

City of Lago Vista Monthly Water Accounting Report



For the Month of: **May**

Year: **2023**

WATER PRODUCED (GAL)

1 Water Produced **TOTAL PRODUCED: 36,160,000**

WATER SOLD (GAL)

2	Residential	26,731,700	
3	Commercial	2,064,400	
4	City Irrigation	242,700	
5	Fire Hydrant Meters	725,500	
6	City Meters (Y & Z routes)	2,573,700	
7	Other Sales (explain): 2nd meter	9,200	
8	TOTAL WATER SOLD:	32,347,200	89.46%

BREAKDOWN OF UNBILLED WATER USAGE (GAL)

9	Water Treatment Plant #1: Process Loss	224,000
10	Water Treatment Plant # 3: Process Loss & Backwash	211,000
11	Wastewater Treatment Plant:	0
12	System Flushing	0
13	Fire Department Usage:	
14	Other Usage (explain): off, not charged	2,507,900
15	lines 9-14 TOTAL UNBILLED WATER USAGE	2,942,900

BREAKDOWN OF KNOWN WATER LOST (GAL)

16	Tank Overflows/Drainage	
17	Excavation Breaks	
18	Water Line Breaks	950
19	lines 16-18 TOTAL KNOWN WATER LOST	950

TOTAL UNACCOUNTED WATER LOSS (GAL)

20 **TOTAL UNACCOUNTED WATER: 868,950 2.40%**

CITY OF LAGO VISTA WATER & WASTEWATER REPORT

May 2023



Water Production

This Month		Total Production - 38.540 MG				
	Raw Water	Production	Efficiency	Highest Day	Average Day	Lowest Day
Water Plant 1	17.451 MG	16.003 MG	91.7%	0.729 MG	0.516 MG	0.321 MG
Water Plant 2	0.000 MG	0.000 MG	∞%	--- MG	0.000 MG	--- MG
Water Plant 3	22.800 MG	22.537 MG	98.8%	0.887 MG	0.727 MG	0.556 MG
Combined	40.252 MG	38.540 MG	95.7%	1.616 MG	1.243 MG	0.899 MG

Past 12 Months		Total Production - 531.133 MG				
	Raw Water	Production	Efficiency	Highest Day	Average Day	Lowest Day
Water Plant 1	229.261 MG	221.645 MG	96.7%	1.047 MG	0.607 MG	0.158 MG
Water Plant 2	0.000 MG	0.000 MG	∞%	--- MG	0.000 MG	--- MG
Water Plant 3	314.009 MG	309.489 MG	98.6%	1.531 MG	0.848 MG	0.460 MG
Combined	543.270 MG	531.133 MG	97.8%	2.543 MG	1.455 MG	0.684 MG

Waste Water Treatment

This Month		Total Treated - 20.076 MG			
	Treated	Highest Day	Average Day	Lowest Day	
Waste Water Treatment Plant	20.076 MG	0.810 MG	0.648 MG	0.540 MG	

Past 12 Months		Total Treated - 134.639 MG			
	Treated	Highest Day	Average Day	Lowest Day	
Waste Water Treatment Plant	134.639 MG	0.980 MG	0.369 MG	0.000 MG	

Effluent Disposal


This Month		WWTP Plant Permit Total - 0.000 MG			
	Total	Highest Day	Average Day	Lowest Day	
Lago Vista Golf Course Permit	0.000 MG	0.001 MG	0.000 MG	-0.001 MG	
Cedar Breaks Permit	0.000 MG	0.001 MG	0.000 MG	-0.001 MG	
WWTP Plant Permit Total	0.000 MG	0.001 MG	0.000 MG	-0.001 MG	
Reclaimed Effluent 210A Permit	0.001 MG	0.001 MG	0.000 MG	0.000 MG	

Past 12 Months		WWTP Plant Permit Total - 0.000 MG			
	Total	Highest Day	Average Day	Lowest Day	
Lago Vista Golf Course Permit	0.000 MG	0.001 MG	0.000 MG	-0.001 MG	
Cedar Breaks Permit	0.000 MG	0.001 MG	0.000 MG	-0.001 MG	
WWTP Plant Permit Total	0.000 MG	0.001 MG	0.000 MG	-0.001 MG	
Reclaimed Effluent 210A Permit	0.003 MG	0.001 MG	0.000 MG	0.000 MG	

May 2023

Combined Water Production

This Month

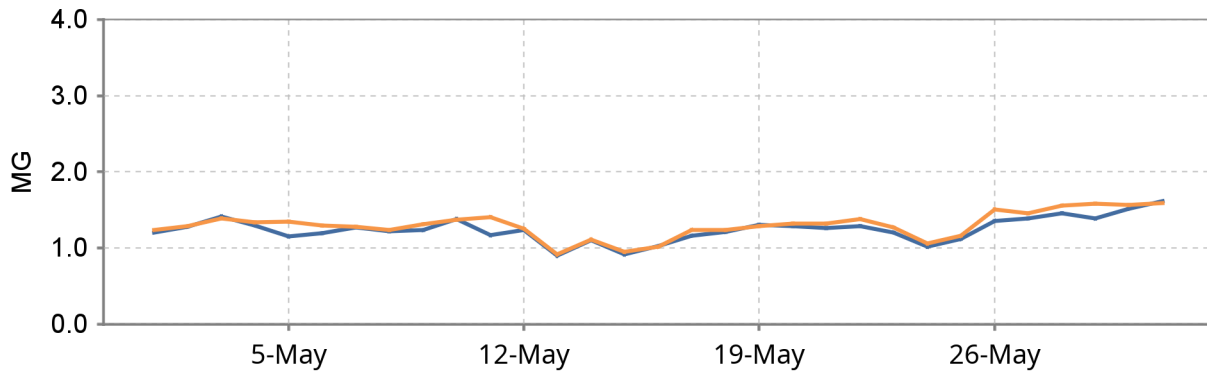


Date	WP1 Raw	WP2 Raw	WP3 Raw	Combined Raw	WP1 Finished	WP2 Finished	WP3 Finished	Combined Finished
05/01/23	0.508	---	0.732	1.240	0.528	---	0.675	1.203
05/02/23	0.518	---	0.767	1.286	0.510	---	0.765	1.274
05/03/23	0.568	---	0.822	1.390	0.599	---	0.817	1.416
05/04/23	0.608	---	0.729	1.337	0.550	---	0.748	1.299
05/05/23	0.608	---	0.737	1.345	0.453	---	0.701	1.153
05/06/23	0.564	---	0.734	1.298	0.466	---	0.725	1.190
05/07/23	0.540	---	0.735	1.275	0.500	---	0.769	1.269
05/08/23	0.530	---	0.707	1.237	0.529	---	0.689	1.218
05/09/23	0.618	---	0.692	1.311	0.593	---	0.644	1.237
05/10/23	0.657	---	0.716	1.373	0.610	---	0.765	1.375
05/11/23	0.695	---	0.707	1.402	0.520	---	0.649	1.169
05/12/23	0.553	---	0.699	1.252	0.539	---	0.694	1.233
05/13/23	0.360	---	0.552	0.912	0.343	---	0.556	0.899
05/14/23	0.379	---	0.727	1.105	0.384	---	0.720	1.103
05/15/23	0.370	---	0.578	0.947	0.353	---	0.560	0.913
05/16/23	0.367	---	0.646	1.014	0.353	---	0.673	1.026
05/17/23	0.552	---	0.683	1.235	0.489	---	0.674	1.163
05/18/23	0.476	---	0.762	1.239	0.491	---	0.717	1.208
05/19/23	0.569	---	0.715	1.284	0.550	---	0.757	1.307
05/20/23	0.539	---	0.781	1.320	0.520	---	0.769	1.290
05/21/23	0.569	---	0.752	1.320	0.531	---	0.734	1.265
05/22/23	0.601	---	0.781	1.382	0.551	---	0.732	1.283
05/23/23	0.507	---	0.758	1.266	0.488	---	0.711	1.199
05/24/23	0.393	---	0.669	1.062	0.321	---	0.697	1.018
05/25/23	0.500	---	0.660	1.160	0.476	---	0.641	1.117
05/26/23	0.730	---	0.778	1.508	0.591	---	0.761	1.353
05/27/23	0.658	---	0.794	1.452	0.582	---	0.808	1.390
05/28/23	0.702	---	0.858	1.560	0.588	---	0.864	1.453
05/29/23	0.819	---	0.766	1.586	0.636	---	0.750	1.385
05/30/23	0.690	---	0.871	1.562	0.630	---	0.887	1.517
05/31/23	0.703	---	0.890	1.593	0.729	---	0.887	1.616
Total (MG)	17.451	0.000	22.800	40.252	16.003	0.000	22.537	38.540
Highest	0.819	---	0.890	1.593	0.729	---	0.887	1.616
Average	0.563	0.000	0.735	1.298	0.516	0.000	0.727	1.243
Lowest	0.360	---	0.552	0.912	0.321	---	0.556	0.899

May 2023

Water Plant 1 Water Production

This Month

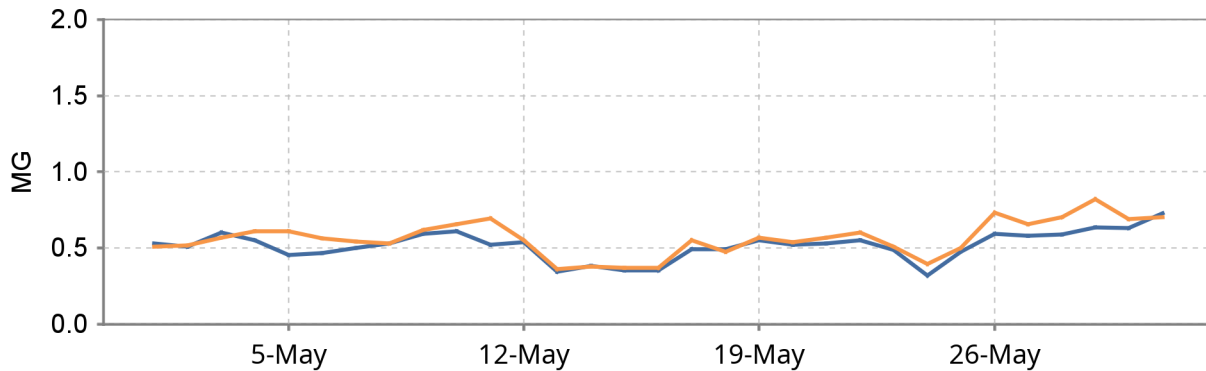


Date	WP1 Raw	WP1 Clarifier A	WP1 Clarifier B	WP1 Finished	WP1 Process Loss	WP1 Efficiency
05/01/23	0.508	0.298	0.215	0.528	-0.020	104%
05/02/23	0.518	0.307	0.215	0.510	0.009	98%
05/03/23	0.568	0.328	0.235	0.599	-0.031	105%
05/04/23	0.608	0.358	0.246	0.550	0.058	91%
05/05/23	0.608	0.327	0.246	0.453	0.155	74%
05/06/23	0.564	0.327	0.236	0.466	0.099	82%
05/07/23	0.540	0.304	0.236	0.500	0.040	93%
05/08/23	0.530	0.317	0.226	0.529	0.001	100%
05/09/23	0.618	0.360	0.256	0.593	0.025	96%
05/10/23	0.657	0.370	0.286	0.610	0.047	93%
05/11/23	0.695	0.388	0.314	0.520	0.176	75%
05/12/23	0.553	0.264	0.278	0.539	0.013	98%
05/13/23	0.360	0.172	0.196	0.343	0.017	95%
05/14/23	0.379	0.182	0.196	0.384	-0.005	101%
05/15/23	0.370	0.173	0.196	0.353	0.016	96%
05/16/23	0.367	0.172	0.196	0.353	0.015	96%
05/17/23	0.552	0.255	0.289	0.489	0.063	89%
05/18/23	0.476	0.223	0.258	0.491	-0.015	103%
05/19/23	0.569	0.264	0.310	0.550	0.019	97%
05/20/23	0.539	0.244	0.289	0.520	0.018	97%
05/21/23	0.569	0.254	0.321	0.531	0.037	93%
05/22/23	0.601	0.284	0.320	0.551	0.050	92%
05/23/23	0.507	0.233	0.279	0.488	0.019	96%
05/24/23	0.393	0.183	0.196	0.321	0.073	82%
05/25/23	0.500	0.234	0.268	0.476	0.024	95%
05/26/23	0.730	0.375	0.351	0.591	0.138	81%
05/27/23	0.658	0.314	0.351	0.582	0.076	88%
05/28/23	0.702	0.334	0.372	0.588	0.114	84%
05/29/23	0.819	0.385	0.433	0.636	0.184	78%
05/30/23	0.690	0.334	0.351	0.630	0.060	91%
05/31/23	0.703	0.336	0.372	0.729	-0.027	104%
Total (MG)	17.451	8.899	8.532	16.003	1.448	-
Highest	0.819	0.388	0.433	0.729	-	-
Average	0.563	0.287	0.275	0.516	-	92%
Lowest	0.360	0.172	0.196	0.321	-	-

May 2023

Water Plant 2 Water Production

This Month

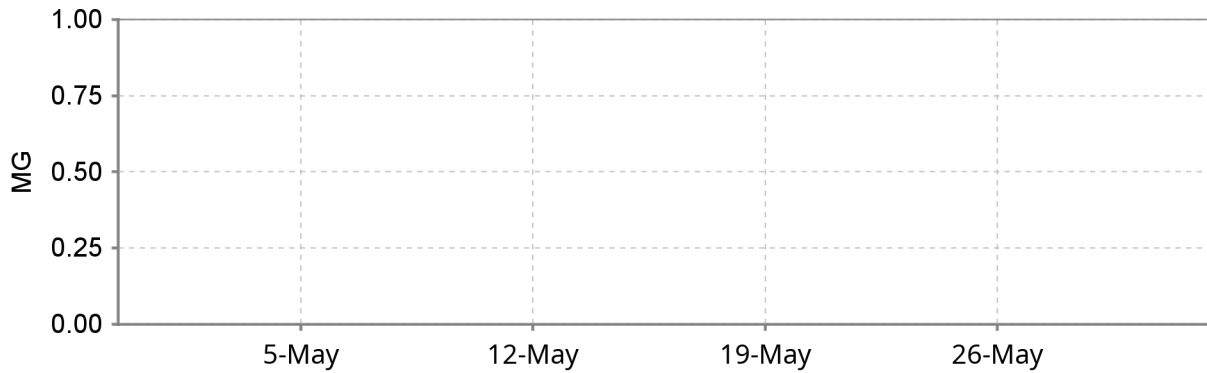


Date	WP2 Raw	To Lohmans	To Golfball	From Golfball	WP2 Finished	WP2 Process Loss	WP2 Efficiency
05/01/23	---	---	---	---	---	---	---%
05/02/23	---	---	---	---	---	---	---%
05/03/23	---	---	---	---	---	---	---%
05/04/23	---	---	---	---	---	---	---%
05/05/23	---	---	---	---	---	---	---%
05/06/23	---	---	---	---	---	---	---%
05/07/23	---	---	---	---	---	---	---%
05/08/23	---	---	---	---	---	---	---%
05/09/23	---	---	---	---	---	---	---%
05/10/23	---	---	---	---	---	---	---%
05/11/23	---	---	---	---	---	---	---%
05/12/23	---	---	---	---	---	---	---%
05/13/23	---	---	---	---	---	---	---%
05/14/23	---	---	---	---	---	---	---%
05/15/23	---	---	---	---	---	---	---%
05/16/23	---	---	---	---	---	---	---%
05/17/23	---	---	---	---	---	---	---%
05/18/23	---	---	---	---	---	---	---%
05/19/23	---	---	---	---	---	---	---%
05/20/23	---	---	---	---	---	---	---%
05/21/23	---	---	---	---	---	---	---%
05/22/23	---	---	---	---	---	---	---%
05/23/23	---	---	---	---	---	---	---%
05/24/23	---	---	---	---	---	---	---%
05/25/23	---	---	---	---	---	---	---%
05/26/23	---	---	---	---	---	---	---%
05/27/23	---	---	---	---	---	---	---%
05/28/23	---	---	---	---	---	---	---%
05/29/23	---	---	---	---	---	---	---%
05/30/23	---	---	---	---	---	---	---%
05/31/23	---	---	---	---	---	---	---%
Total (MG)	0.000	0.000	0.000	0.000	0.000	0.000	-
Highest	---	---	---	---	---	-	-
Average	0.000	0.000	0.000	0.000	0.000	-	∞%
Lowest	---	---	---	---	---	-	-

May 2023

Water Plant 3 Water Production

This Month

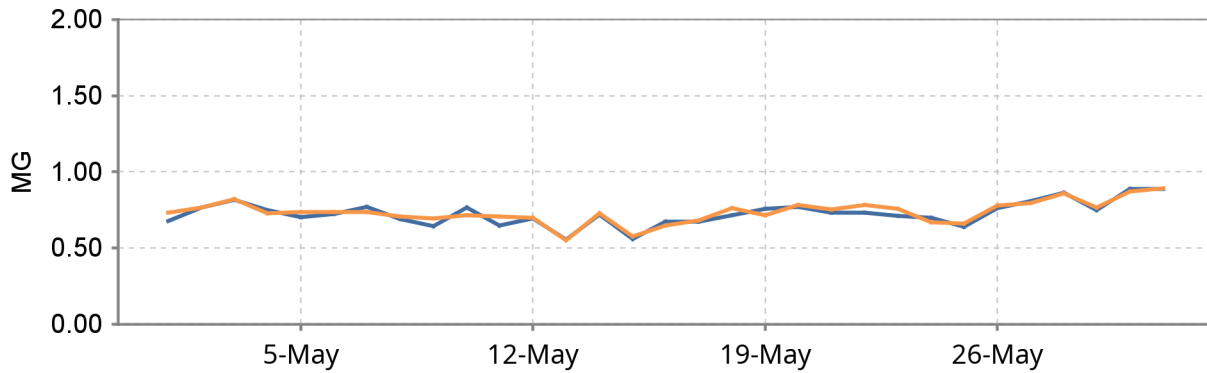


Date	WP3 Raw	WP3 Unit 1	WP3 Decant	WP3 Backwash	WP3 Finished	WP3 Process Loss	WP3 Efficiency
05/01/23	0.732	0.721	0.000	0.000	0.675	0.057	92%
05/02/23	0.767	0.788	0.000	0.000	0.765	0.003	100%
05/03/23	0.822	0.877	0.000	0.046	0.817	0.005	99%
05/04/23	0.729	0.714	0.000	0.009	0.748	-0.020	103%
05/05/23	0.737	0.762	0.000	0.000	0.701	0.036	95%
05/06/23	0.734	0.741	0.000	0.000	0.725	0.009	99%
05/07/23	0.735	0.787	0.000	0.053	0.769	-0.034	105%
05/08/23	0.707	0.723	0.000	0.001	0.689	0.018	97%
05/09/23	0.692	0.691	0.000	0.000	0.644	0.049	93%
05/10/23	0.716	0.723	0.000	0.000	0.765	-0.050	107%
05/11/23	0.707	0.741	0.000	0.053	0.649	0.058	92%
05/12/23	0.699	0.743	0.000	0.002	0.694	0.005	99%
05/13/23	0.552	0.568	0.000	0.000	0.556	-0.004	101%
05/14/23	0.727	0.718	0.000	0.000	0.720	0.007	99%
05/15/23	0.578	0.580	0.000	0.000	0.560	0.018	97%
05/16/23	0.646	0.709	0.000	0.052	0.673	-0.027	104%
05/17/23	0.683	0.686	0.000	0.002	0.674	0.009	99%
05/18/23	0.762	0.778	0.000	0.000	0.717	0.046	94%
05/19/23	0.715	0.709	0.000	0.000	0.757	-0.041	106%
05/20/23	0.781	0.836	0.000	0.055	0.769	0.012	99%
05/21/23	0.752	0.779	0.000	0.000	0.734	0.018	98%
05/22/23	0.781	0.744	0.000	0.000	0.732	0.049	94%
05/23/23	0.758	0.767	0.000	0.000	0.711	0.048	94%
05/24/23	0.669	0.724	0.000	0.047	0.697	-0.028	104%
05/25/23	0.660	0.672	0.000	0.007	0.641	0.020	97%
05/26/23	0.778	0.779	0.000	0.000	0.761	0.016	98%
05/27/23	0.794	0.810	0.000	0.000	0.808	-0.014	102%
05/28/23	0.858	0.909	0.000	0.051	0.864	-0.007	101%
05/29/23	0.766	0.783	0.000	0.004	0.750	0.016	98%
05/30/23	0.871	0.865	0.000	0.000	0.887	-0.015	102%
05/31/23	0.890	0.906	0.000	0.000	0.887	0.003	100%
Total (MG)	22.800	23.329	0.000	0.381	22.537	0.263	-
Highest	0.890	0.909	0.000	0.055	0.887	-	-
Average	0.735	0.753	0.000	0.012	0.727	-	99%
Lowest	0.552	0.568	0.000	0.000	0.556	-	-

May 2023

Waste Water Treatment

This Month

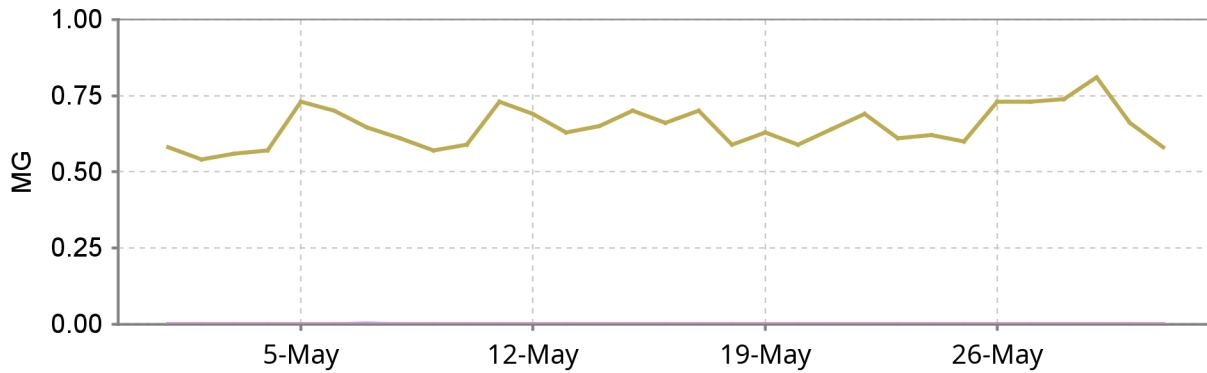


Date	WWTP Treated	LVGC Permit	Cedar Breaks Permit	WWTP Permit	Reclaimed Effluent 210A Permit
05/01/23	0.580	0.000	0.000	0.000	0.000
05/02/23	0.540	0.000	0.000	0.000	0.000
05/03/23	0.560	0.000	0.000	0.000	0.000
05/04/23	0.570	0.000	0.000	0.000	0.000
05/05/23	0.730	0.000	0.000	0.000	0.000
05/06/23	0.700	0.000	0.000	0.000	0.000
05/07/23	0.646	0.001	0.001	0.001	0.001
05/08/23	0.610	0.000	0.000	0.000	0.000
05/09/23	0.570	0.000	0.000	0.000	0.000
05/10/23	0.590	0.000	0.000	0.000	0.000
05/11/23	0.730	0.000	0.000	0.000	0.000
05/12/23	0.690	0.000	0.000	0.000	0.000
05/13/23	0.630	0.000	0.000	0.000	0.000
05/14/23	0.650	0.000	0.000	0.000	0.000
05/15/23	0.700	-0.001	-0.001	-0.001	0.000
05/16/23	0.660	0.000	0.000	0.000	0.000
05/17/23	0.700	0.000	0.000	0.000	0.000
05/18/23	0.590	0.000	0.000	0.000	0.000
05/19/23	0.630	0.000	0.000	0.000	0.000
05/20/23	0.590	0.000	0.000	0.000	0.000
05/21/23	0.640	0.000	0.000	0.000	0.000
05/22/23	0.690	0.000	0.000	0.000	0.000
05/23/23	0.610	0.000	0.000	0.000	0.000
05/24/23	0.620	0.000	0.000	0.000	0.000
05/25/23	0.600	0.000	0.000	0.000	0.000
05/26/23	0.730	0.000	0.000	0.000	0.000
05/27/23	0.730	0.000	0.000	0.000	0.000
05/28/23	0.740	0.000	0.000	0.000	0.000
05/29/23	0.810	0.000	0.000	0.000	0.000
05/30/23	0.660	0.000	0.000	0.000	0.000
05/31/23	0.580	0.000	0.000	0.000	0.000
Total (MG)	20.076	0.000	0.000	0.000	0.001
Highest	0.810	0.001	0.001	0.001	0.001
Average	0.648	0.000	0.000	0.000	0.000
Lowest	0.540	-0.001	-0.001	-0.001	0.000

May 2023

Effluent Disposal


This Month

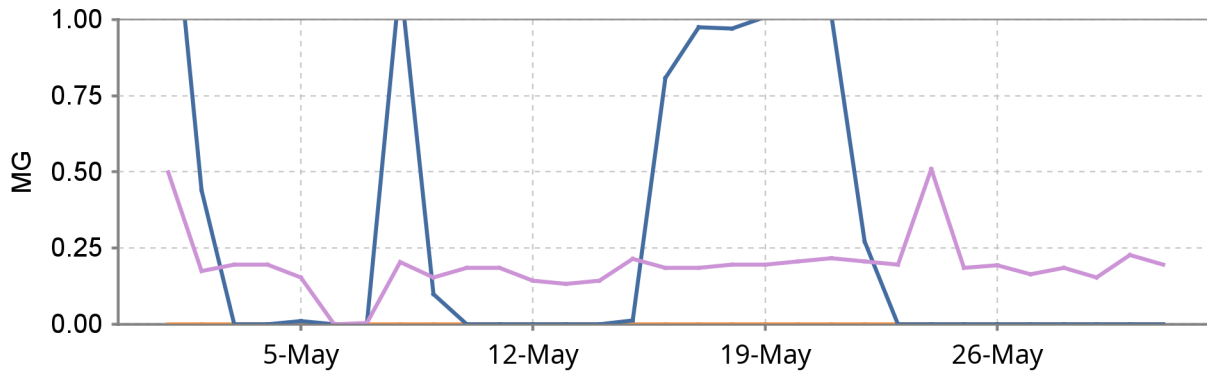

Date	LVGC Usage	LVGC Permit	Cedar Brks. Usage	Cedar Brks. Permit	HLGC Usage	Reclaimed E 210A Permit	LVGC Lake Water	HLGC Lake Water
05/01/23	0.498	0.000	1.562	0.000	0.000	0.000	0.000	---
05/02/23	0.174	0.000	0.440	0.000	0.000	0.000	0.000	---
05/03/23	0.195	0.000	0.000	0.000	0.000	0.000	0.000	---
05/04/23	0.195	0.000	0.000	0.000	0.000	0.000	0.000	---
05/05/23	0.154	0.000	0.010	0.000	0.000	0.000	0.000	---
05/06/23	0.000	0.000	0.000	0.000	0.000	0.000	-0.001	---
05/07/23	0.004	0.001	0.000	0.001	0.000	0.001	0.000	---
05/08/23	0.203	0.000	1.134	0.000	0.000	0.000	0.000	---
05/09/23	0.153	0.000	0.098	0.000	0.000	0.000	0.000	---
05/10/23	0.184	0.000	0.000	0.000	0.000	0.000	0.000	---
05/11/23	0.185	0.000	0.000	0.000	0.000	0.000	0.000	---
05/12/23	0.143	0.000	0.000	0.000	0.000	0.000	0.000	---
05/13/23	0.133	0.000	0.000	0.000	0.000	0.000	0.000	---
05/14/23	0.142	0.000	0.000	0.000	0.000	0.000	0.000	---
05/15/23	0.215	-0.001	0.011	-0.001	0.000	0.000	0.000	---
05/16/23	0.185	0.000	0.808	0.000	0.000	0.000	0.000	---
05/17/23	0.184	0.000	0.975	0.000	0.000	0.000	0.000	---
05/18/23	0.195	0.000	0.972	0.000	0.000	0.000	0.000	---
05/19/23	0.195	0.000	1.009	0.000	0.000	0.000	0.000	---
05/20/23	0.205	0.000	1.006	0.000	0.000	0.000	0.000	---
05/21/23	0.216	0.000	1.016	0.000	0.000	0.000	0.000	---
05/22/23	0.205	0.000	0.271	0.000	0.000	0.000	0.000	---
05/23/23	0.195	0.000	0.000	0.000	0.000	0.000	0.000	---
05/24/23	0.508	0.000	0.000	0.000	0.000	0.000	0.000	---
05/25/23	0.184	0.000	0.000	0.000	0.000	0.000	0.000	---
05/26/23	0.193	0.000	0.000	0.000	0.000	0.000	0.000	---
05/27/23	0.163	0.000	0.000	0.000	0.000	0.000	0.000	---
05/28/23	0.184	0.000	0.000	0.000	0.000	0.000	0.000	---
05/29/23	0.153	0.000	0.000	0.000	0.000	0.000	0.000	---
05/30/23	0.226	0.000	0.000	0.000	0.000	0.000	0.000	---
05/31/23	0.196	0.000	0.000	0.000	0.000	0.000	0.000	---
Total (MG)	5.963	0.000	9.311	0.000	0.000	0.001	-0.001	0.000
Highest	0.508	0.001	1.562	0.001	0.000	0.001	0.000	---
Average	0.192	0.000	0.300	0.000	0.000	0.000	0.000	0.000
Lowest	0.000	-0.001	0.000	-0.001	0.000	0.000	-0.001	---

Combined Water Production


Past 12 Months

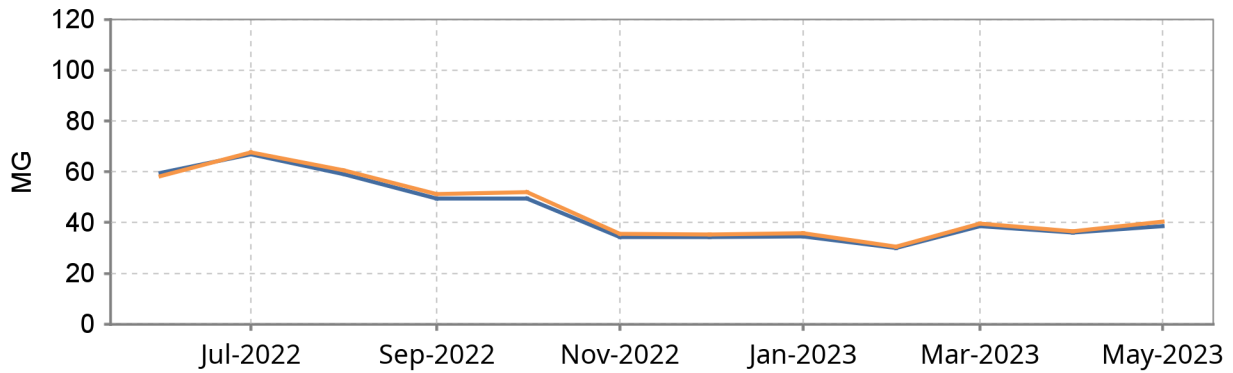

Date	WP1 Raw	WP2 Raw	WP3 Raw	Combined Raw	WP1 Finished	WP2 Finished	WP3 Finished	Combined Finished
Jun, 2022	22.950	---	35.341	58.291	24.539	---	34.923	59.462
Jul, 2022	28.395	---	39.319	67.715	28.046	---	38.865	66.911
Aug, 2022	26.112	---	34.540	60.653	24.930	---	34.125	59.054
Sep, 2022	22.545	---	28.651	51.196	21.394	---	28.178	49.572
Oct, 2022	23.281	---	28.661	51.942	21.235	---	28.180	49.416
Nov, 2022	14.785	---	20.696	35.481	13.853	---	20.480	34.333
Dec, 2022	14.185	---	21.042	35.227	13.571	---	20.768	34.339
Jan, 2023	15.114	---	20.628	35.742	14.589	---	20.074	34.662
Feb, 2023	12.903	---	17.658	30.562	12.690	---	17.364	30.054
Mar, 2023	16.666	---	22.948	39.614	16.147	---	22.483	38.631
Apr, 2023	14.872	---	21.724	36.596	14.648	---	21.512	36.160
May, 2023	17.451	---	22.800	40.252	16.003	---	22.537	38.540
Total (MG)	229.261	0.000	314.009	543.270	221.645	0.000	309.489	531.133
Highest	28.395	---	39.319	67.715	28.046	---	38.865	66.911
Average	19.105	0.000	26.167	45.273	18.470	0.000	25.791	44.261
Lowest	12.903	---	17.658	30.562	12.690	---	17.364	30.054

Water Plant 1 Water Production

Past 12 Months

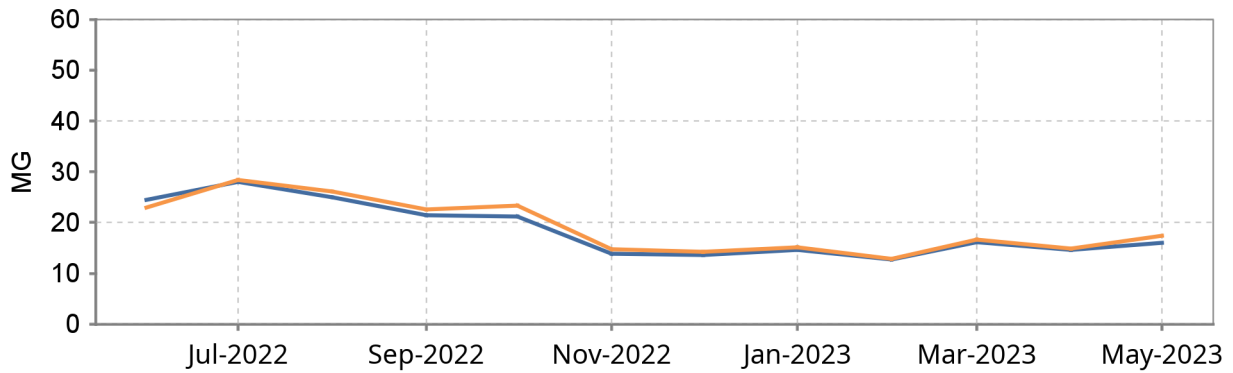


Date	WP1 Raw	WP1 Clarifier A	WP1 Clarifier B	WP1 Finished	WP1 Process Loss	WP1 Efficiency
Jun, 2022	22.950	11.620	11.332	24.539	-1.589	107%
Jul, 2022	28.395	14.380	14.010	28.046	0.349	99%
Aug, 2022	26.112	13.330	12.789	24.930	1.183	95%
Sep, 2022	22.545	11.473	11.072	21.394	1.151	95%
Oct, 2022	23.281	11.739	11.545	21.235	2.046	91%
Nov, 2022	14.785	8.000	6.782	13.853	0.932	94%
Dec, 2022	14.185	8.120	6.060	13.571	0.614	96%
Jan, 2023	15.114	8.843	6.277	14.589	0.525	97%
Feb, 2023	12.903	7.611	5.506	12.690	0.213	98%
Mar, 2023	16.666	9.586	7.088	16.147	0.519	97%
Apr, 2023	14.872	8.604	6.259	14.648	0.224	98%
May, 2023	17.451	8.899	8.532	16.003	1.448	92%
Total (MG)	229.261	122.205	107.253	221.645	7.616	-
Highest	28.395	14.380	14.010	28.046	-	-
Average	19.105	10.184	8.938	18.470	-	97%
Lowest	12.903	7.611	5.506	12.690	-	-

May 2023

Water Plant 2 Water Production

Past 12 Months

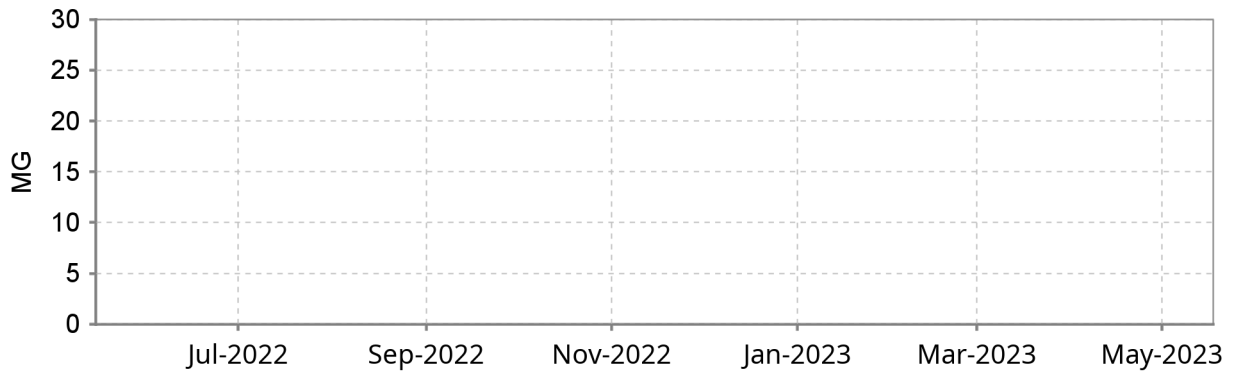


Date	WP2 Raw	To Lohmans	To Golfball	From Golfball	WP2 Finished	WP2 Process Loss	WP2 Efficiency
Jun, 2022	---	---	---	---	---	---	---%
Jul, 2022	---	---	---	---	---	---	---%
Aug, 2022	---	---	---	---	---	---	---%
Sep, 2022	---	---	---	---	---	---	---%
Oct, 2022	---	---	---	---	---	---	---%
Nov, 2022	---	---	---	---	---	---	---%
Dec, 2022	---	---	---	---	---	---	---%
Jan, 2023	---	---	---	---	---	---	---%
Feb, 2023	---	---	---	---	---	---	---%
Mar, 2023	---	---	---	---	---	---	---%
Apr, 2023	---	---	---	---	---	---	---%
May, 2023	---	---	---	---	---	---	---%
Total (MG)	0.000	0.000	0.000	0.000	0.000	0.000	-
Highest	---	---	---	---	---	-	-
Average	0.000	0.000	0.000	0.000	0.000	-	∞%
Lowest	---	---	---	---	---	-	-

May 2023

Water Plant 3 Water Production

Past 12 Months

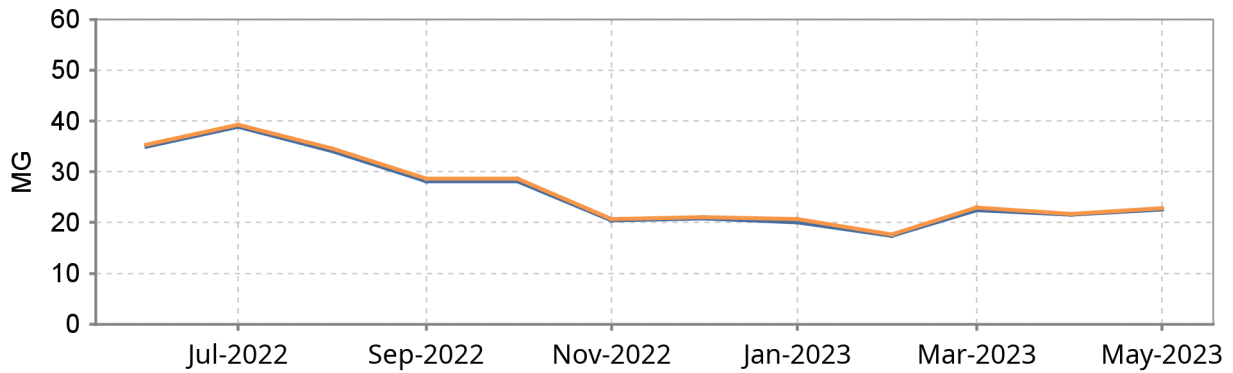


Date	WP3 Raw	WP3 Unit 1	WP3 Decant	WP3 Backwash	WP3 Finished	WP3 Process Loss	WP3 Efficiency
Jun, 2022	35.341	35.771	0.000	0.584	34.923	0.418	99%
Jul, 2022	39.319	39.852	0.000	0.693	38.865	0.455	99%
Aug, 2022	34.540	34.876	0.000	0.535	34.125	0.416	99%
Sep, 2022	28.651	28.857	0.000	0.483	28.178	0.473	98%
Oct, 2022	28.661	29.068	0.000	0.487	28.180	0.481	98%
Nov, 2022	20.696	21.352	0.000	0.375	20.480	0.216	99%
Dec, 2022	21.042	21.749	0.000	0.334	20.768	0.275	99%
Jan, 2023	20.628	21.082	0.000	0.372	20.074	0.555	97%
Feb, 2023	17.658	18.241	0.000	0.373	17.364	0.295	98%
Mar, 2023	22.948	23.459	0.000	0.390	22.483	0.465	98%
Apr, 2023	21.724	22.270	0.000	0.327	21.512	0.211	99%
May, 2023	22.800	23.329	0.000	0.381	22.537	0.263	99%
Total (MG)	314.009	319.907	0.000	5.335	309.489	4.521	-
Highest	39.319	39.852	0.000	0.693	38.865	-	-
Average	26.167	26.659	0.000	0.445	25.791	-	99%
Lowest	17.658	18.241	0.000	0.327	17.364	-	-

May 2023

Waste Water Treatment


Past 12 Months

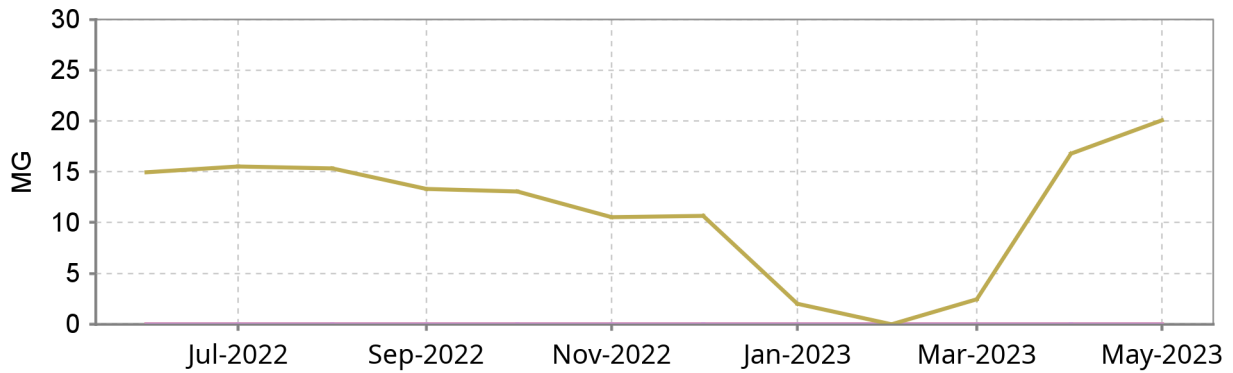

Date	WWTP Treated	LVGC Permit	Cedar Breaks Permit	WWTP Permit	Reclaimed Effluent 210A Permit
Jun, 2022	14.961	0.000	0.000	0.000	0.000
Jul, 2022	15.561	0.000	0.000	0.000	0.000
Aug, 2022	15.319	0.001	0.001	0.001	0.001
Sep, 2022	13.303	-0.001	-0.001	-0.001	0.000
Oct, 2022	13.091	0.000	0.000	0.000	0.000
Nov, 2022	10.530	0.000	0.000	0.000	0.000
Dec, 2022	10.638	0.000	0.000	0.000	0.000
Jan, 2023	1.980	0.000	0.000	0.000	0.000
Feb, 2023	0.000	0.000	0.000	0.000	0.001
Mar, 2023	2.410	0.000	0.000	0.000	0.000
Apr, 2023	16.770	0.000	0.000	0.000	0.000
May, 2023	20.076	0.000	0.000	0.000	0.001
Total (MG)	134.639	0.000	0.000	0.000	0.003
Highest	20.076	0.001	0.001	0.001	0.001
Average	11.220	0.000	0.000	0.000	0.000
Lowest	0.000	-0.001	-0.001	-0.001	0.000

Effluent Disposal


Past 12 Months

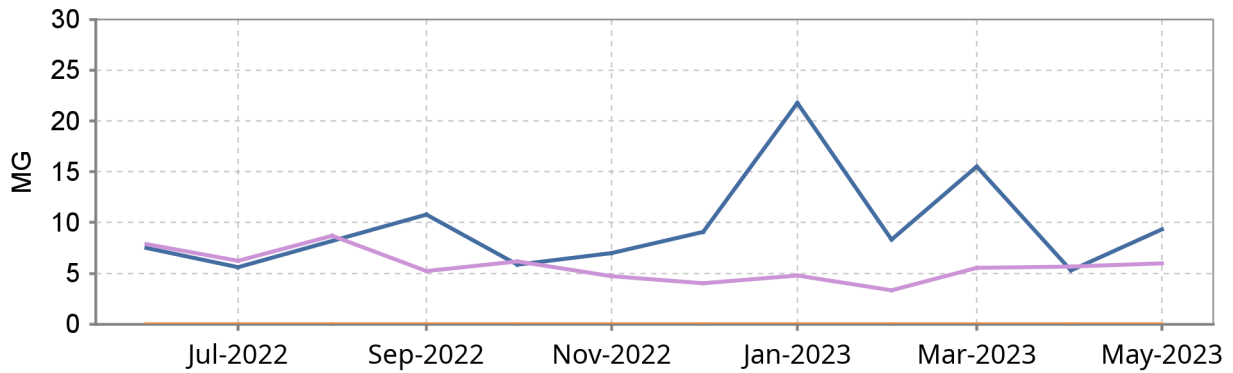

Date	LVGC Usage	LVGC Permit	Cedar Brks. Usage	Cedar Brks. Permit	HLGC Usage	Reclaimed E 210A Permit	LVGC Lake Water	HLGC Lake Water
Jun, 2022	7.887	0.000	7.508	0.000	0.000	0.000	0.001	---
Jul, 2022	6.212	0.000	5.603	0.000	0.000	0.000	0.002	---
Aug, 2022	8.699	0.001	8.224	0.001	0.000	0.001	0.003	---
Sep, 2022	5.240	-0.001	10.806	-0.001	0.000	0.000	0.002	---
Oct, 2022	6.161	0.000	5.885	0.000	0.000	0.000	0.004	---
Nov, 2022	4.724	0.000	6.972	0.000	0.000	0.000	-0.013	---
Dec, 2022	4.015	0.000	9.067	0.000	0.000	0.000	-0.002	---
Jan, 2023	4.802	0.000	21.797	0.000	0.000	0.000	0.000	---
Feb, 2023	3.335	0.000	8.305	0.000	0.000	0.001	0.000	---
Mar, 2023	5.552	0.000	15.544	0.000	0.000	0.000	0.000	---
Apr, 2023	5.639	0.000	5.279	0.000	0.000	0.000	0.000	---
May, 2023	5.963	0.000	9.311	0.000	0.000	0.001	-0.001	---
Total (MG)	68.228	0.000	114.301	0.000	0.000	0.003	-0.002	0.000
Highest	8.699	0.001	21.797	0.001	0.000	0.001	0.004	---
Average	5.686	0.000	9.525	0.000	0.000	0.000	0.000	0.000
Lowest	3.335	-0.001	5.279	-0.001	0.000	0.000	-0.013	---

Combined Water Production

5 Year Average Daily Production

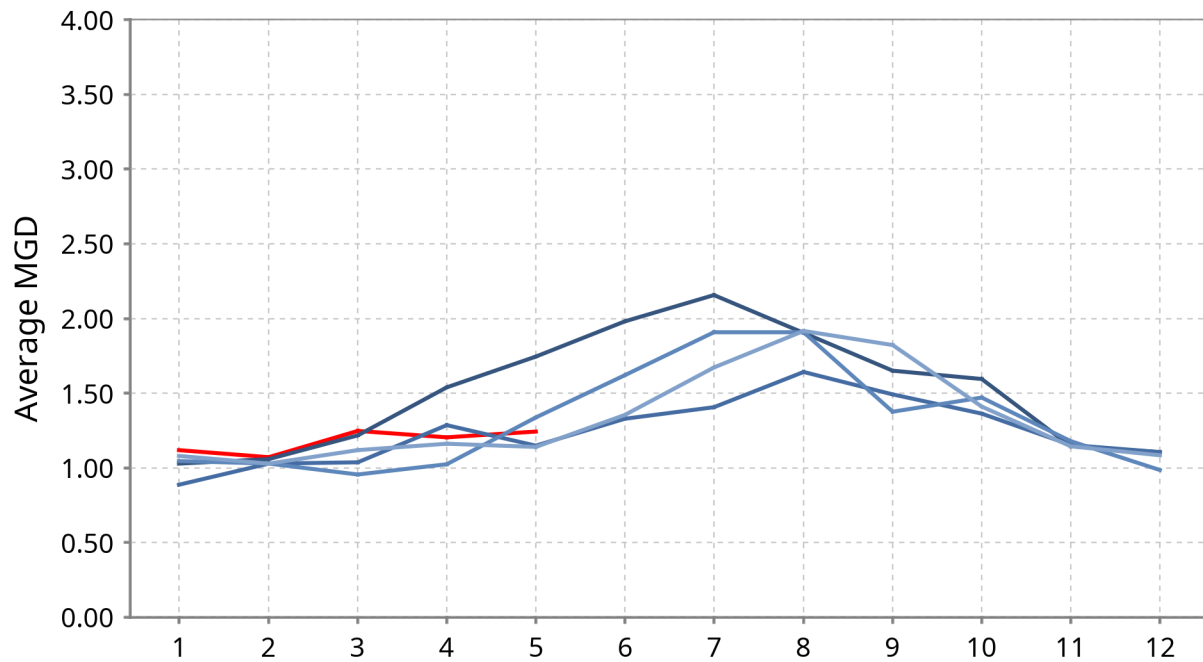


Month	Year - 4	Year - 3	Year - 2	Last Year	This Year
Jan	1.080	1.047	0.888	1.027	1.118
Feb	1.030	1.031	1.030	1.059	1.073
Mar	1.118	0.957	1.039	1.217	1.246
Apr	1.161	1.023	1.285	1.541	1.205
May	1.139	1.339	1.149	1.744	1.243
Jun	1.355	1.621	1.330	1.982	---
Jul	1.671	1.906	1.407	2.158	---
Aug	1.916	1.909	1.642	1.905	---
Sep	1.822	1.376	1.492	1.652	---
Oct	1.412	1.469	1.365	1.594	---
Nov	1.143	1.178	1.153	1.144	---
Dec	1.085	0.985	1.105	1.108	---

Highest	1.916	1.909	1.642	2.158	1.246
Average	1.328	1.320	1.240	1.511	1.177
Lowest	1.030	0.957	0.888	1.027	1.073

May 2023

Waste Water Treatment

5 Year Average Daily Treated

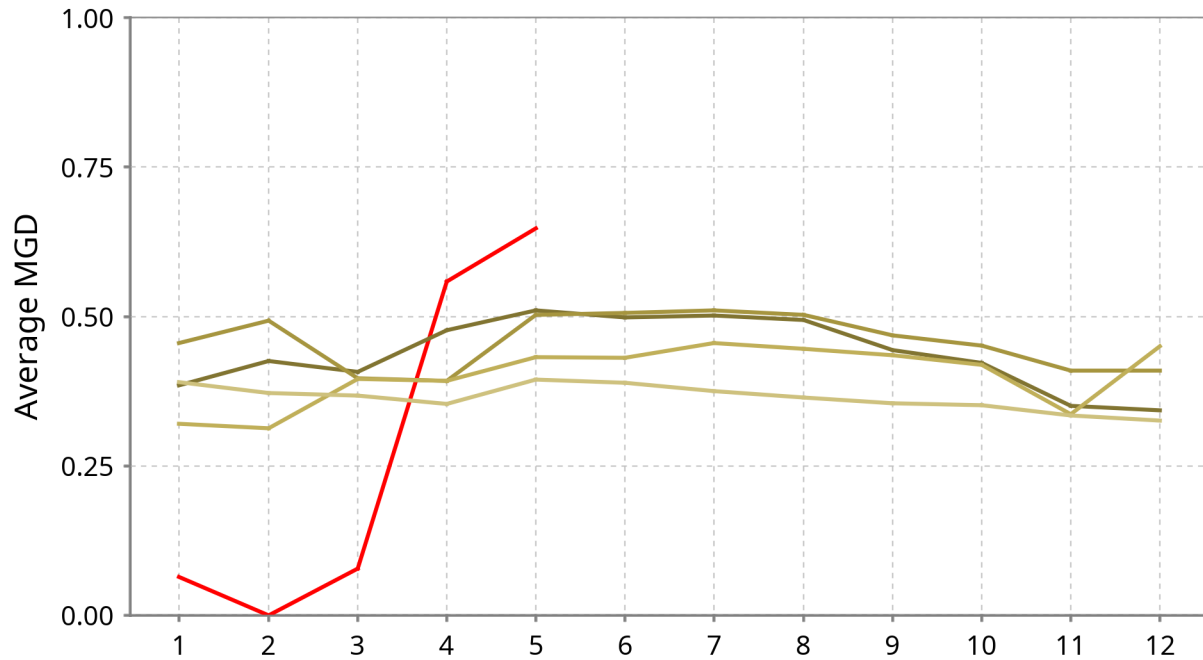

Month	Year - 4	Year - 3	Year - 2	Last Year	This Year
Jan	0.390	0.320	0.456	0.385	0.064
Feb	0.372	0.313	0.493	0.425	0.000
Mar	0.367	0.396	0.396	0.407	0.078
Apr	0.354	0.392	0.392	0.477	0.559
May	0.395	0.431	0.503	0.511	0.648
Jun	0.389	0.431	0.506	0.499	---
Jul	0.375	0.455	0.510	0.502	---
Aug	0.365	0.446	0.503	0.494	---
Sep	0.355	0.435	0.469	0.443	---
Oct	0.352	0.419	0.451	0.422	---
Nov	0.335	0.337	0.409	0.351	---
Dec	0.325	0.450	0.410	0.343	---

Highest	0.395	0.455	0.510	0.511	0.648
Average	0.364	0.402	0.458	0.438	0.270
Lowest	0.325	0.313	0.392	0.343	0.000



Work Management Requests

Lago Vista

Date Range: 5/1/2023 - 6/8/2023

Start Date	End Date	Status	Request ID	Type	Sub Type	Assigned To
6/7/2023 12:00 AM	6/7/2023 12:00 AM	In Progress	Water Leak: Surrey Ln	Utilities	Water Leak	Steve Castro
6/5/2023 12:00 AM	6/7/2023 12:00 AM	In Progress	(SEWER SERVICE INSTALL) 20301 CONTINENTAL DR	Utilities	Other	Kurt Peer
6/5/2023 12:00 AM	6/7/2023 12:00 AM	In Progress	(WATER SERVICE INSTALL) 20301 CONTINENTAL DR	Utilities	Other	Kurt Peer
5/29/2023 12:00 AM	5/29/2023 12:00 AM	Received	FH Replacement: Bowie CV	Utilities	FH Issue/Replacement	Kurt Peer
5/29/2023 12:00 AM	5/29/2023 12:00 AM	On Hold	Insert Valve Prep: Bell Lane	Utilities	Other	Michael Bell
5/1/2023 12:00 AM	5/4/2023 12:00 AM	Pending	FH replacement: Hamilton Ave #3	Utilities	FH Issue/Replacement	Kurt Peer
5/1/2023 12:00 AM	5/4/2023 12:00 AM	Pending	FH replacement: Hamilton Ave #2	Utilities	FH Issue/Replacement	Kurt Peer
				Total	7	