

City of Lago Vista Monthly Water Accounting Report



For the Month of: **June**

Year: **2024**

WATER PRODUCED (GAL)

1 Water Produced **TOTAL PRODUCED: 43,835,000**

WATER SOLD (GAL)

2	Residential	28,599,400	
3	Commercial	2,673,800	
4	City Irrigation	1,473,000	
5	Fire Hydrant Meters	959,000	
6	City Meters (Y & Z routes)	2,391,000	
7	Other Sales (explain): 2nd meter main	1,640,000	
8	TOTAL WATER SOLD:	37,736,200	86.09%

BREAKDOWN OF UNBILLED WATER USAGE (GAL)

9	Water Treatment Plant #1: Process Loss	1,057,000
10	Water Treatment Plant # 3: Process Loss & Backwash	322,000
11	Wastewater Treatment Plant:	0
12	System Flushing	75,000
13	Fire Department Usage:	150,000
14	Other Usage (explain): off, not charged	2,233,900
15	lines 9-14 TOTAL UNBILLED WATER USAGE	3,837,900

BREAKDOWN OF KNOWN WATER LOST (GAL)

16	Tank Overflows/Drainage	2,500
17	Excavation Breaks	0
18	Water Line Breaks	
19	lines 16-18 TOTAL KNOWN WATER LOST	2,500

TOTAL UNACCOUNTED WATER LOSS (GAL)

20 **TOTAL UNACCOUNTED WATER: 2,258,400 5.15%**

CITY OF LAGO VISTA WATER & WASTEWATER REPORT

June 2024



Water Production

This Month		Total Production - 43.835 MG				
	Raw Water	Production	Efficiency	Highest Day	Average Day	Lowest Day
Water Plant 1	17.020 MG	15.963 MG	93.8%	0.746 MG	0.532 MG	0.362 MG
Water Plant 2	0.000 MG	0.000 MG	∞%	--- MG	0.000 MG	--- MG
Water Plant 3	28.194 MG	27.872 MG	98.9%	1.253 MG	0.929 MG	0.685 MG
Combined	45.214 MG	43.835 MG	97.0%	1.999 MG	1.461 MG	1.111 MG
Past 12 Months		Total Production - 488.438 MG				
	Raw Water	Production	Efficiency	Highest Day	Average Day	Lowest Day
Water Plant 1	161.856 MG	139.611 MG	86.3%	1.211 MG	0.381 MG	0.133 MG
Water Plant 2	0.000 MG	0.000 MG	∞%	--- MG	0.000 MG	--- MG
Water Plant 3	353.181 MG	348.826 MG	98.8%	1.727 MG	0.953 MG	0.578 MG
Combined	515.037 MG	488.438 MG	94.8%	2.705 MG	1.335 MG	0.797 MG

Waste Water Treatment

This Month			Total Treated - 19.447 MG	
	Treated	Highest Day	Average Day	Lowest Day
Waste Water Treatment Plant	19.447 MG	0.740 MG	0.648 MG	0.560 MG
Past 12 Months			Total Treated - 212.155 MG	
	Treated	Highest Day	Average Day	Lowest Day
Waste Water Treatment Plant	212.155 MG	0.870 MG	0.580 MG	0.410 MG


Effluent Disposal

This Month		WWTP Plant Permit Total - 19.447 MG		
	Total	Highest Day	Average Day	Lowest Day
Lago Vista Golf Course Permit	5.109 MG	2.892 MG	0.170 MG	0.000 MG
Cedar Breaks Permit	0.000 MG	0.000 MG	0.000 MG	0.000 MG
WWTP Plant Permit Total	19.447 MG	0.740 MG	0.648 MG	0.560 MG
Reclaimed Effluent 210A Permit	0.000 MG	0.000 MG	0.000 MG	0.000 MG
Past 12 Months		WWTP Plant Permit Total - 212.146 MG		
	Total	Highest Day	Average Day	Lowest Day
Lago Vista Golf Course Permit	59.693 MG	2.892 MG	0.163 MG	0.000 MG
Cedar Breaks Permit	47.027 MG	30.378 MG	0.128 MG	-30.378 MG
WWTP Plant Permit Total	212.146 MG	0.870 MG	0.580 MG	0.410 MG
Reclaimed Effluent 210A Permit	0.000 MG	0.000 MG	0.000 MG	0.000 MG

June 2024

Combined Water Production

This Month

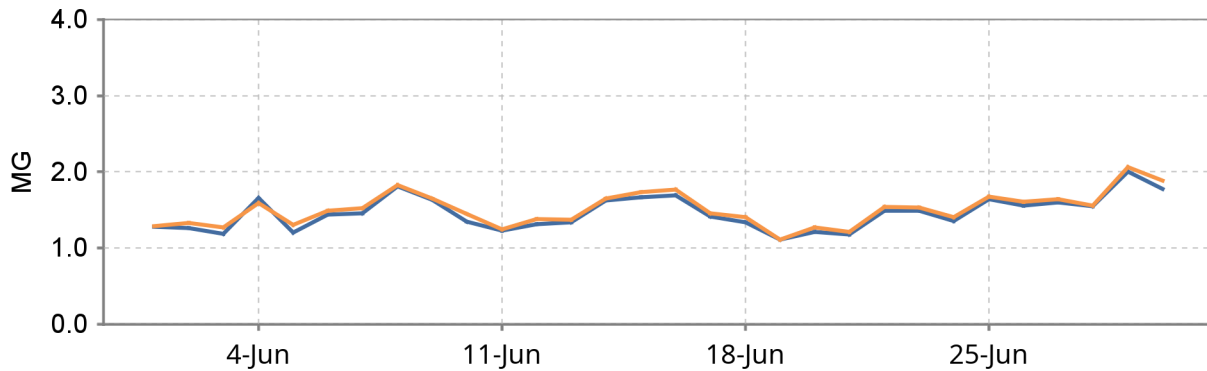


Date	WP1 Raw	WP2 Raw	WP3 Raw	Combined Raw	WP1 Finished	WP2 Finished	WP3 Finished	Combined Finished
06/01/24	0.455	---	0.834	1.289	0.425	---	0.854	1.279
06/02/24	0.478	---	0.853	1.331	0.425	---	0.839	1.264
06/03/24	0.514	---	0.756	1.270	0.462	---	0.722	1.185
06/04/24	0.686	---	0.904	1.591	0.682	---	0.976	1.658
06/05/24	0.456	---	0.848	1.304	0.426	---	0.776	1.201
06/06/24	0.575	---	0.917	1.493	0.541	---	0.900	1.441
06/07/24	0.498	---	1.022	1.520	0.448	---	1.004	1.453
06/08/24	0.750	---	1.076	1.825	0.721	---	1.090	1.810
06/09/24	0.566	---	1.083	1.649	0.554	---	1.080	1.634
06/10/24	0.589	---	0.854	1.443	0.533	---	0.810	1.343
06/11/24	0.527	---	0.720	1.246	0.485	---	0.742	1.228
06/12/24	0.523	---	0.856	1.379	0.480	---	0.832	1.312
06/13/24	0.551	---	0.824	1.375	0.538	---	0.800	1.338
06/14/24	0.573	---	1.080	1.653	0.552	---	1.074	1.626
06/15/24	0.618	---	1.111	1.729	0.584	---	1.086	1.670
06/16/24	0.696	---	1.073	1.770	0.635	---	1.053	1.688
06/17/24	0.594	---	0.864	1.458	0.563	---	0.853	1.416
06/18/24	0.491	---	0.914	1.405	0.468	---	0.872	1.341
06/19/24	0.451	---	0.657	1.108	0.426	---	0.685	1.111
06/20/24	0.410	---	0.859	1.269	0.378	---	0.831	1.209
06/21/24	0.411	---	0.798	1.209	0.362	---	0.818	1.181
06/22/24	0.593	---	0.947	1.540	0.553	---	0.937	1.490
06/23/24	0.562	---	0.965	1.527	0.542	---	0.946	1.487
06/24/24	0.533	---	0.872	1.405	0.526	---	0.832	1.357
06/25/24	0.593	---	1.079	1.673	0.540	---	1.101	1.642
06/26/24	0.618	---	0.986	1.604	0.567	---	0.987	1.554
06/27/24	0.578	---	1.064	1.643	0.547	---	1.049	1.596
06/28/24	0.581	---	0.976	1.557	0.571	---	0.974	1.545
06/29/24	0.806	---	1.256	2.062	0.746	---	1.253	1.999
06/30/24	0.744	---	1.145	1.889	0.683	---	1.096	1.778
Total (MG)	17.020	0.000	28.194	45.214	15.963	0.000	27.872	43.835
Highest	0.806	---	1.256	2.062	0.746	---	1.253	1.999
Average	0.567	0.000	0.940	1.507	0.532	0.000	0.929	1.461
Lowest	0.410	---	0.657	1.108	0.362	---	0.685	1.111

June 2024

Water Plant 1 Water Production

This Month

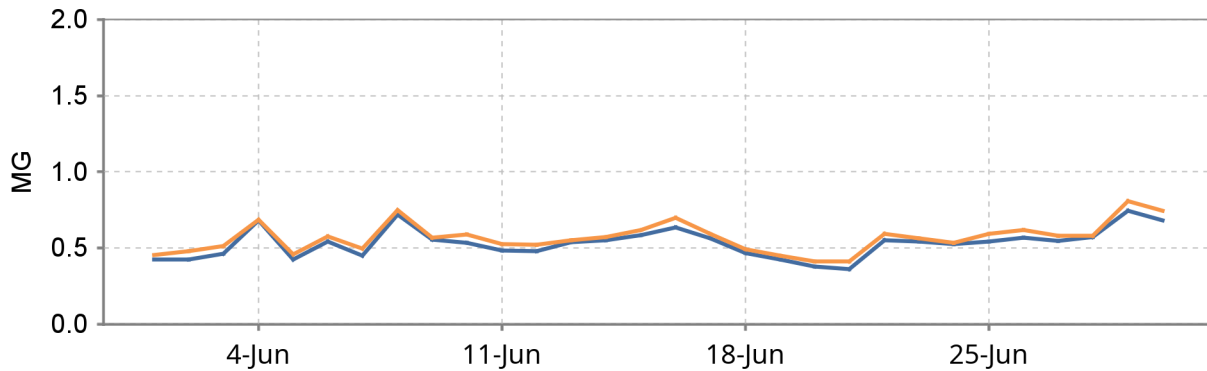


Date	WP1 Raw	WP1 Clarifier A	WP1 Clarifier B	WP1 Finished	WP1 Process Loss	WP1 Efficiency
06/01/24	0.455	0.275	0.183	0.425	0.030	93%
06/02/24	0.478	0.297	0.184	0.425	0.053	89%
06/03/24	0.514	0.317	0.194	0.462	0.051	90%
06/04/24	0.686	0.428	0.265	0.682	0.004	99%
06/05/24	0.456	0.276	0.184	0.426	0.030	93%
06/06/24	0.575	0.347	0.225	0.541	0.035	94%
06/07/24	0.498	0.296	0.194	0.448	0.049	90%
06/08/24	0.750	0.459	0.296	0.721	0.029	96%
06/09/24	0.566	0.347	0.214	0.554	0.011	98%
06/10/24	0.589	0.358	0.234	0.533	0.057	90%
06/11/24	0.527	0.316	0.204	0.485	0.042	92%
06/12/24	0.523	0.318	0.214	0.480	0.043	92%
06/13/24	0.551	0.337	0.214	0.538	0.013	98%
06/14/24	0.573	0.337	0.234	0.552	0.021	96%
06/15/24	0.618	0.376	0.247	0.584	0.034	95%
06/16/24	0.696	0.418	0.275	0.635	0.061	91%
06/17/24	0.594	0.357	0.234	0.563	0.031	95%
06/18/24	0.491	0.296	0.194	0.468	0.023	95%
06/19/24	0.451	0.265	0.183	0.426	0.025	95%
06/20/24	0.410	0.245	0.174	0.378	0.032	92%
06/21/24	0.411	0.245	0.163	0.362	0.048	88%
06/22/24	0.593	0.358	0.235	0.553	0.040	93%
06/23/24	0.562	0.338	0.224	0.542	0.021	96%
06/24/24	0.533	0.316	0.214	0.526	0.007	99%
06/25/24	0.593	0.358	0.234	0.540	0.053	91%
06/26/24	0.618	0.378	0.234	0.567	0.051	92%
06/27/24	0.578	0.347	0.234	0.547	0.031	95%
06/28/24	0.581	0.348	0.245	0.571	0.010	98%
06/29/24	0.806	0.480	0.325	0.746	0.060	93%
06/30/24	0.744	0.438	0.305	0.683	0.061	92%
Total (MG)	17.020	10.271	6.757	15.963	1.057	-
Highest	0.806	0.480	0.325	0.746	-	-
Average	0.567	0.342	0.225	0.532	-	94%
Lowest	0.410	0.245	0.163	0.362	-	-

June 2024

Water Plant 3 Water Production

This Month

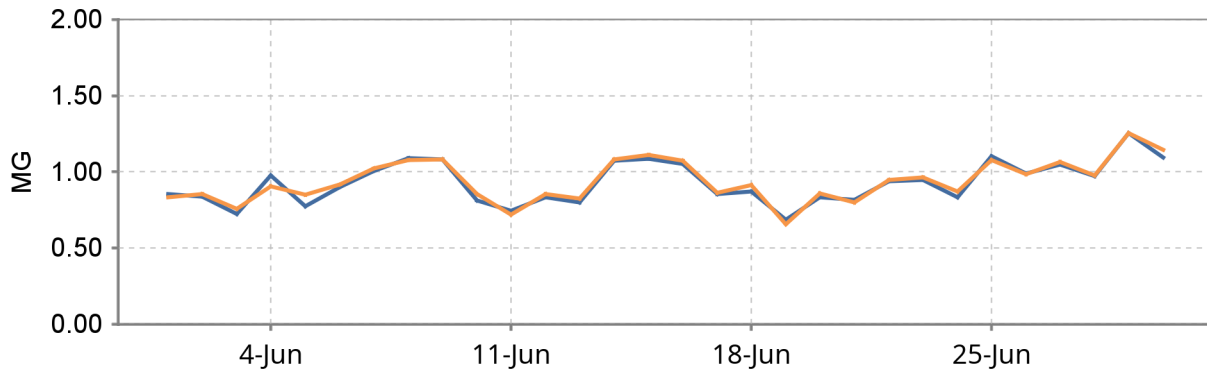


Date	WP3 Raw	WP3 Unit 1	WP3 Decant	WP3 Backwash	WP3 Finished	WP3 Process Loss	WP3 Efficiency
06/01/24	0.834	0.908	0.000	0.050	0.854	-0.020	102%
06/02/24	0.853	0.842	0.000	0.005	0.839	0.015	98%
06/03/24	0.756	0.750	0.000	0.000	0.722	0.034	96%
06/04/24	0.904	0.920	0.000	0.055	0.976	-0.072	108%
06/05/24	0.848	0.915	0.000	0.000	0.776	0.072	91%
06/06/24	0.917	0.907	0.000	0.000	0.900	0.017	98%
06/07/24	1.022	1.033	0.000	0.000	1.004	0.018	98%
06/08/24	1.076	1.120	0.000	0.047	1.090	-0.014	101%
06/09/24	1.083	1.103	0.000	0.008	1.080	0.003	100%
06/10/24	0.854	0.850	0.000	0.000	0.810	0.044	95%
06/11/24	0.720	0.771	0.000	0.049	0.742	-0.023	103%
06/12/24	0.856	0.872	0.000	0.006	0.832	0.023	97%
06/13/24	0.824	0.797	0.000	0.000	0.800	0.024	97%
06/14/24	1.080	1.069	0.000	0.000	1.074	0.006	99%
06/15/24	1.111	1.167	0.000	0.055	1.086	0.026	98%
06/16/24	1.073	1.088	0.000	0.000	1.053	0.020	98%
06/17/24	0.864	0.848	0.000	0.000	0.853	0.011	99%
06/18/24	0.914	0.990	0.000	0.048	0.872	0.041	95%
06/19/24	0.657	0.667	0.000	0.007	0.685	-0.027	104%
06/20/24	0.859	0.850	0.000	0.000	0.831	0.028	97%
06/21/24	0.798	0.800	0.000	0.000	0.818	-0.020	102%
06/22/24	0.947	0.992	0.000	0.049	0.937	0.010	99%
06/23/24	0.965	0.983	0.000	0.006	0.946	0.019	98%
06/24/24	0.872	0.868	0.000	0.000	0.832	0.040	95%
06/25/24	1.079	1.080	0.000	0.000	1.101	-0.022	102%
06/26/24	0.986	1.045	0.000	0.048	0.987	-0.001	100%
06/27/24	1.064	1.075	0.000	0.007	1.049	0.016	99%
06/28/24	0.976	0.971	0.000	0.000	0.974	0.002	100%
06/29/24	1.256	1.320	0.000	0.052	1.253	0.003	100%
06/30/24	1.145	1.140	0.000	0.003	1.096	0.049	96%
Total (MG)	28.194	28.739	0.000	0.495	27.872	0.322	-
Highest	1.256	1.320	0.000	0.055	1.253	-	-
Average	0.940	0.958	0.000	0.016	0.929	-	99%
Lowest	0.657	0.667	0.000	0.000	0.685	-	-

June 2024

Waste Water Treatment

This Month

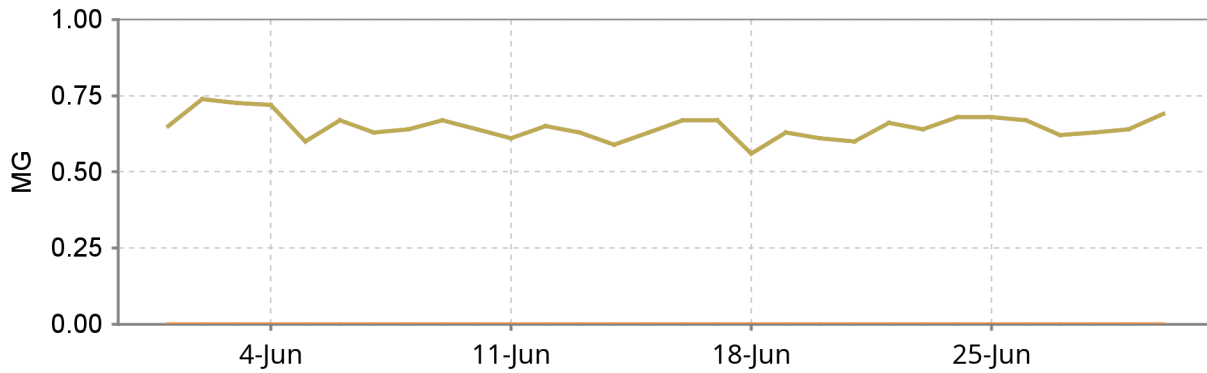


Date	WWTP Treated	LVGC Permit	Cedar Breaks Permit	WWTP Permit	Reclaimed Effluent 210A Permit
06/01/24	0.650	0.000	0.000	0.650	0.000
06/02/24	0.740	0.000	0.000	0.740	0.000
06/03/24	0.727	0.000	0.000	0.727	0.000
06/04/24	0.720	0.000	0.000	0.720	0.000
06/05/24	0.600	0.000	0.000	0.600	0.000
06/06/24	0.670	0.000	0.000	0.670	0.000
06/07/24	0.630	0.000	0.000	0.630	0.000
06/08/24	0.640	0.000	0.000	0.640	0.000
06/09/24	0.670	0.000	0.000	0.670	0.000
06/10/24	0.640	0.000	0.000	0.640	0.000
06/11/24	0.610	0.000	0.000	0.610	0.000
06/12/24	0.650	0.000	0.000	0.650	0.000
06/13/24	0.630	0.000	0.000	0.630	0.000
06/14/24	0.590	0.000	0.000	0.590	0.000
06/15/24	0.630	0.000	0.000	0.630	0.000
06/16/24	0.670	0.000	0.000	0.670	0.000
06/17/24	0.670	2.892	0.000	0.670	0.000
06/18/24	0.560	0.000	0.000	0.560	0.000
06/19/24	0.630	0.296	0.000	0.630	0.000
06/20/24	0.610	0.123	0.000	0.610	0.000
06/21/24	0.600	0.213	0.000	0.600	0.000
06/22/24	0.660	0.123	0.000	0.660	0.000
06/23/24	0.640	0.193	0.000	0.640	0.000
06/24/24	0.680	0.204	0.000	0.680	0.000
06/25/24	0.680	0.142	0.000	0.680	0.000
06/26/24	0.670	0.154	0.000	0.670	0.000
06/27/24	0.620	0.153	0.000	0.620	0.000
06/28/24	0.630	0.225	0.000	0.630	0.000
06/29/24	0.640	0.176	0.000	0.640	0.000
06/30/24	0.690	0.214	0.000	0.690	0.000
Total (MG)	19.447	5.109	0.000	19.447	0.000
Highest	0.740	2.892	0.000	0.740	0.000
Average	0.648	0.170	0.000	0.648	0.000
Lowest	0.560	0.000	0.000	0.560	0.000

June 2024

Effluent Disposal


This Month

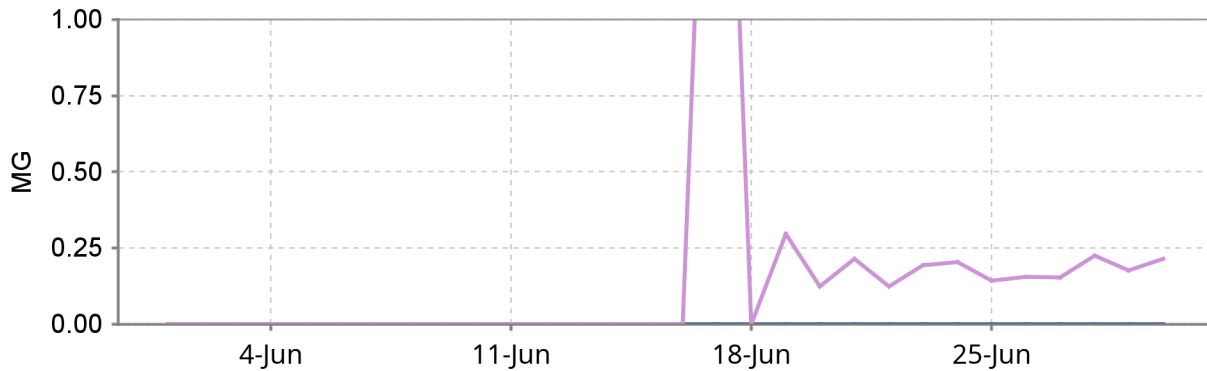

Date	LVGC Usage	LVGC Permit	Cedar Brks. Usage	Cedar Brks. Permit	HLGC Usage	Reclaimed E 210A Permit	LVGC Lake Water	HLGC Lake Water
06/01/24	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
06/02/24	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
06/03/24	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
06/04/24	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
06/05/24	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
06/06/24	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
06/07/24	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
06/08/24	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
06/09/24	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
06/10/24	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
06/11/24	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
06/12/24	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
06/13/24	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
06/14/24	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
06/15/24	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
06/16/24	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
06/17/24	2.892	2.892	0.000	0.000	0.000	0.000	0.000	---
06/18/24	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
06/19/24	0.296	0.296	0.000	0.000	0.000	0.000	0.000	---
06/20/24	0.123	0.123	0.000	0.000	0.000	0.000	0.000	---
06/21/24	0.213	0.213	0.000	0.000	0.000	0.000	0.000	---
06/22/24	0.123	0.123	0.000	0.000	0.000	0.000	0.000	---
06/23/24	0.193	0.193	0.000	0.000	0.000	0.000	0.000	---
06/24/24	0.204	0.204	0.000	0.000	0.000	0.000	0.000	---
06/25/24	0.142	0.142	0.000	0.000	0.000	0.000	0.000	---
06/26/24	0.154	0.154	0.000	0.000	0.000	0.000	0.000	---
06/27/24	0.153	0.153	0.000	0.000	0.000	0.000	0.000	---
06/28/24	0.225	0.225	0.000	0.000	0.000	0.000	0.000	---
06/29/24	0.176	0.176	0.000	0.000	0.000	0.000	0.000	---
06/30/24	0.214	0.214	0.000	0.000	0.000	0.000	0.000	---
Total (MG)	5.109	5.109	0.000	0.000	0.000	0.000	0.000	0.000
Highest	2.892	2.892	0.000	0.000	0.000	0.000	0.000	---
Average	0.170	0.170	0.000	0.000	0.000	0.000	0.000	0.000
Lowest	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---

Combined Water Production

Past 12 Months

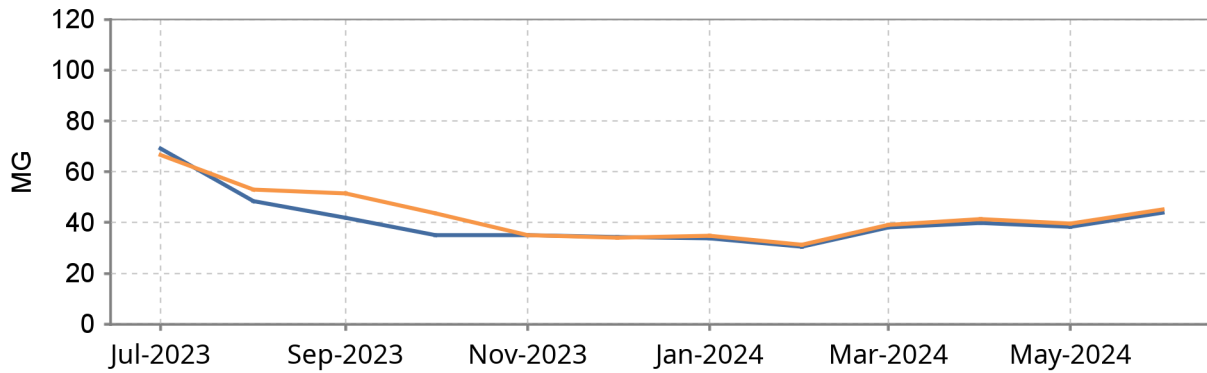


Date	WP1 Raw	WP2 Raw	WP3 Raw	Combined Raw	WP1 Finished	WP2 Finished	WP3 Finished	Combined Finished
Jul, 2023	19.101	---	47.580	66.681	22.066	---	47.156	69.222
Aug, 2023	14.433	---	38.490	52.923	10.431	---	38.028	48.459
Sep, 2023	19.005	---	32.402	51.406	9.927	---	32.059	41.986
Oct, 2023	16.560	---	27.064	43.624	8.364	---	26.753	35.117
Nov, 2023	13.214	---	21.813	35.028	13.461	---	21.505	34.965
Dec, 2023	12.536	---	21.446	33.981	13.026	---	21.281	34.307
Jan, 2024	11.078	---	23.843	34.920	10.521	---	23.336	33.857
Feb, 2024	6.493	---	24.883	31.376	5.973	---	24.546	30.519
Mar, 2024	9.271	---	29.837	39.108	8.548	---	29.469	38.017
Apr, 2024	11.258	---	30.009	41.267	10.391	---	29.535	39.926
May, 2024	11.888	---	27.620	39.509	10.941	---	27.285	38.226
Jun, 2024	17.020	---	28.194	45.214	15.963	---	27.872	43.835
Total (MG)	161.856	0.000	353.181	515.037	139.611	0.000	348.826	488.438
Highest	19.101	---	47.580	66.681	22.066	---	47.156	69.222
Average	13.488	0.000	29.432	42.920	11.634	0.000	29.069	40.703
Lowest	6.493	---	21.446	31.376	5.973	---	21.281	30.519


June 2024

Water Plant 1 Water Production

Past 12 Months

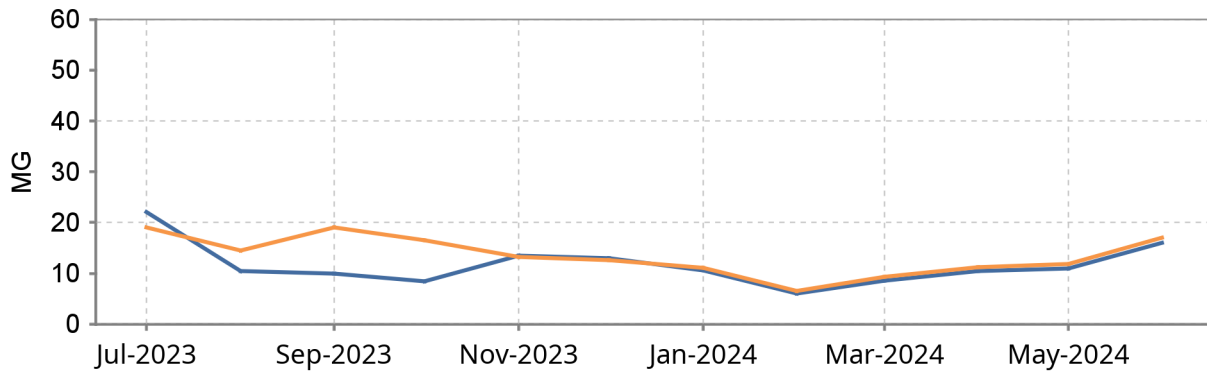


Date	WP1 Raw	WP1 Clarifier A	WP1 Clarifier B	WP1 Finished	WP1 Process Loss	WP1 Efficiency
Jul, 2023	19.101	7.041	12.046	22.066	-2.965	116%
Aug, 2023	14.433	12.180	2.261	10.431	4.002	72%
Sep, 2023	19.005	11.987	7.012	9.927	9.078	52%
Oct, 2023	16.560	10.276	6.279	8.364	8.196	51%
Nov, 2023	13.214	8.216	4.996	13.461	-0.246	102%
Dec, 2023	12.536	7.773	4.763	13.026	-0.490	104%
Jan, 2024	11.078	6.779	4.289	10.521	0.557	95%
Feb, 2024	6.493	4.027	2.476	5.973	0.519	92%
Mar, 2024	9.271	5.707	3.560	8.548	0.723	92%
Apr, 2024	11.258	6.728	4.536	10.391	0.867	92%
May, 2024	11.888	7.086	4.774	10.941	0.947	92%
Jun, 2024	17.020	10.271	6.757	15.963	1.057	94%
Total (MG)	161.856	98.072	63.751	139.611	22.245	-
Highest	19.101	12.180	12.046	22.066	-	-
Average	13.488	8.173	5.313	11.634	-	86%
Lowest	6.493	4.027	2.261	5.973	-	-

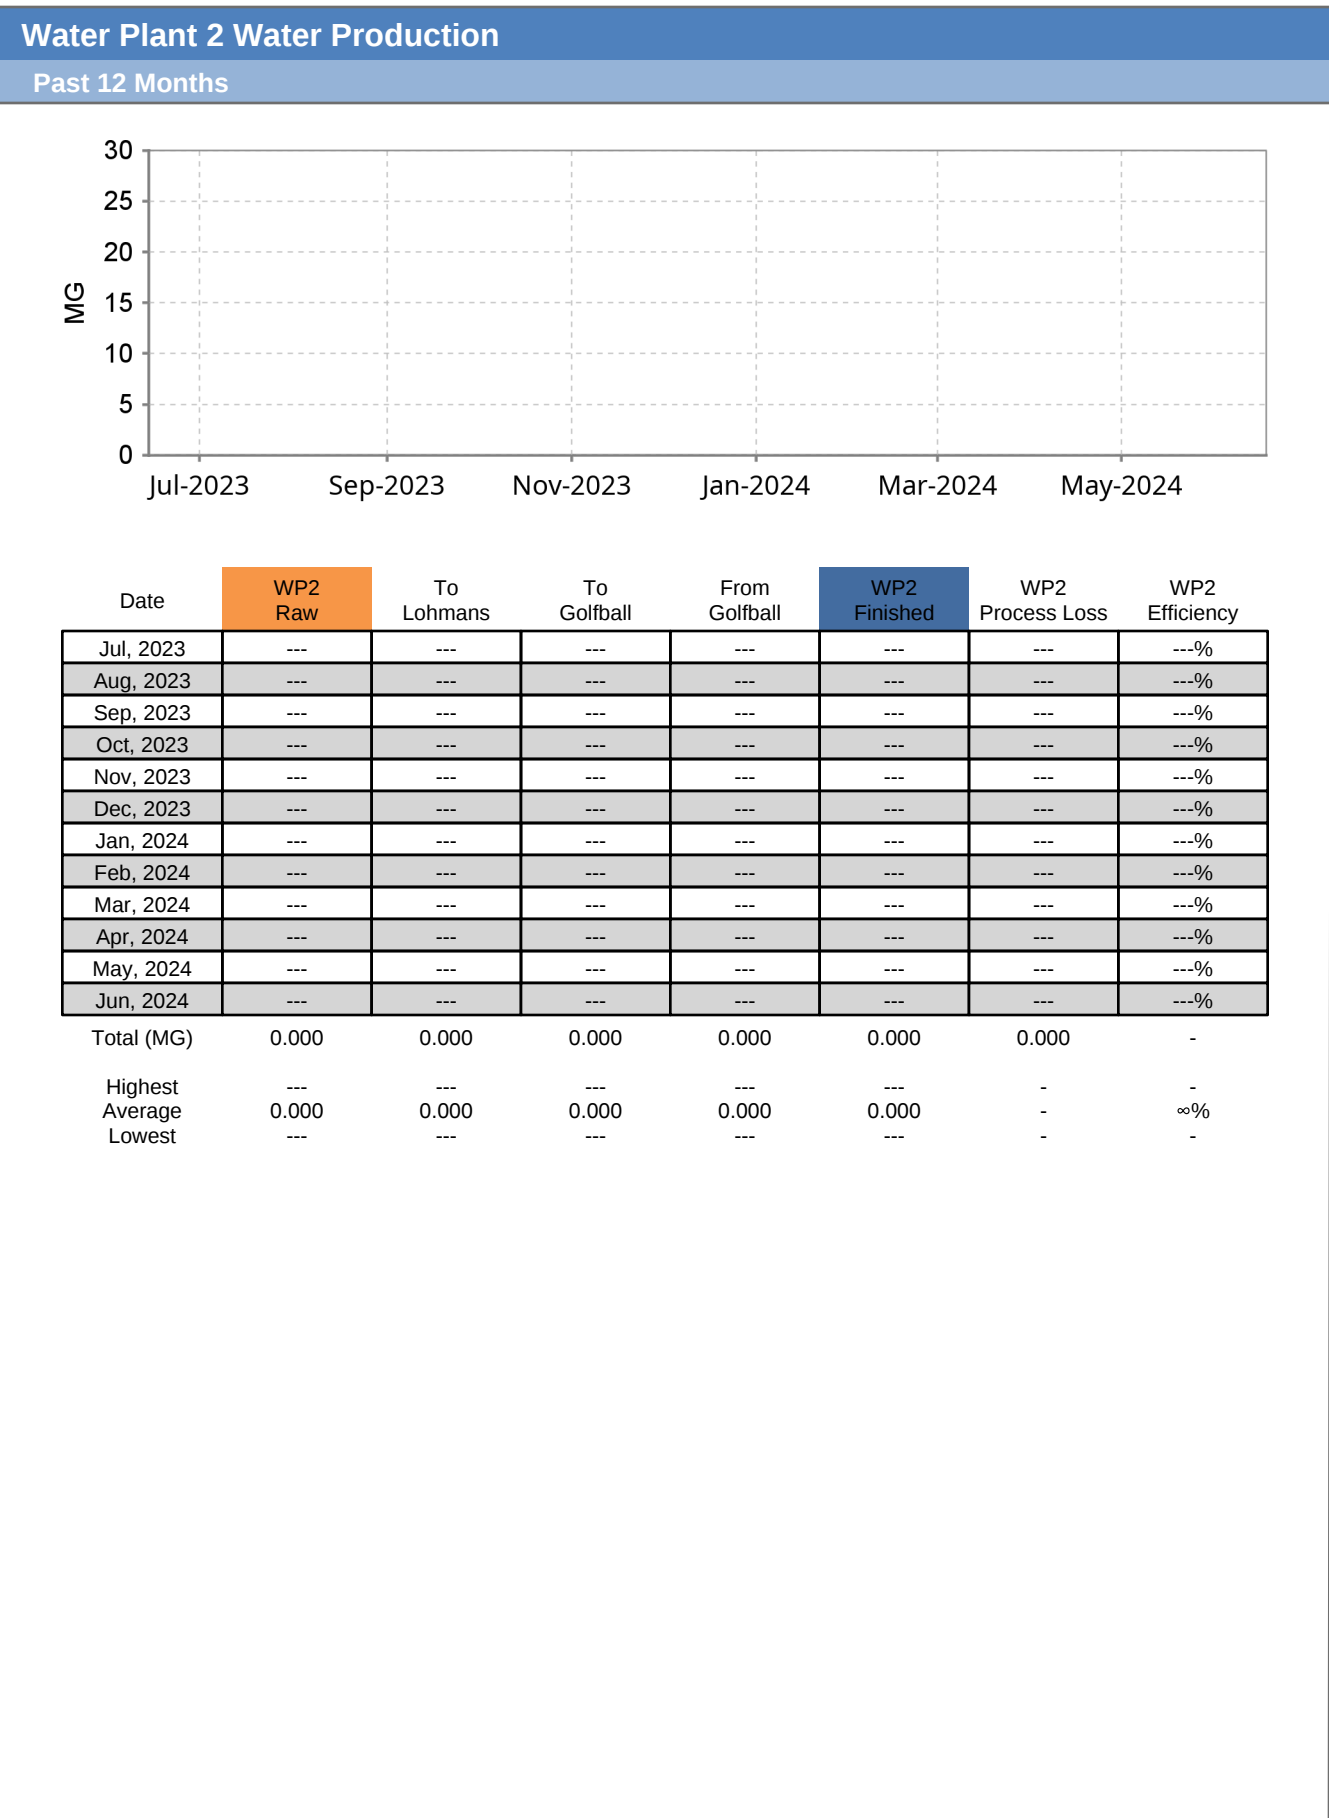

June 2024

Water Plant 3 Water Production

Past 12 Months

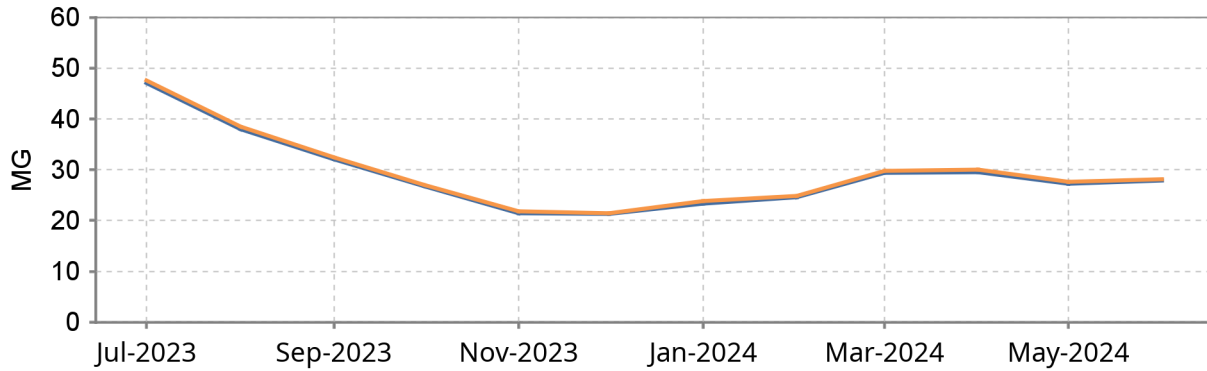


Date	WP3 Raw	WP3 Unit 1	WP3 Decant	WP3 Backwash	WP3 Finished	WP3 Process Loss	WP3 Efficiency
Jul, 2023	47.580	48.430	0.000	0.689	47.156	0.424	99%
Aug, 2023	38.490	39.052	0.000	0.554	38.028	0.461	99%
Sep, 2023	32.402	33.068	0.000	0.536	32.059	0.342	99%
Oct, 2023	27.064	27.791	0.000	0.442	26.753	0.312	99%
Nov, 2023	21.813	22.364	0.000	0.381	21.505	0.309	99%
Dec, 2023	21.446	21.996	0.000	0.382	21.281	0.164	99%
Jan, 2024	23.843	24.246	0.000	0.380	23.336	0.507	98%
Feb, 2024	24.883	25.527	0.000	0.440	24.546	0.337	99%
Mar, 2024	29.837	30.560	0.000	0.495	29.469	0.368	99%
Apr, 2024	30.009	30.600	0.000	0.494	29.535	0.474	98%
May, 2024	27.620	28.178	0.000	0.440	27.285	0.335	99%
Jun, 2024	28.194	28.739	0.000	0.495	27.872	0.322	99%
Total (MG)	353.181	360.552	0.000	5.729	348.826	4.355	-
Highest	47.580	48.430	0.000	0.689	47.156	-	-
Average	29.432	30.046	0.000	0.477	29.069	-	99%
Lowest	21.446	21.996	0.000	0.380	21.281	-	-

June 2024

Waste Water Treatment


Past 12 Months

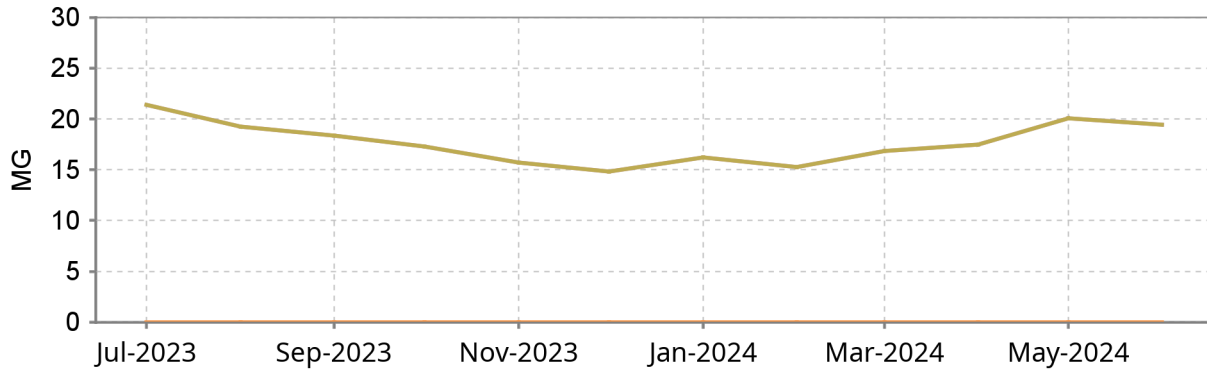

Date	WWTP Treated	LVGC Permit	Cedar Breaks Permit	WWTP Permit	Reclaimed Effluent 210A Permit
Jul, 2023	21.390	9.879	0.000	21.381	0.000
Aug, 2023	19.229	9.389	0.000	19.229	0.000
Sep, 2023	18.360	7.649	0.000	18.360	0.000
Oct, 2023	17.270	6.956	0.000	17.270	0.000
Nov, 2023	15.690	5.511	30.378	15.690	0.000
Dec, 2023	14.823	5.239	-30.378	14.823	0.000
Jan, 2024	16.217	2.082	30.378	16.217	0.000
Feb, 2024	15.299	0.000	0.000	15.299	0.000
Mar, 2024	16.836	0.000	0.000	16.836	0.000
Apr, 2024	17.490	3.467	12.976	17.490	0.000
May, 2024	20.104	4.413	3.674	20.104	0.000
Jun, 2024	19.447	5.109	0.000	19.447	0.000
Total (MG)	212.155	59.693	47.027	212.146	0.000
Highest	21.390	9.879	30.378	21.381	0.000
Average	17.680	4.974	3.919	17.679	0.000
Lowest	14.823	0.000	-30.378	14.823	0.000

Effluent Disposal


Past 12 Months

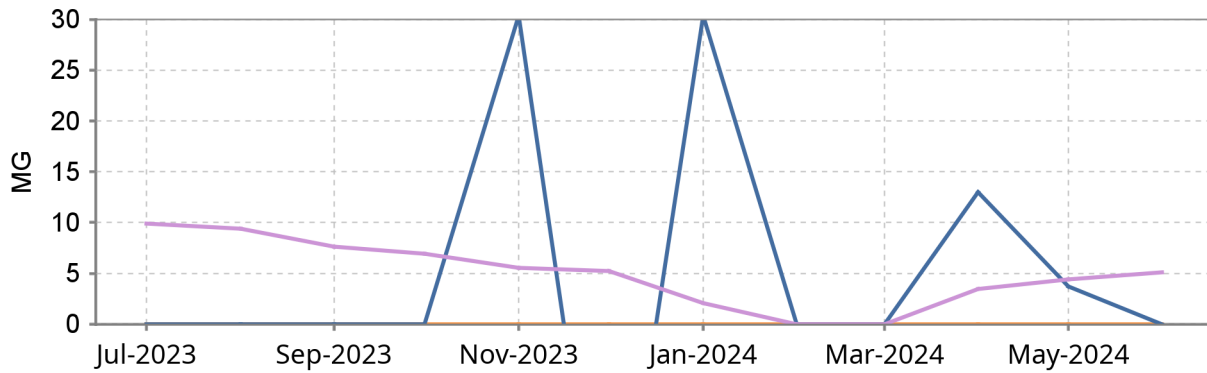

Date	LVGC Usage	LVGC Permit	Cedar Brks. Usage	Cedar Brks. Permit	HLGC Usage	Reclaimed E 210A Permit	LVGC Lake Water	HLGC Lake Water
Jul, 2023	9.878	9.879	0.000	0.000	0.000	0.000	0.000	---
Aug, 2023	9.389	9.389	0.000	0.000	0.000	0.000	0.000	---
Sep, 2023	7.649	7.649	0.000	0.000	0.000	0.000	0.000	---
Oct, 2023	6.956	6.956	0.000	0.000	0.000	0.000	0.000	---
Nov, 2023	5.511	5.511	30.378	30.378	0.000	0.000	0.000	---
Dec, 2023	5.239	5.239	-30.378	-30.378	0.000	0.000	0.000	---
Jan, 2024	2.082	2.082	30.378	30.378	0.000	0.000	0.000	---
Feb, 2024	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
Mar, 2024	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
Apr, 2024	3.467	3.467	12.981	12.976	0.000	0.000	0.000	---
May, 2024	4.413	4.413	3.674	3.674	0.000	0.000	0.000	---
Jun, 2024	5.109	5.109	0.000	0.000	0.000	0.000	0.000	---
Total (MG)	59.693	59.693	47.033	47.027	0.000	0.000	0.000	0.000
Highest	9.878	9.879	30.378	30.378	0.000	0.000	0.000	---
Average	4.974	4.974	3.919	3.919	0.000	0.000	0.000	0.000
Lowest	0.000	0.000	-30.378	-30.378	0.000	0.000	0.000	---

Combined Water Production


5 Year Average Daily Production

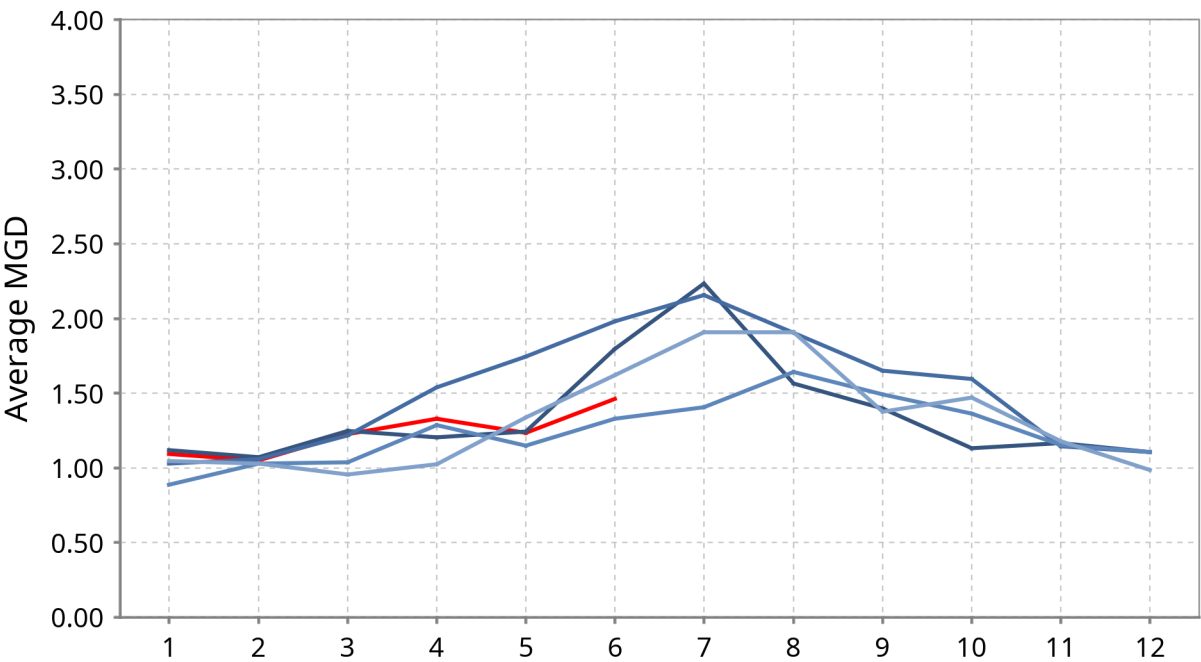

Month	Year - 4	Year - 3	Year - 2	Last Year	This Year
Jan	1.047	0.888	1.027	1.118	1.092
Feb	1.031	1.030	1.059	1.073	1.052
Mar	0.957	1.039	1.217	1.246	1.226
Apr	1.023	1.285	1.541	1.205	1.331
May	1.339	1.149	1.744	1.243	1.233
Jun	1.621	1.330	1.982	1.796	1.461
Jul	1.906	1.407	2.158	2.233	---
Aug	1.909	1.642	1.905	1.563	---
Sep	1.376	1.492	1.652	1.400	---
Oct	1.469	1.365	1.594	1.133	---
Nov	1.178	1.153	1.144	1.166	---
Dec	0.985	1.105	1.108	1.107	---
Highest	1.909	1.642	2.158	2.233	1.461
Average	1.320	1.240	1.511	1.357	1.233
Lowest	0.957	0.888	1.027	1.073	1.052

Waste Water Treatment

5 Year Average Daily Treated

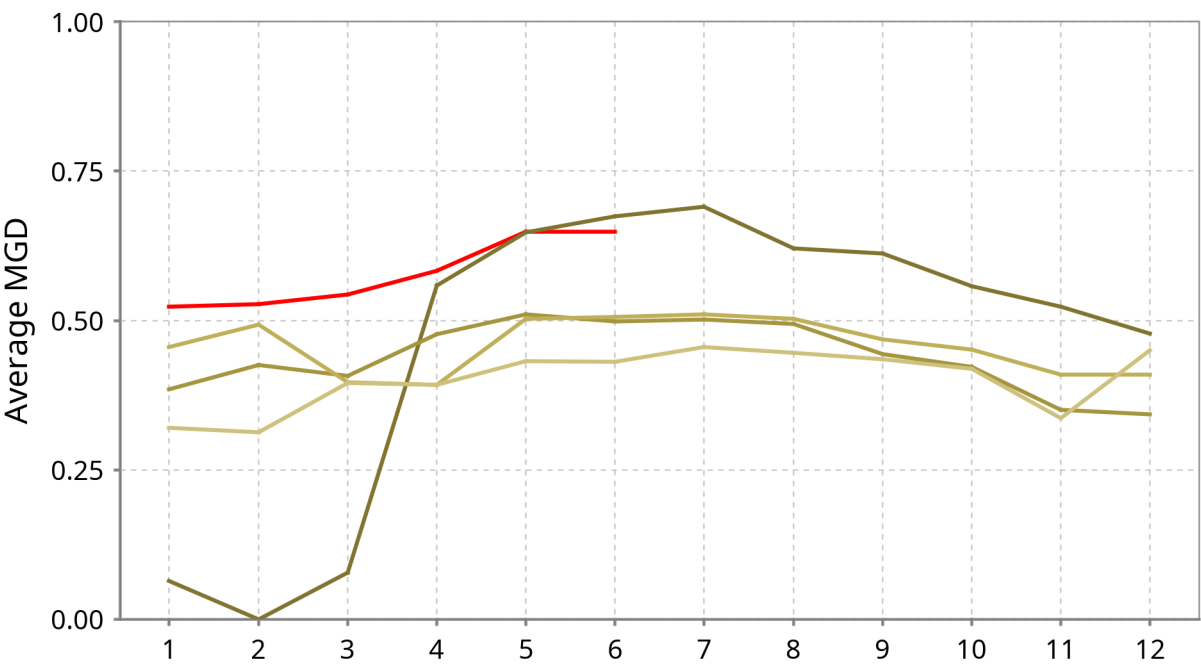

Month	Year - 4	Year - 3	Year - 2	Last Year	This Year
Jan	0.320	0.456	0.385	0.064	0.523
Feb	0.313	0.493	0.425	0.000	0.528
Mar	0.396	0.396	0.407	0.078	0.543
Apr	0.392	0.392	0.477	0.559	0.583
May	0.431	0.503	0.511	0.648	0.649
Jun	0.431	0.506	0.499	0.675	0.648
Jul	0.455	0.510	0.502	0.690	---
Aug	0.446	0.503	0.494	0.620	---
Sep	0.435	0.469	0.443	0.612	---
Oct	0.419	0.451	0.422	0.557	---
Nov	0.337	0.409	0.351	0.523	---
Dec	0.450	0.410	0.343	0.478	---
Highest	0.455	0.510	0.511	0.690	0.649
Average	0.402	0.458	0.438	0.459	0.579
Lowest	0.313	0.392	0.343	0.000	0.523



Fleet Events By Date Range

Lago Vista

Date Range:

6/1/2024 - 6/30/2024

Date: 6/18/2024

Status: Complete

Assigned To: Joel Peer

Event ID: 7019

Event Type: Maintenance

Work Order ID:

Feature ID: Chevy 2500 Pickup

Feature Class: Fleet Unit

Fee:

Note: oil and fliter change. fluids topped off, cabin air fliter replaced.

Date: 6/26/2024

Status: Complete

Assigned To: Joel Peer

Event ID: 8201

Event Type: Maintenance

Work Order ID:

Feature ID: Chevy Silverado Pickup

Feature Class: Fleet Unit

Fee:

Note: oil and filter changed needs front tires and alignment

Date: 6/18/2024

Status: Complete

Assigned To: Joel Peer

Event ID: 6016

Event Type: Other

Work Order ID:

Feature ID: 2022 Chevy Sliverado
5500 series

Feature Class: Fleet Unit

Fee:

Note: inspected 6-18-24

Date: 6/5/2024

Status: Complete

Assigned To: Joel Peer

Event ID: 6019

Event Type: Maintenance

Work Order ID:

Feature ID: Chevy 2500 Pickup

Feature Class: Fleet Unit

Fee:

Note: removed and replace passanger side rear tail light.

Total

4



Work Management Requests

Lago Vista

Date Range: 6/1/2024 - 6/30/2024

Start Date	End Date	Status	Request ID	Type	Sub Type	Assigned To
6/30/2024 12:00 AM	6/30/2024 12:00 AM	On Hold	FH Replacement: Boone Dr	Utilities	FH Issue/Replacement	Steve Castro
6/27/2024 12:00 AM	6/27/2024 12:00 AM	In Progress	(METER SET) 8503 PINE MUHLY DR	Utilities	Other	Jamie Nichols
6/27/2024 12:00 AM	6/27/2024 12:00 AM	Pending	(METER SET) 8600 RED BOTTLE BRUSH RD	Utilities	Other	Jamie Nichols
6/27/2024 12:00 AM	6/27/2024 12:00 AM	In Progress	(METER SET) 8519 PINE MUHLY DR	Utilities	Other	Jamie Nichols
6/27/2024 12:00 AM	6/27/2024 12:00 AM	In Progress	(METER SET) 8606 RED BOTTLE BRUSH RD	Utilities	Other	Jamie Nichols
6/27/2024 12:00 AM	6/27/2024 12:00 AM	Pending	(METER SET) 8504 RED BOTTLE BRUSH RD	Utilities	Other	Jamie Nichols
6/26/2024 12:00 AM	6/26/2024 12:00 AM	In Progress	(WATER LEAK) 3907 CONSTITUTION DR	Utilities	Water Leak	Steve Castro
6/26/2024 12:00 AM	6/26/2024 12:00 AM	Complete	(METER SET) 19905 CONSTITUTION CV	Utilities	Other	Jamie Nichols
6/24/2024 12:00 AM	6/24/2024 12:00 AM	Complete	(METER INSTALL) 4500 SILVERHILL DR	Utilities	Other	Jamie Nichols
6/24/2024 12:00 AM	6/24/2024 12:00 AM	Pending	(SEWER SERVICE INSTALL) 20807 MADISON CV	Utilities	Other	Steve Castro
6/23/2024 12:00 AM	6/23/2024 12:00 AM	Received	FH Replacement: Twisting Trail	Utilities	FH Issue/Replacement	Steve Castro
6/13/2024 12:00 AM	6/13/2024 12:00 AM	Complete	METER SET: 8330 TIMBER TRAIL	Utilities	Other	Jamie Nichols
6/12/2024 12:00 AM	6/12/2024 12:00 AM	Complete	(METER SET) 20110 LEE LN	Utilities	Other	Jamie Nichols
6/12/2024 12:00 AM	6/12/2024 12:00 AM	Complete	(METER SET) 4205 OUTPOST TRACE	Utilities	Other	Jamie Nichols
6/10/2024 12:00 AM	6/10/2024 12:00 AM	On Hold	Replace 8" Valve On Thunderbird St #060102	Utilities	Valve Issue/Exercising	Luis Mendoza

Start Date	End Date	Status	Request ID	Type	Sub Type	Assigned To
6/10/2024 12:00 AM	6/13/2024 12:00 AM	Cancelled	Insert Valve Install: American Dr	Utilities	Valve Issue/Exercising	Luis Mendoza
6/10/2024 12:00 AM	6/13/2024 12:00 AM	Complete	Insert Valve Install: Parliament Cove	Utilities	Valve Issue/Exercising	Luis Mendoza
6/6/2024 12:00 AM	6/6/2024 12:00 AM	Complete	Replace PRV: Mt Laurel Rd	Utilities	Other	Luis Mendoza
6/3/2024 12:00 AM	6/3/2024 12:00 AM	Complete	(SEWER SERVICE INSTALL) 6914 CEDAR RIDGE DR	Utilities	Other	Luis Mendoza
6/3/2024 12:00 AM	6/3/2024 12:00 AM	In Progress	(WATER SERVICE INSTALL) 6914 CEDAR RIDGE DR	Utilities	Other	Luis Mendoza
				Total	20	