

CITY OF LAGO VISTA WATER & WASTEWATER REPORT

January 2025



Water Production

This Month		Total Production - 33.788 MG				
	Raw Water	Production	Efficiency	Highest Day	Average Day	Lowest Day
Water Plant 1	11.775 MG	10.690 MG	90.8%	0.495 MG	0.345 MG	0.193 MG
Water Plant 2	0.000 MG	0.000 MG	∞%	--- MG	0.000 MG	--- MG
Water Plant 3	23.728 MG	23.098 MG	97.3%	0.953 MG	0.745 MG	0.566 MG
Combined	35.503 MG	33.788 MG	95.2%	1.280 MG	1.090 MG	0.937 MG

Past 12 Months		Total Production - 504.752 MG				
	Raw Water	Production	Efficiency	Highest Day	Average Day	Lowest Day
Water Plant 1	186.072 MG	173.535 MG	93.3%	0.845 MG	0.474 MG	0.137 MG
Water Plant 2	0.000 MG	0.000 MG	∞%	--- MG	0.000 MG	--- MG
Water Plant 3	335.316 MG	331.217 MG	98.8%	1.455 MG	0.905 MG	0.566 MG
Combined	521.388 MG	504.752 MG	96.8%	2.200 MG	1.379 MG	0.906 MG

Waste Water Treatment

This Month		Total Treated - 16.439 MG		
	Treated	Highest Day	Average Day	Lowest Day
Waste Water Treatment Plant	16.439 MG	0.729 MG	0.530 MG	0.440 MG
Past 12 Months		Total Treated - 209.575 MG		
	Treated	Highest Day	Average Day	Lowest Day
Waste Water Treatment Plant	209.575 MG	0.820 MG	0.573 MG	0.410 MG


Effluent Disposal

This Month		WWTP Plant Permit Total - 16.440 MG			
	Total	Highest Day	Average Day	Lowest Day	
Lago Vista Golf Course Permit	2.218 MG	0.142 MG	0.072 MG	0.010 MG	
Cedar Breaks Permit	25.795 MG	1.706 MG	0.832 MG	0.000 MG	
WWTP Plant Permit Total	16.440 MG	0.729 MG	0.530 MG	0.440 MG	
Reclaimed Effluent 210A Permit	0.000 MG	0.000 MG	0.000 MG	0.000 MG	
Past 12 Months		WWTP Plant Permit Total - 209.576 MG			
	Total	Highest Day	Average Day	Lowest Day	
Lago Vista Golf Course Permit	44.142 MG	2.892 MG	0.121 MG	0.000 MG	
Cedar Breaks Permit	114.493 MG	1.706 MG	0.313 MG	0.000 MG	
WWTP Plant Permit Total	209.576 MG	0.820 MG	0.573 MG	0.410 MG	
Reclaimed Effluent 210A Permit	0.000 MG	0.000 MG	0.000 MG	0.000 MG	

January 2025

Combined Water Production

This Month

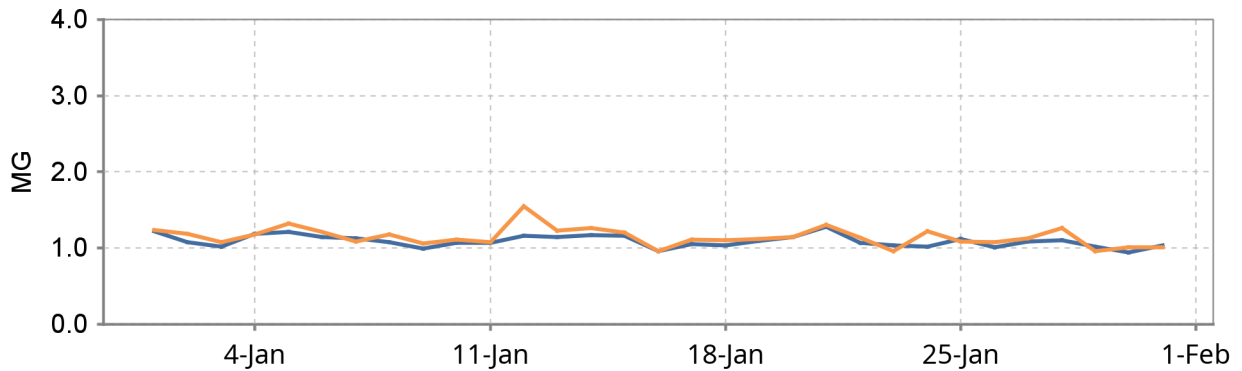


Date	WP1 Raw	WP2 Raw	WP3 Raw	Combined Raw	WP1 Finished	WP2 Finished	WP3 Finished	Combined Finished
01/01/25	0.559	---	0.678	1.237	0.487	---	0.731	1.217
01/02/25	0.458	---	0.724	1.182	0.416	---	0.659	1.075
01/03/25	0.481	---	0.592	1.073	0.428	---	0.591	1.019
01/04/25	0.461	---	0.713	1.174	0.454	---	0.728	1.182
01/05/25	0.584	---	0.736	1.319	0.495	---	0.715	1.210
01/06/25	0.482	---	0.728	1.209	0.426	---	0.714	1.140
01/07/25	0.507	---	0.580	1.087	0.492	---	0.634	1.126
01/08/25	0.479	---	0.699	1.178	0.438	---	0.634	1.072
01/09/25	0.489	---	0.572	1.061	0.424	---	0.566	0.990
01/10/25	0.435	---	0.675	1.111	0.393	---	0.678	1.071
01/11/25	0.487	---	0.590	1.076	0.456	---	0.610	1.066
01/12/25	0.509	---	1.038	1.547	0.486	---	0.670	1.156
01/13/25	0.522	---	0.705	1.227	0.418	---	0.729	1.147
01/14/25	0.224	---	1.039	1.262	0.215	---	0.953	1.168
01/15/25	0.238	---	0.963	1.201	0.226	---	0.931	1.157
01/16/25	0.208	---	0.748	0.956	0.193	---	0.764	0.956
01/17/25	0.342	---	0.772	1.114	0.296	---	0.757	1.053
01/18/25	0.343	---	0.757	1.100	0.317	---	0.720	1.036
01/19/25	0.238	---	0.881	1.120	0.224	---	0.872	1.096
01/20/25	0.385	---	0.756	1.141	0.369	---	0.775	1.144
01/21/25	0.384	---	0.916	1.301	0.328	---	0.952	1.280
01/22/25	0.301	---	0.830	1.131	0.286	---	0.786	1.071
01/23/25	0.270	---	0.684	0.954	0.255	---	0.782	1.038
01/24/25	0.260	---	0.956	1.215	0.214	---	0.806	1.020
01/25/25	0.321	---	0.762	1.083	0.297	---	0.823	1.119
01/26/25	0.311	---	0.767	1.079	0.304	---	0.702	1.005
01/27/25	0.290	---	0.837	1.127	0.266	---	0.821	1.086
01/28/25	0.356	---	0.908	1.264	0.290	---	0.815	1.105
01/29/25	0.322	---	0.636	0.958	0.306	---	0.707	1.013
01/30/25	0.229	---	0.779	1.007	0.225	---	0.712	0.937
01/31/25	0.301	---	0.707	1.008	0.266	---	0.764	1.031
Total (MG)	11.775	0.000	23.728	35.503	10.690	0.000	23.098	33.788
Highest	0.584	---	1.039	1.547	0.495	---	0.953	1.280
Average	0.380	0.000	0.765	1.145	0.345	0.000	0.745	1.090
Lowest	0.208	---	0.572	0.954	0.193	---	0.566	0.937

January 2025

Water Plant 1 Water Production

This Month

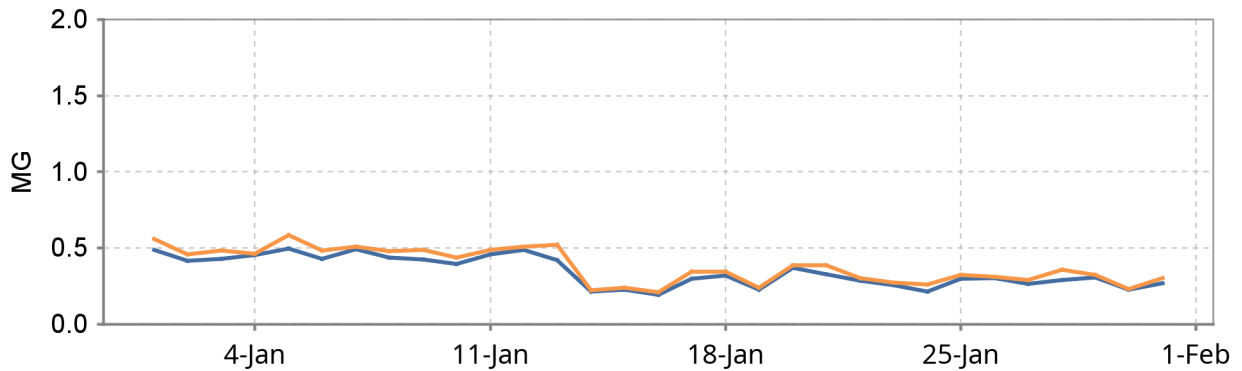


Date	WP1 Raw	WP1 Clarifier A	WP1 Clarifier B	WP1 Finished	WP1 Process Loss	WP1 Efficiency
01/01/25	0.559	0.254	0.288	0.487	0.072	87%
01/02/25	0.458	0.216	0.256	0.416	0.042	91%
01/03/25	0.481	0.233	0.247	0.428	0.053	89%
01/04/25	0.461	0.205	0.257	0.454	0.006	99%
01/05/25	0.584	0.255	0.319	0.495	0.088	85%
01/06/25	0.482	0.215	0.267	0.426	0.055	88%
01/07/25	0.507	0.194	0.321	0.492	0.015	97%
01/08/25	0.479	0.183	0.290	0.438	0.042	91%
01/09/25	0.489	0.194	0.299	0.424	0.065	87%
01/10/25	0.435	0.163	0.270	0.393	0.042	90%
01/11/25	0.487	0.184	0.300	0.456	0.031	94%
01/12/25	0.509	0.204	0.310	0.486	0.023	95%
01/13/25	0.522	0.007	0.510	0.418	0.103	80%
01/14/25	0.224	0.000	0.225	0.215	0.009	96%
01/15/25	0.238	0.000	0.239	0.226	0.013	95%
01/16/25	0.208	0.000	0.208	0.193	0.015	93%
01/17/25	0.342	0.000	0.352	0.296	0.046	87%
01/18/25	0.343	0.000	0.332	0.317	0.026	92%
01/19/25	0.238	0.000	0.249	0.224	0.015	94%
01/20/25	0.385	0.000	0.374	0.369	0.016	96%
01/21/25	0.384	0.000	0.384	0.328	0.056	85%
01/22/25	0.301	0.000	0.301	0.286	0.015	95%
01/23/25	0.270	0.000	0.270	0.255	0.015	94%
01/24/25	0.260	0.000	0.259	0.214	0.045	82%
01/25/25	0.321	0.000	0.331	0.297	0.025	92%
01/26/25	0.311	0.000	0.312	0.304	0.008	98%
01/27/25	0.290	0.000	0.280	0.266	0.025	92%
01/28/25	0.356	0.000	0.360	0.290	0.065	82%
01/29/25	0.322	0.000	0.322	0.306	0.016	95%
01/30/25	0.229	0.000	0.229	0.225	0.004	98%
01/31/25	0.301	0.000	0.301	0.266	0.035	88%
Total (MG)	11.775	2.509	9.264	10.690	1.085	-
Highest	0.584	0.255	0.510	0.495	-	-
Average	0.380	0.081	0.299	0.345	-	91%
Lowest	0.208	0.000	0.208	0.193	-	-

January 2025

Water Plant 2 Water Production

This Month

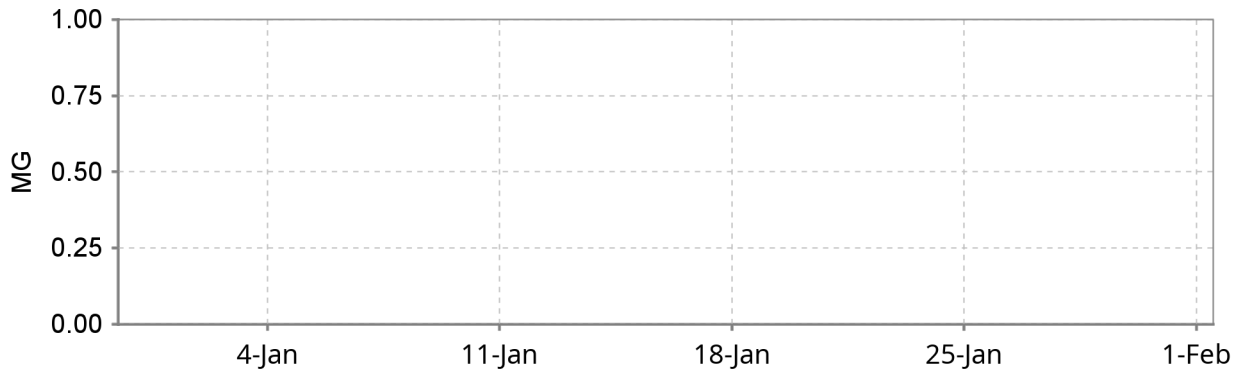


Date	WP2 Raw	To Lohmans	To Golfball	From Golfball	WP2 Finished	WP2 Process Loss	WP2 Efficiency
01/01/25	---	---	---	---	---	---	---%
01/02/25	---	---	---	---	---	---	---%
01/03/25	---	---	---	---	---	---	---%
01/04/25	---	---	---	---	---	---	---%
01/05/25	---	---	---	---	---	---	---%
01/06/25	---	---	---	---	---	---	---%
01/07/25	---	---	---	---	---	---	---%
01/08/25	---	---	---	---	---	---	---%
01/09/25	---	---	---	---	---	---	---%
01/10/25	---	---	---	---	---	---	---%
01/11/25	---	---	---	---	---	---	---%
01/12/25	---	---	---	---	---	---	---%
01/13/25	---	---	---	---	---	---	---%
01/14/25	---	---	---	---	---	---	---%
01/15/25	---	---	---	---	---	---	---%
01/16/25	---	---	---	---	---	---	---%
01/17/25	---	---	---	---	---	---	---%
01/18/25	---	---	---	---	---	---	---%
01/19/25	---	---	---	---	---	---	---%
01/20/25	---	---	---	---	---	---	---%
01/21/25	---	---	---	---	---	---	---%
01/22/25	---	---	---	---	---	---	---%
01/23/25	---	---	---	---	---	---	---%
01/24/25	---	---	---	---	---	---	---%
01/25/25	---	---	---	---	---	---	---%
01/26/25	---	---	---	---	---	---	---%
01/27/25	---	---	---	---	---	---	---%
01/28/25	---	---	---	---	---	---	---%
01/29/25	---	---	---	---	---	---	---%
01/30/25	---	---	---	---	---	---	---%
01/31/25	---	---	---	---	---	---	---%
Total (MG)	0.000	0.000	0.000	0.000	0.000	0.000	-
Highest	---	---	---	---	---	-	-
Average	0.000	0.000	0.000	0.000	0.000	-	∞%
Lowest	---	---	---	---	---	-	-

January 2025

Water Plant 3 Water Production

This Month

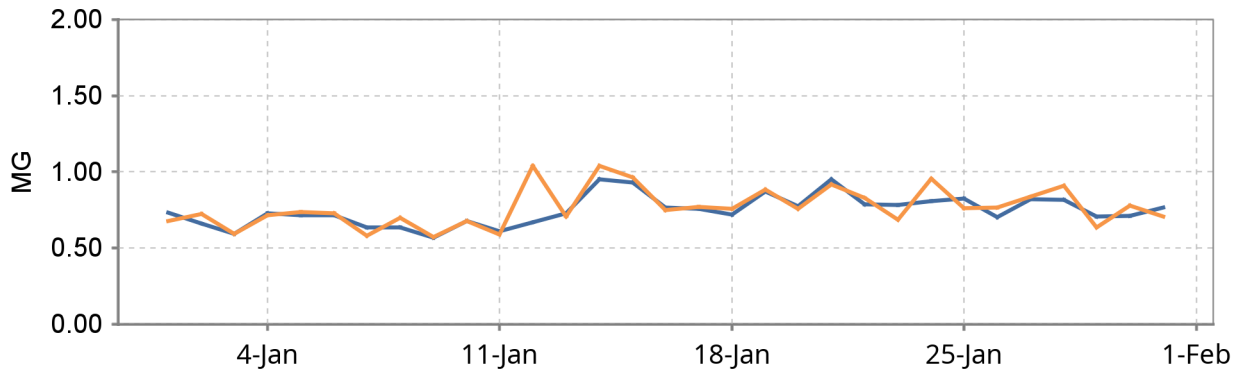


Date	WP3 Raw	WP3 Unit 1	WP3 Decant	WP3 Backwash	WP3 Finished	WP3 Process Loss	WP3 Efficiency
01/01/25	0.678	0.684	0.000	0.005	0.731	-0.052	108%
01/02/25	0.724	0.710	0.000	0.000	0.659	0.065	91%
01/03/25	0.592	0.593	0.000	0.000	0.591	0.001	100%
01/04/25	0.713	0.775	0.000	0.051	0.728	-0.015	102%
01/05/25	0.736	0.731	0.000	0.000	0.715	0.021	97%
01/06/25	0.728	0.720	0.000	0.000	0.714	0.014	98%
01/07/25	0.580	0.588	0.000	0.000	0.634	-0.054	109%
01/08/25	0.699	0.756	0.000	0.053	0.634	0.065	91%
01/09/25	0.572	0.587	0.000	0.003	0.566	0.006	99%
01/10/25	0.675	0.732	0.000	0.048	0.678	-0.003	100%
01/11/25	0.590	0.588	0.000	0.003	0.610	-0.020	103%
01/12/25	1.038	1.033	0.000	0.000	0.670	0.368	65%
01/13/25	0.705	0.709	0.000	0.048	0.729	-0.024	103%
01/14/25	1.039	1.083	0.000	0.007	0.953	0.086	92%
01/15/25	0.963	0.972	0.000	0.000	0.931	0.031	97%
01/16/25	0.748	0.767	0.000	0.053	0.764	-0.015	102%
01/17/25	0.772	0.804	0.000	0.002	0.757	0.015	98%
01/18/25	0.757	0.750	0.000	0.000	0.720	0.038	95%
01/19/25	0.881	0.942	0.000	0.049	0.872	0.009	99%
01/20/25	0.756	0.771	0.000	0.005	0.775	-0.018	102%
01/21/25	0.916	0.960	0.000	0.053	0.952	-0.036	104%
01/22/25	0.830	0.824	0.000	0.003	0.786	0.044	95%
01/23/25	0.684	0.687	0.000	0.038	0.782	-0.099	114%
01/24/25	0.956	1.051	0.000	0.049	0.806	0.149	84%
01/25/25	0.762	0.771	0.000	0.008	0.823	-0.061	108%
01/26/25	0.767	0.814	0.000	0.049	0.702	0.066	91%
01/27/25	0.837	0.855	0.000	0.007	0.821	0.017	98%
01/28/25	0.908	1.074	0.000	0.197	0.815	0.094	90%
01/29/25	0.636	0.692	0.000	0.008	0.707	-0.071	111%
01/30/25	0.779	0.776	0.000	0.000	0.712	0.067	91%
01/31/25	0.707	0.709	0.000	0.052	0.764	-0.057	108%
Total (MG)	23.728	24.508	0.000	0.790	23.098	0.630	-
Highest	1.039	1.083	0.000	0.197	0.953	-	-
Average	0.765	0.791	0.000	0.025	0.745	-	97%
Lowest	0.572	0.587	0.000	0.000	0.566	-	-

January 2025

Waste Water Treatment

This Month

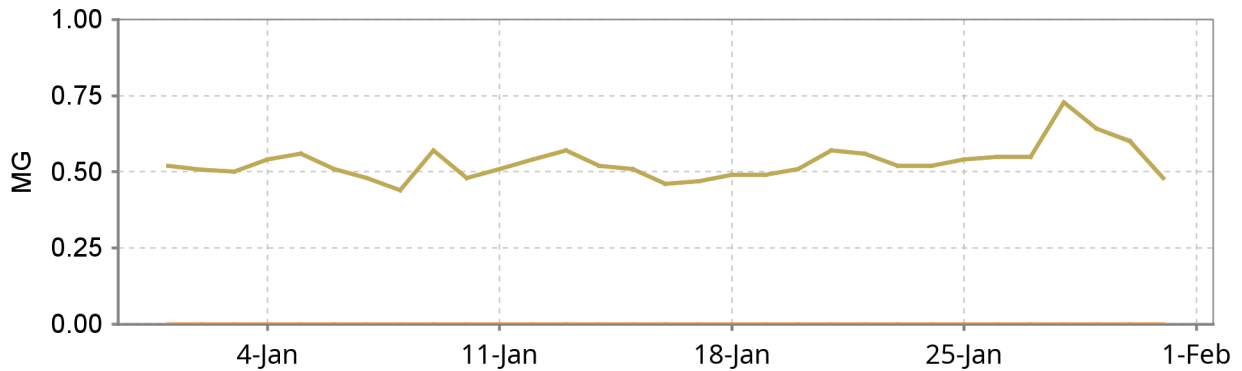


Date	WWTP Treated	LVGC Permit	Cedar Breaks Permit	WWTP Permit	Reclaimed Effluent 210A Permit
01/01/25	0.520	0.101	0.000	0.520	0.000
01/02/25	0.508	0.079	0.553	0.508	0.000
01/03/25	0.500	0.071	0.517	0.500	0.000
01/04/25	0.540	0.081	0.187	0.540	0.000
01/05/25	0.560	0.020	0.176	0.560	0.000
01/06/25	0.510	0.020	1.046	0.510	0.000
01/07/25	0.480	0.010	0.675	0.480	0.000
01/08/25	0.440	0.020	1.566	0.440	0.000
01/09/25	0.570	0.020	1.667	0.570	0.000
01/10/25	0.480	0.010	1.665	0.480	0.000
01/11/25	0.510	0.142	1.662	0.510	0.000
01/12/25	0.540	0.111	0.416	0.540	0.000
01/13/25	0.570	0.030	1.463	0.570	0.000
01/14/25	0.520	0.101	0.558	0.520	0.000
01/15/25	0.510	0.101	1.517	0.510	0.000
01/16/25	0.460	0.101	1.641	0.460	0.000
01/17/25	0.470	0.101	1.665	0.470	0.000
01/18/25	0.490	0.010	0.788	0.490	0.000
01/19/25	0.490	0.010	0.002	0.490	0.000
01/20/25	0.510	0.020	0.000	0.510	0.000
01/21/25	0.570	0.010	0.000	0.570	0.000
01/22/25	0.560	0.020	0.275	0.560	0.000
01/23/25	0.520	0.101	0.839	0.520	0.000
01/24/25	0.520	0.141	0.002	0.520	0.000
01/25/25	0.540	0.121	0.935	0.540	0.000
01/26/25	0.550	0.111	1.668	0.550	0.000
01/27/25	0.550	0.111	1.682	0.550	0.000
01/28/25	0.729	0.119	1.706	0.729	0.000
01/29/25	0.642	0.112	0.925	0.642	0.000
01/30/25	0.600	0.121	0.001	0.601	0.000
01/31/25	0.480	0.091	0.000	0.480	0.000
Total (MG)	16.439	2.218	25.795	16.440	0.000
Highest	0.729	0.142	1.706	0.729	0.000
Average	0.530	0.072	0.832	0.530	0.000
Lowest	0.440	0.010	0.000	0.440	0.000

January 2025

Effluent Disposal


This Month

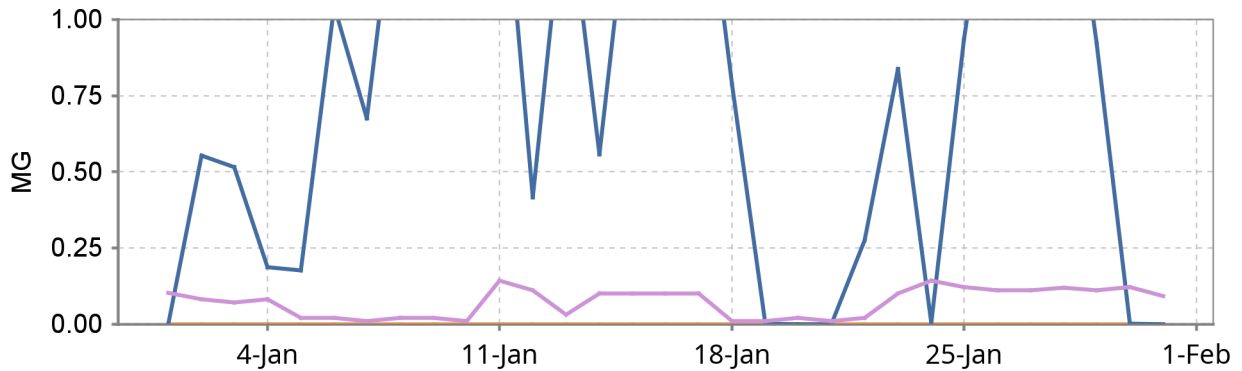

Date	LVGC Usage	LVGC Permit	Cedar Brks. Usage	Cedar Brks. Permit	HLGC Usage	Reclaimed E 210A Permit	LVGC Lake Water	HLGC Lake Water
01/01/25	0.102	0.101	0.000	0.000	0.000	0.000	0.000	---
01/02/25	0.082	0.079	0.553	0.553	0.000	0.000	0.000	---
01/03/25	0.071	0.071	0.517	0.517	0.000	0.000	0.000	---
01/04/25	0.081	0.081	0.187	0.187	0.000	0.000	0.000	---
01/05/25	0.020	0.020	0.176	0.176	0.000	0.000	0.000	---
01/06/25	0.020	0.020	1.046	1.046	0.000	0.000	0.000	---
01/07/25	0.010	0.010	0.675	0.675	0.000	0.000	0.000	---
01/08/25	0.020	0.020	1.566	1.566	0.000	0.000	0.000	---
01/09/25	0.020	0.020	1.663	1.667	0.000	0.000	0.000	---
01/10/25	0.010	0.010	1.669	1.665	0.000	0.000	0.000	---
01/11/25	0.142	0.142	1.662	1.662	0.000	0.000	0.000	---
01/12/25	0.111	0.111	0.416	0.416	0.000	0.000	0.000	---
01/13/25	0.030	0.030	1.463	1.463	0.000	0.000	0.000	---
01/14/25	0.101	0.101	0.558	0.558	0.000	0.000	0.000	---
01/15/25	0.101	0.101	1.517	1.517	0.000	0.000	0.000	---
01/16/25	0.101	0.101	1.641	1.641	0.000	0.000	0.000	---
01/17/25	0.101	0.101	1.665	1.665	0.000	0.000	0.000	---
01/18/25	0.010	0.010	0.788	0.788	0.000	0.000	0.000	---
01/19/25	0.010	0.010	0.002	0.002	0.000	0.000	0.000	---
01/20/25	0.020	0.020	0.000	0.000	0.000	0.000	0.000	---
01/21/25	0.010	0.010	0.000	0.000	0.000	0.000	0.000	---
01/22/25	0.020	0.020	0.275	0.275	0.000	0.000	0.000	---
01/23/25	0.101	0.101	0.839	0.839	0.000	0.000	0.000	---
01/24/25	0.141	0.141	0.002	0.002	0.000	0.000	0.000	---
01/25/25	0.121	0.121	0.935	0.935	0.000	0.000	0.000	---
01/26/25	0.111	0.111	1.668	1.668	0.000	0.000	0.000	---
01/27/25	0.111	0.111	1.682	1.682	0.000	0.000	0.000	---
01/28/25	0.119	0.119	1.706	1.706	0.000	0.000	0.000	---
01/29/25	0.112	0.112	0.925	0.925	0.000	0.000	0.000	---
01/30/25	0.121	0.121	0.001	0.001	0.000	0.000	0.000	---
01/31/25	0.091	0.091	0.000	0.000	0.000	0.000	0.000	---
Total (MG)	2.221	2.218	25.795	25.795	0.000	0.000	0.000	0.000
Highest	0.142	0.142	1.706	1.706	0.000	0.000	0.000	---
Average	0.072	0.072	0.832	0.832	0.000	0.000	0.000	0.000
Lowest	0.010	0.010	0.000	0.000	0.000	0.000	0.000	---

Combined Water Production


Past 12 Months

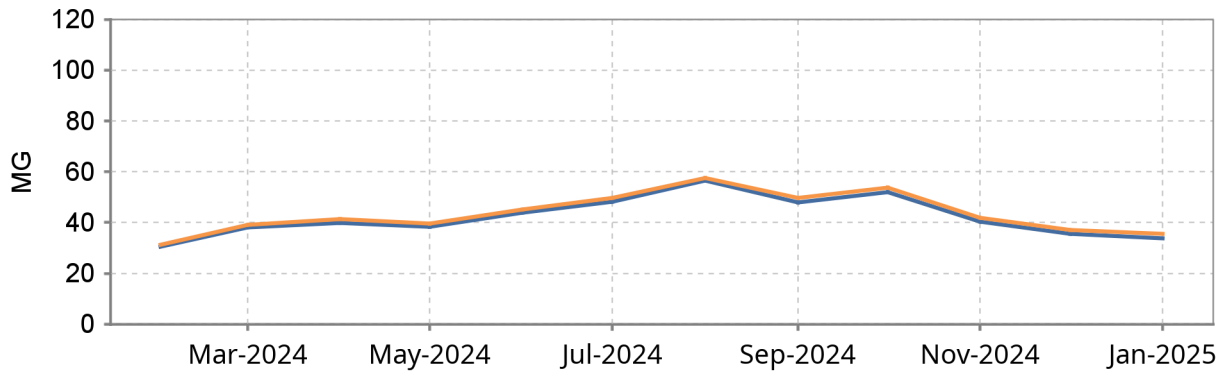

Date	WP1 Raw	WP2 Raw	WP3 Raw	Combined Raw	WP1 Finished	WP2 Finished	WP3 Finished	Combined Finished
Feb, 2024	6.493	---	24.883	31.376	5.973	---	24.546	30.519
Mar, 2024	9.271	---	29.837	39.108	8.548	---	29.469	38.017
Apr, 2024	11.258	---	30.009	41.267	10.391	---	29.535	39.926
May, 2024	11.888	---	27.620	39.509	10.941	---	27.285	38.226
Jun, 2024	17.020	---	28.194	45.214	15.963	---	27.872	43.835
Jul, 2024	18.856	---	30.889	49.745	17.765	---	30.557	48.322
Aug, 2024	21.790	---	35.757	57.547	21.129	---	35.392	56.521
Sep, 2024	21.205	---	28.396	49.601	19.761	---	28.103	47.864
Oct, 2024	23.252	---	30.507	53.759	21.669	---	30.228	51.897
Nov, 2024	17.782	---	23.999	41.782	16.545	---	23.802	40.347
Dec, 2024	15.482	---	21.496	36.978	14.160	---	21.328	35.489
Jan, 2025	11.775	---	23.728	35.503	10.690	---	23.098	33.788
Total (MG)	186.072	0.000	335.316	521.388	173.535	0.000	331.217	504.752
Highest	23.252	---	35.757	57.547	21.669	---	35.392	56.521
Average	15.506	0.000	27.943	43.449	14.461	0.000	27.601	42.063
Lowest	6.493	---	21.496	31.376	5.973	---	21.328	30.519

Water Plant 1 Water Production


Past 12 Months

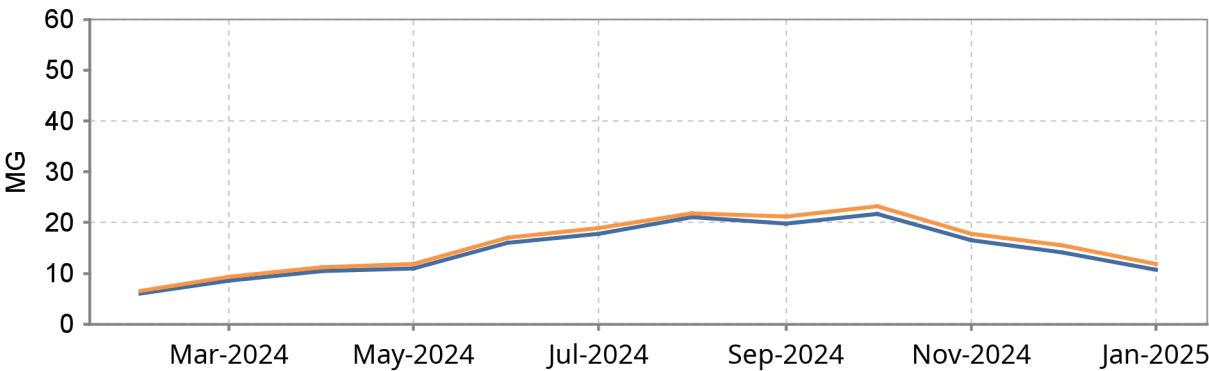

Date	WP1 Raw	WP1 Clarifier A	WP1 Clarifier B	WP1 Finished	WP1 Process Loss	WP1 Efficiency
Feb, 2024	6.493	4.027	2.476	5.973	0.519	92%
Mar, 2024	9.271	5.707	3.560	8.548	0.723	92%
Apr, 2024	11.258	6.728	4.536	10.391	0.867	92%
May, 2024	11.888	7.086	4.774	10.941	0.947	92%
Jun, 2024	17.020	10.271	6.757	15.963	1.057	94%
Jul, 2024	18.856	11.355	7.502	17.765	1.092	94%
Aug, 2024	21.790	11.931	9.852	21.129	0.660	97%
Sep, 2024	21.205	11.803	9.402	19.761	1.444	93%
Oct, 2024	23.252	13.178	10.071	21.669	1.583	93%
Nov, 2024	17.782	10.107	7.674	16.545	1.237	93%
Dec, 2024	15.482	8.354	7.137	14.160	1.322	91%
Jan, 2025	11.775	2.509	9.264	10.690	1.085	91%
Total (MG)	186.072	103.056	83.006	173.535	12.537	-
Highest	23.252	13.178	10.071	21.669	-	-
Average	15.506	8.588	6.917	14.461	-	93%
Lowest	6.493	2.509	2.476	5.973	-	-

Water Plant 2 Water Production


Past 12 Months

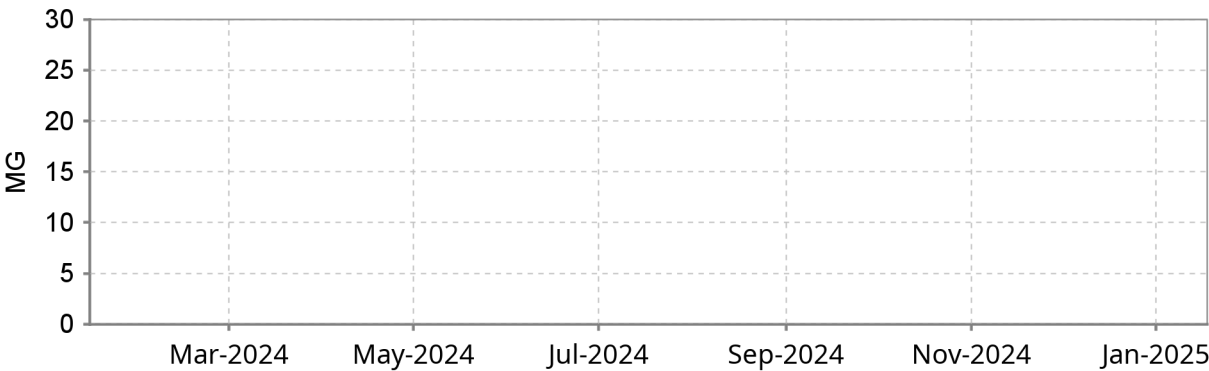

Date	WP2 Raw	To Lohmans	To Golfball	From Golfball	WP2 Finished	WP2 Process Loss	WP2 Efficiency
Feb, 2024	---	---	---	---	---	---	---%
Mar, 2024	---	---	---	---	---	---	---%
Apr, 2024	---	---	---	---	---	---	---%
May, 2024	---	---	---	---	---	---	---%
Jun, 2024	---	---	---	---	---	---	---%
Jul, 2024	---	---	---	---	---	---	---%
Aug, 2024	---	---	---	---	---	---	---%
Sep, 2024	---	---	---	---	---	---	---%
Oct, 2024	---	---	---	---	---	---	---%
Nov, 2024	---	---	---	---	---	---	---%
Dec, 2024	---	---	---	---	---	---	---%
Jan, 2025	---	---	---	---	---	---	---%
Total (MG)	0.000	0.000	0.000	0.000	0.000	0.000	-
Highest	---	---	---	---	---	-	-
Average	0.000	0.000	0.000	0.000	0.000	-	∞%
Lowest	---	---	---	---	---	-	-

Water Plant 3 Water Production

Past 12 Months

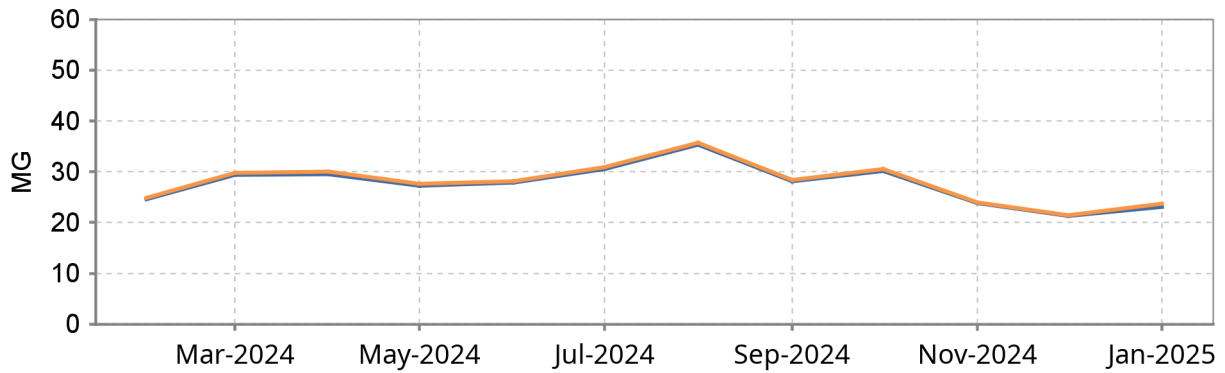


Date	WP3 Raw	WP3 Unit 1	WP3 Decant	WP3 Backwash	WP3 Finished	WP3 Process Loss	WP3 Efficiency
Feb, 2024	24.883	25.527	0.000	0.440	24.546	0.337	99%
Mar, 2024	29.837	30.560	0.000	0.495	29.469	0.368	99%
Apr, 2024	30.009	30.600	0.000	0.494	29.535	0.474	98%
May, 2024	27.620	28.178	0.000	0.440	27.285	0.335	99%
Jun, 2024	28.194	28.739	0.000	0.495	27.872	0.322	99%
Jul, 2024	30.889	31.464	0.000	0.495	30.557	0.331	99%
Aug, 2024	35.757	36.729	0.000	0.768	35.392	0.365	99%
Sep, 2024	28.396	29.176	0.000	0.605	28.103	0.293	99%
Oct, 2024	30.507	31.274	0.000	0.656	30.228	0.279	99%
Nov, 2024	23.999	24.710	0.000	0.556	23.802	0.197	99%
Dec, 2024	21.496	22.048	0.000	0.422	21.328	0.168	99%
Jan, 2025	23.728	24.508	0.000	0.790	23.098	0.630	97%
Total (MG)	335.316	343.514	0.000	6.656	331.217	4.099	-
Highest	35.757	36.729	0.000	0.790	35.392	-	-
Average	27.943	28.626	0.000	0.555	27.601	-	99%
Lowest	21.496	22.048	0.000	0.422	21.328	-	-

January 2025

Waste Water Treatment


Past 12 Months

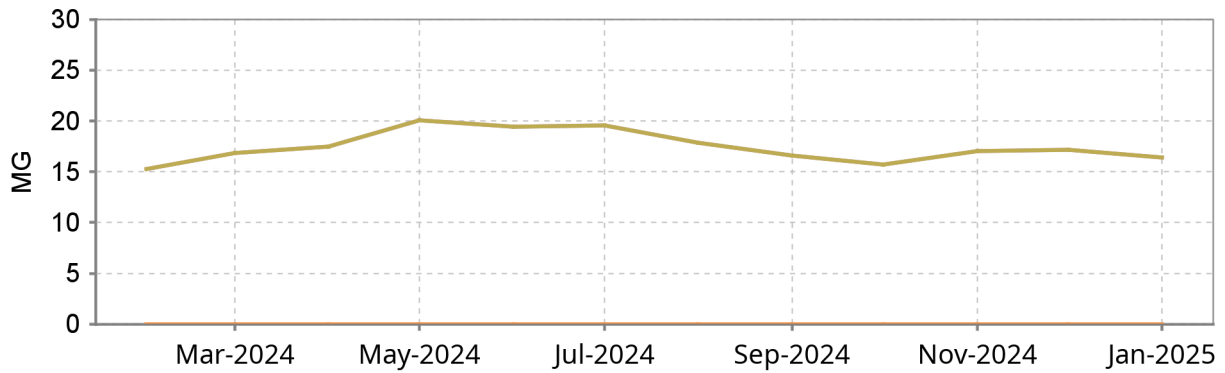

Date	WWTP Treated	LVGC Permit	Cedar Breaks Permit	WWTP Permit	Reclaimed Effluent 210A Permit
Feb, 2024	15.299	0.000	0.000	15.299	0.000
Mar, 2024	16.836	0.000	0.000	16.836	0.000
Apr, 2024	17.490	3.467	12.976	17.490	0.000
May, 2024	20.104	4.413	3.674	20.104	0.000
Jun, 2024	19.447	5.109	0.000	19.447	0.000
Jul, 2024	19.570	4.772	0.000	19.570	0.000
Aug, 2024	17.850	5.993	0.000	17.850	0.000
Sep, 2024	16.627	4.633	4.363	16.627	0.000
Oct, 2024	15.722	6.327	23.827	15.722	0.000
Nov, 2024	17.031	4.601	20.445	17.031	0.000
Dec, 2024	17.160	2.608	23.415	17.160	0.000
Jan, 2025	16.439	2.218	25.795	16.440	0.000
Total (MG)	209.575	44.142	114.493	209.576	0.000
Highest	20.104	6.327	25.795	20.104	0.000
Average	17.465	3.679	9.541	17.465	0.000
Lowest	15.299	0.000	0.000	15.299	0.000

Effluent Disposal


Past 12 Months

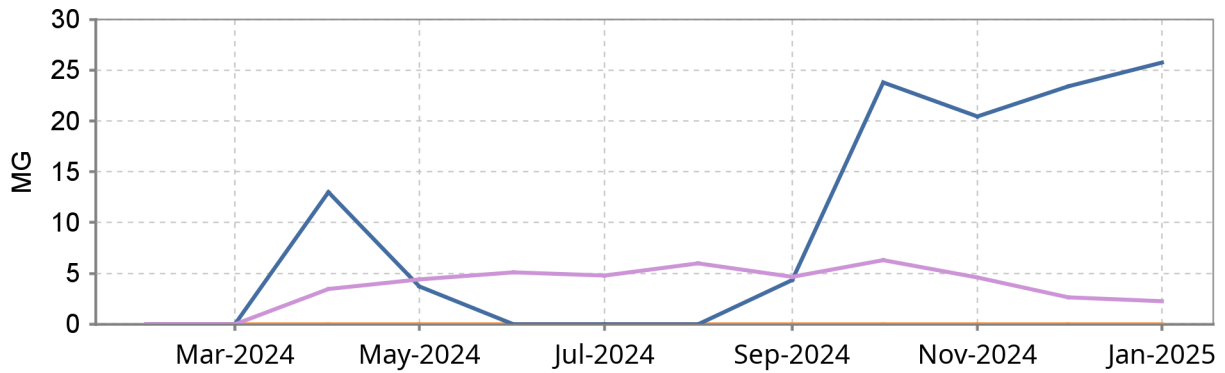

Date	LVGC Usage	LVGC Permit	Cedar Brks. Usage	Cedar Brks. Permit	HLGC Usage	Reclaimed E 210A Permit	LVGC Lake Water	HLGC Lake Water
Feb, 2024	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
Mar, 2024	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---
Apr, 2024	3.467	3.467	12.981	12.976	0.000	0.000	0.000	---
May, 2024	4.413	4.413	3.674	3.674	0.000	0.000	0.000	---
Jun, 2024	5.109	5.109	0.000	0.000	0.000	0.000	0.000	---
Jul, 2024	4.772	4.772	0.000	0.000	0.000	0.000	0.000	---
Aug, 2024	5.993	5.993	0.000	0.000	0.000	0.000	0.000	---
Sep, 2024	4.633	4.633	4.363	4.363	0.000	0.000	0.000	---
Oct, 2024	6.327	6.327	23.827	23.827	0.000	0.000	0.000	---
Nov, 2024	4.601	4.601	20.445	20.445	0.000	0.000	0.000	---
Dec, 2024	2.605	2.608	23.415	23.415	0.000	0.000	0.000	---
Jan, 2025	2.221	2.218	25.795	25.795	0.000	0.000	0.000	---
Total (MG)	44.142	44.142	114.499	114.493	0.000	0.000	0.000	0.000
Highest	6.327	6.327	25.795	25.795	0.000	0.000	0.000	---
Average	3.679	3.679	9.542	9.541	0.000	0.000	0.000	0.000
Lowest	0.000	0.000	0.000	0.000	0.000	0.000	0.000	---

Combined Water Production


5 Year Average Daily Production

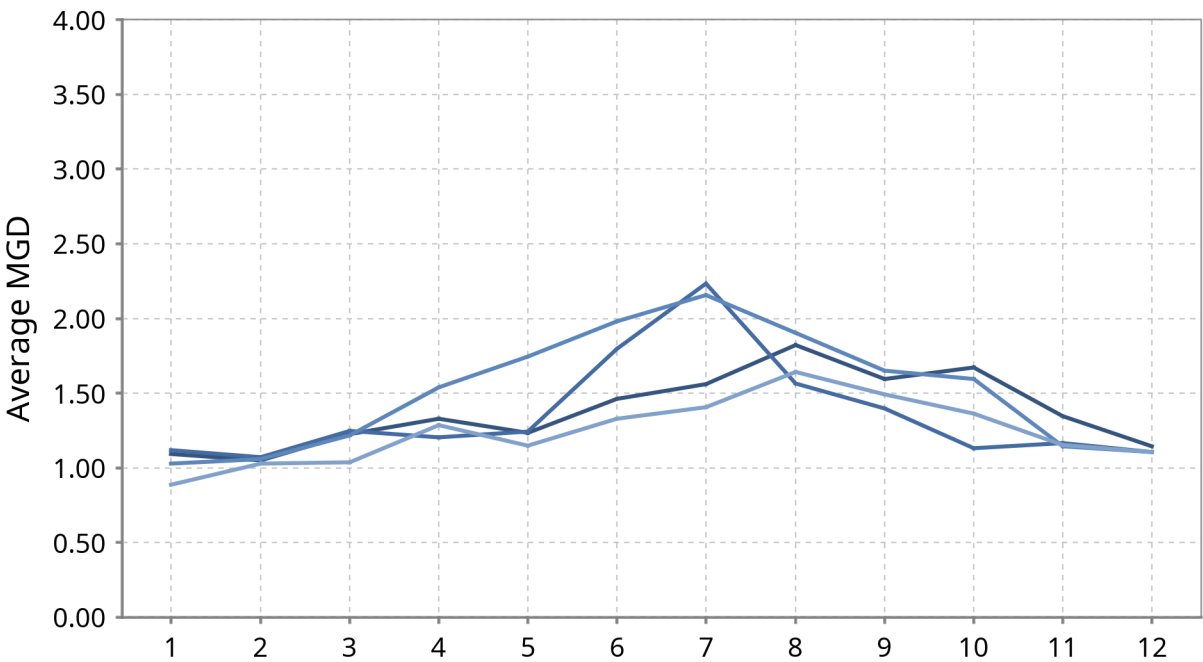

Month	Year - 4	Year - 3	Year - 2	Last Year	This Year
Jan	0.888	1.027	1.118	1.092	1.090
Feb	1.030	1.059	1.073	1.052	---
Mar	1.039	1.217	1.246	1.226	---
Apr	1.285	1.541	1.205	1.331	---
May	1.149	1.744	1.243	1.233	---
Jun	1.330	1.982	1.796	1.461	---
Jul	1.407	2.158	2.233	1.559	---
Aug	1.642	1.905	1.563	1.823	---
Sep	1.492	1.652	1.400	1.595	---
Oct	1.365	1.594	1.133	1.674	---
Nov	1.153	1.144	1.166	1.345	---
Dec	1.105	1.108	1.107	1.145	---
Highest	1.642	2.158	2.233	1.823	1.090
Average	1.240	1.511	1.357	1.378	1.090
Lowest	0.888	1.027	1.073	1.052	1.090

Waste Water Treatment

5 Year Average Daily Treated

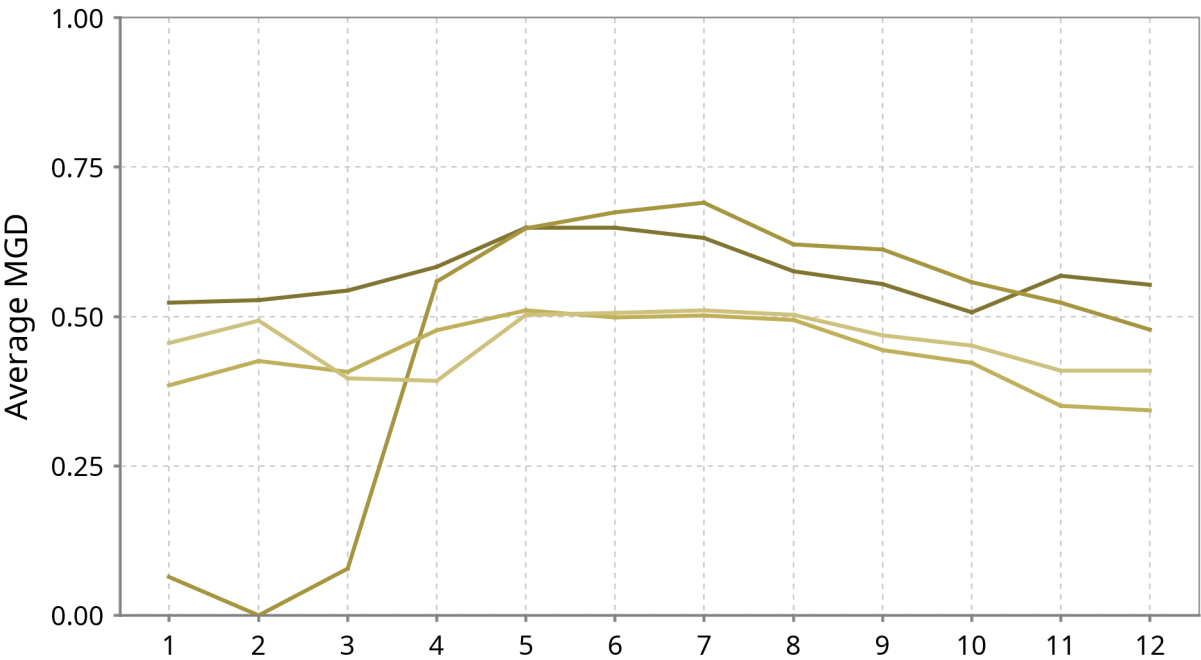

Month	Year - 4	Year - 3	Year - 2	Last Year	This Year
Jan	0.456	0.385	0.064	0.523	0.530
Feb	0.493	0.425	0.000	0.528	---
Mar	0.396	0.407	0.078	0.543	---
Apr	0.392	0.477	0.559	0.583	---
May	0.503	0.511	0.648	0.649	---
Jun	0.506	0.499	0.675	0.648	---
Jul	0.510	0.502	0.690	0.631	---
Aug	0.503	0.494	0.620	0.576	---
Sep	0.469	0.443	0.612	0.554	---
Oct	0.451	0.422	0.557	0.507	---
Nov	0.409	0.351	0.523	0.568	---
Dec	0.410	0.343	0.478	0.554	---
Highest	0.510	0.511	0.690	0.649	0.530
Average	0.458	0.438	0.459	0.572	0.530
Lowest	0.392	0.343	0.000	0.507	0.530