

CITY OF LAGO VISTA WATER & WASTEWATER REPORT

March 2025



Water Production

This Month		Total Production - 40.779 MG				
	Raw Water	Production	Efficiency	Highest Day	Average Day	Lowest Day
Water Plant 1	12.710 MG	11.754 MG	92.5%	0.511 MG	0.379 MG	0.255 MG
Water Plant 2	0.000 MG	0.000 MG	∞%	--- MG	0.000 MG	--- MG
Water Plant 3	29.489 MG	29.025 MG	98.4%	1.140 MG	0.936 MG	0.782 MG
Combined	42.199 MG	40.779 MG	96.6%	1.650 MG	1.315 MG	1.068 MG

Past 12 Months		Total Production - 507.285 MG				
	Raw Water	Production	Efficiency	Highest Day	Average Day	Lowest Day
Water Plant 1	191.773 MG	178.763 MG	93.2%	0.845 MG	0.490 MG	0.091 MG
Water Plant 2	0.000 MG	0.000 MG	∞%	--- MG	0.000 MG	--- MG
Water Plant 3	332.671 MG	328.522 MG	98.8%	1.455 MG	0.900 MG	0.566 MG
Combined	524.444 MG	507.285 MG	96.7%	2.200 MG	1.390 MG	0.888 MG

Waste Water Treatment

This Month		Total Treated - 18.390 MG		
	Treated	Highest Day	Average Day	Lowest Day
Waste Water Treatment Plant	18.390 MG	0.690 MG	0.593 MG	0.520 MG
Past 12 Months		Total Treated - 211.170 MG		
	Treated	Highest Day	Average Day	Lowest Day
Waste Water Treatment Plant	211.170 MG	0.820 MG	0.579 MG	0.440 MG


Effluent Disposal

This Month		WWTP Plant Permit Total - 18.390 MG		
	Total	Highest Day	Average Day	Lowest Day
Lago Vista Golf Course Permit	0.560 MG	234.900 MG	0.018 MG	-234.880 MG
Cedar Breaks Permit	-313.022 MG	1.518 MG	-10.097 MG	-335.365 MG
WWTP Plant Permit Total	18.390 MG	0.690 MG	0.593 MG	0.520 MG
Reclaimed Effluent 210A Permit	0.000 MG	0.000 MG	0.000 MG	0.000 MG
Past 12 Months		WWTP Plant Permit Total - 211.171 MG		
	Total	Highest Day	Average Day	Lowest Day
Lago Vista Golf Course Permit	47.263 MG	234.900 MG	0.129 MG	-234.880 MG
Cedar Breaks Permit	-179.945 MG	1.706 MG	-0.493 MG	-335.365 MG
WWTP Plant Permit Total	211.171 MG	0.820 MG	0.579 MG	0.440 MG
Reclaimed Effluent 210A Permit	0.000 MG	0.000 MG	0.000 MG	0.000 MG

March 2025

Combined Water Production

This Month

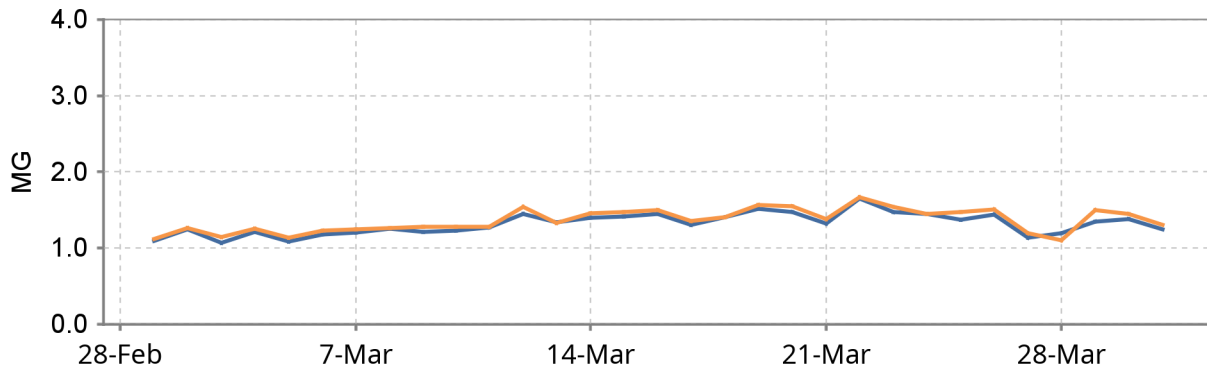


Date	WP1 Raw	WP2 Raw	WP3 Raw	Combined Raw	WP1 Finished	WP2 Finished	WP3 Finished	Combined Finished
03/01/25	0.269	---	0.851	1.120	0.255	---	0.841	1.097
03/02/25	0.363	---	0.895	1.258	0.349	---	0.894	1.242
03/03/25	0.312	---	0.831	1.143	0.286	---	0.782	1.068
03/04/25	0.394	---	0.859	1.253	0.334	---	0.879	1.213
03/05/25	0.322	---	0.811	1.133	0.306	---	0.782	1.088
03/06/25	0.352	---	0.876	1.228	0.319	---	0.854	1.173
03/07/25	0.415	---	0.833	1.248	0.380	---	0.824	1.204
03/08/25	0.374	---	0.890	1.264	0.366	---	0.884	1.251
03/09/25	0.394	---	0.880	1.274	0.336	---	0.873	1.209
03/10/25	0.394	---	0.887	1.281	0.367	---	0.861	1.228
03/11/25	0.373	---	0.902	1.275	0.367	---	0.904	1.271
03/12/25	0.529	---	1.010	1.540	0.459	---	0.990	1.449
03/13/25	0.395	---	0.935	1.330	0.378	---	0.961	1.340
03/14/25	0.478	---	0.980	1.459	0.419	---	0.976	1.395
03/15/25	0.436	---	1.037	1.474	0.418	---	0.994	1.412
03/16/25	0.467	---	1.031	1.499	0.449	---	0.998	1.447
03/17/25	0.456	---	0.900	1.357	0.388	---	0.919	1.307
03/18/25	0.415	---	0.988	1.404	0.406	---	0.996	1.403
03/19/25	0.499	---	1.070	1.569	0.462	---	1.053	1.515
03/20/25	0.477	---	1.067	1.544	0.429	---	1.040	1.468
03/21/25	0.404	---	0.974	1.379	0.390	---	0.931	1.321
03/22/25	0.561	---	1.105	1.666	0.511	---	1.140	1.650
03/23/25	0.426	---	1.113	1.539	0.400	---	1.076	1.476
03/24/25	0.500	---	0.948	1.447	0.469	---	0.976	1.445
03/25/25	0.426	---	1.048	1.474	0.388	---	0.982	1.370
03/26/25	0.468	---	1.034	1.502	0.442	---	0.993	1.435
03/27/25	0.291	---	0.904	1.196	0.279	---	0.856	1.136
03/28/25	0.301	---	0.799	1.100	0.287	---	0.909	1.196
03/29/25	0.415	---	1.079	1.494	0.359	---	0.989	1.348
03/30/25	0.395	---	1.052	1.446	0.377	---	1.005	1.382
03/31/25	0.405	---	0.899	1.304	0.379	---	0.862	1.241
Total (MG)	12.710	0.000	29.489	42.199	11.754	0.000	29.025	40.779
Highest	0.561	---	1.113	1.666	0.511	---	1.140	1.650
Average	0.410	0.000	0.951	1.361	0.379	0.000	0.936	1.315
Lowest	0.269	---	0.799	1.100	0.255	---	0.782	1.068

March 2025

Water Plant 1 Water Production

This Month

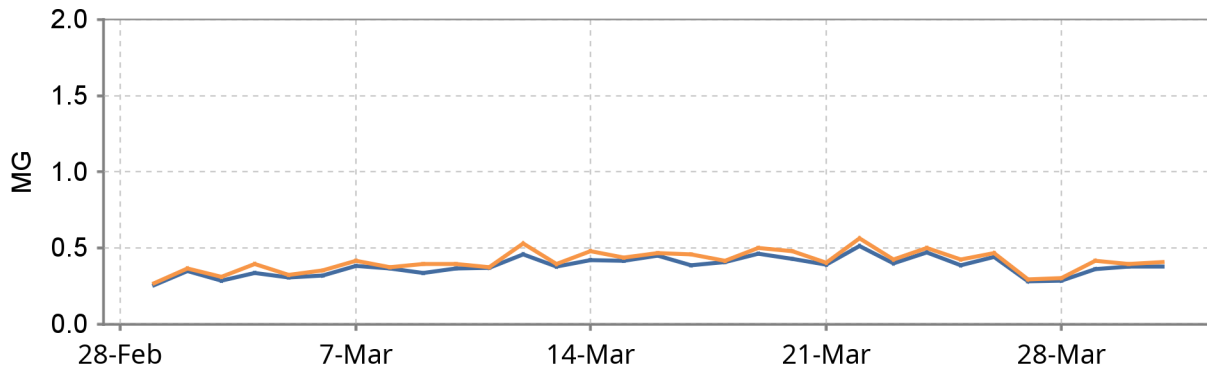


Date	WP1 Raw	WP1 Clarifier A	WP1 Clarifier B	WP1 Finished	WP1 Process Loss	WP1 Efficiency
03/01/25	0.269	0.000	0.269	0.255	0.014	95%
03/02/25	0.363	0.000	0.363	0.349	0.015	96%
03/03/25	0.312	0.000	0.312	0.286	0.026	92%
03/04/25	0.394	0.000	0.394	0.334	0.061	85%
03/05/25	0.322	0.000	0.322	0.306	0.016	95%
03/06/25	0.352	0.000	0.352	0.319	0.033	91%
03/07/25	0.415	0.000	0.415	0.380	0.035	92%
03/08/25	0.374	0.000	0.374	0.366	0.008	98%
03/09/25	0.394	0.000	0.394	0.336	0.058	85%
03/10/25	0.394	0.000	0.394	0.367	0.027	93%
03/11/25	0.373	0.000	0.373	0.367	0.006	98%
03/12/25	0.529	0.000	0.529	0.459	0.070	87%
03/13/25	0.395	0.000	0.395	0.378	0.016	96%
03/14/25	0.478	0.000	0.478	0.419	0.059	88%
03/15/25	0.436	0.000	0.436	0.418	0.019	96%
03/16/25	0.467	0.000	0.467	0.449	0.019	96%
03/17/25	0.456	0.000	0.456	0.388	0.068	85%
03/18/25	0.415	0.000	0.415	0.406	0.009	98%
03/19/25	0.499	0.000	0.499	0.462	0.037	93%
03/20/25	0.477	0.000	0.477	0.429	0.048	90%
03/21/25	0.404	0.000	0.404	0.390	0.014	96%
03/22/25	0.561	0.000	0.561	0.511	0.051	91%
03/23/25	0.426	0.000	0.426	0.400	0.026	94%
03/24/25	0.500	0.000	0.500	0.469	0.031	94%
03/25/25	0.426	0.000	0.426	0.388	0.038	91%
03/26/25	0.468	0.000	0.468	0.442	0.026	94%
03/27/25	0.291	0.000	0.291	0.279	0.012	96%
03/28/25	0.301	0.000	0.301	0.287	0.014	95%
03/29/25	0.415	0.000	0.415	0.359	0.056	86%
03/30/25	0.395	0.000	0.395	0.377	0.017	96%
03/31/25	0.405	0.000	0.405	0.379	0.026	94%
Total (MG)	12.710	0.001	12.709	11.754	0.956	-
Highest	0.561	0.000	0.561	0.511	-	-
Average	0.410	0.000	0.410	0.379	-	92%
Lowest	0.269	0.000	0.269	0.255	-	-

March 2025

Water Plant 3 Water Production

This Month

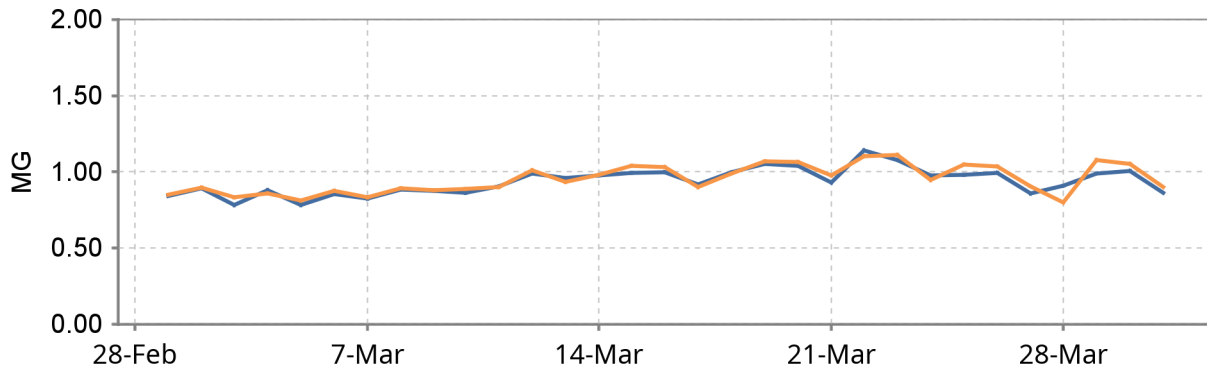


Date	WP3 Raw	WP3 Unit 1	WP3 Decant	WP3 Backwash	WP3 Finished	WP3 Process Loss	WP3 Efficiency
03/01/25	0.851	0.826	0.000	0.000	0.841	0.010	99%
03/02/25	0.895	0.953	0.000	0.050	0.894	0.001	100%
03/03/25	0.831	0.832	0.000	0.007	0.782	0.049	94%
03/04/25	0.859	0.902	0.000	0.052	0.879	-0.021	102%
03/05/25	0.811	0.831	0.000	0.006	0.782	0.029	96%
03/06/25	0.876	0.860	0.000	0.000	0.854	0.023	97%
03/07/25	0.833	0.911	0.000	0.050	0.824	0.009	99%
03/08/25	0.890	0.873	0.000	0.008	0.884	0.006	99%
03/09/25	0.880	0.874	0.000	0.000	0.873	0.007	99%
03/10/25	0.887	0.946	0.000	0.050	0.861	0.026	97%
03/11/25	0.902	0.887	0.000	0.006	0.904	-0.002	100%
03/12/25	1.010	1.038	0.000	0.050	0.990	0.020	98%
03/13/25	0.935	0.958	0.000	0.007	0.961	-0.026	103%
03/14/25	0.980	0.965	0.000	0.000	0.976	0.005	100%
03/15/25	1.037	1.103	0.000	0.056	0.994	0.043	96%
03/16/25	1.031	1.039	0.000	0.001	0.998	0.034	97%
03/17/25	0.900	0.952	0.000	0.052	0.919	-0.019	102%
03/18/25	0.988	0.966	0.000	0.004	0.996	-0.008	101%
03/19/25	1.070	1.071	0.000	0.000	1.053	0.017	98%
03/20/25	1.067	1.134	0.000	0.052	1.040	0.027	97%
03/21/25	0.974	0.966	0.000	0.004	0.931	0.043	96%
03/22/25	1.105	1.164	0.000	0.047	1.140	-0.035	103%
03/23/25	1.113	1.107	0.000	0.009	1.076	0.037	97%
03/24/25	0.948	1.001	0.000	0.050	0.976	-0.029	103%
03/25/25	1.048	1.052	0.000	0.007	0.982	0.066	94%
03/26/25	1.034	1.061	0.000	0.057	0.993	0.041	96%
03/27/25	0.904	0.874	0.000	0.000	0.856	0.048	95%
03/28/25	0.799	0.816	0.000	0.000	0.909	-0.111	114%
03/29/25	1.079	1.110	0.000	0.050	0.989	0.090	92%
03/30/25	1.052	1.043	0.000	0.006	1.005	0.046	96%
03/31/25	0.899	0.924	0.000	0.052	0.862	0.037	96%
Total (MG)	29.489	30.039	0.000	0.734	29.025	0.464	-
Highest	1.113	1.164	0.000	0.057	1.140	-	-
Average	0.951	0.969	0.000	0.024	0.936	-	98%
Lowest	0.799	0.816	0.000	0.000	0.782	-	-

March 2025

Waste Water Treatment

This Month

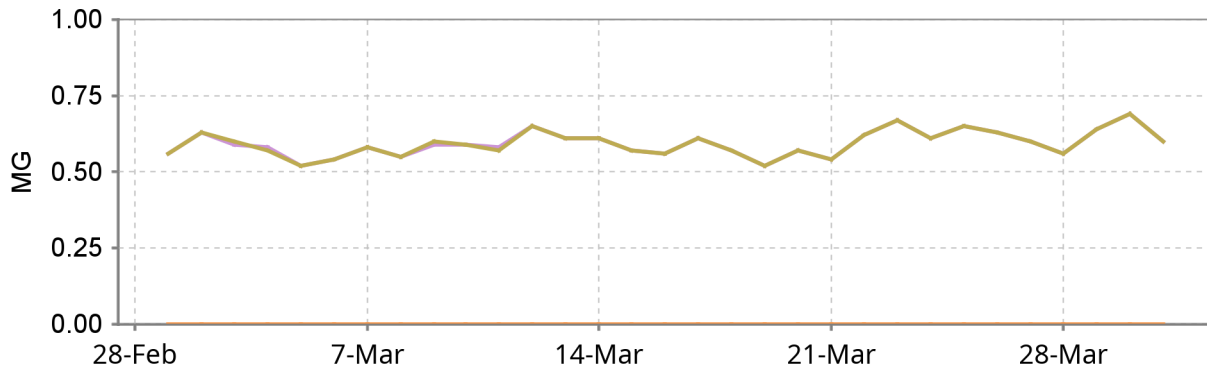


Date	WWTP Treated	LVGC Permit	Cedar Breaks Permit	WWTP Permit	Reclaimed Effluent 210A Permit
03/01/25	0.560	0.030	0.551	0.560	0.000
03/02/25	0.630	0.020	0.588	0.630	0.000
03/03/25	0.600	0.020	0.602	0.590	0.000
03/04/25	0.570	0.002	0.003	0.580	0.000
03/05/25	0.520	0.000	0.992	0.520	0.000
03/06/25	0.540	0.000	1.055	0.540	0.000
03/07/25	0.580	0.000	-335.365	0.580	0.000
03/08/25	0.550	0.000	1.022	0.550	0.000
03/09/25	0.600	0.000	1.076	0.590	0.000
03/10/25	0.590	0.000	1.084	0.590	0.000
03/11/25	0.570	0.000	1.061	0.580	0.000
03/12/25	0.650	0.000	1.048	0.650	0.000
03/13/25	0.610	0.000	1.058	0.610	0.000
03/14/25	0.610	0.000	0.125	0.610	0.000
03/15/25	0.570	0.000	1.411	0.570	0.000
03/16/25	0.560	0.000	1.518	0.560	0.000
03/17/25	0.610	-234.880	0.365	0.610	0.000
03/18/25	0.570	234.900	1.022	0.570	0.000
03/19/25	0.520	0.051	0.041	0.520	0.000
03/20/25	0.570	0.051	0.923	0.570	0.000
03/21/25	0.540	0.082	0.488	0.540	0.000
03/22/25	0.620	0.061	0.005	0.620	0.000
03/23/25	0.670	0.050	0.000	0.670	0.000
03/24/25	0.610	0.041	0.871	0.610	0.000
03/25/25	0.650	0.040	0.974	0.650	0.000
03/26/25	0.630	0.040	0.970	0.630	0.000
03/27/25	0.600	0.000	0.896	0.600	0.000
03/28/25	0.560	0.000	0.501	0.560	0.000
03/29/25	0.640	0.000	0.732	0.640	0.000
03/30/25	0.690	0.000	0.445	0.690	0.000
03/31/25	0.600	0.051	0.917	0.600	0.000
Total (MG)	18.390	0.560	-313.022	18.390	0.000
Highest	0.690	234.900	1.518	0.690	0.000
Average	0.593	0.018	-10.097	0.593	0.000
Lowest	0.520	-234.880	-335.365	0.520	0.000

March 2025

Effluent Disposal


This Month

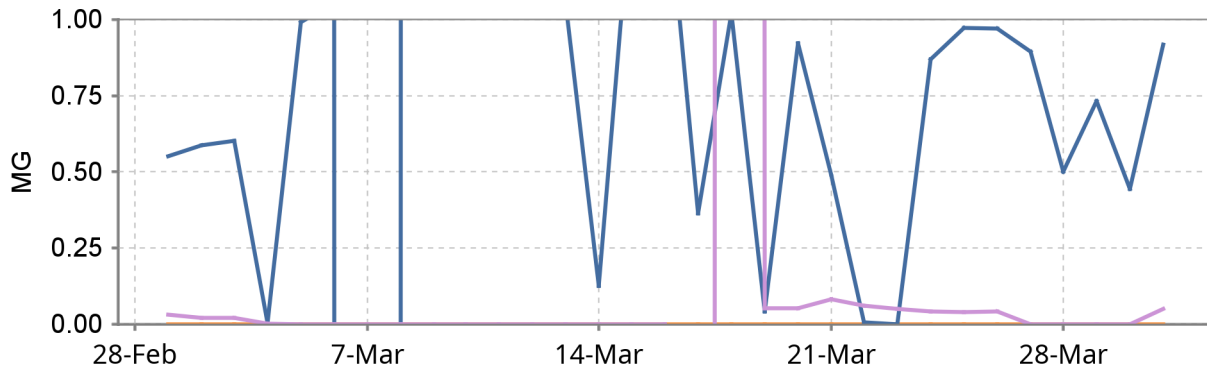

Date	LVGC Usage	LVGC Permit	Cedar Brks. Usage	Cedar Brks. Permit	HLGC Usage	Reclaimed E 210A Permit	LVGC Lake Water	HLGC Lake Water
03/01/25	0.030	0.030	0.551	0.551	0.000	0.000	0.000	---
03/02/25	0.020	0.020	0.588	0.588	0.000	0.000	0.000	---
03/03/25	0.020	0.020	0.602	0.602	0.000	0.000	0.000	---
03/04/25	0.002	0.002	0.003	0.003	0.000	0.000	0.000	---
03/05/25	0.000	0.000	0.992	0.992	0.000	0.000	0.000	---
03/06/25	0.000	0.000	1.055	1.055	0.000	0.000	0.000	---
03/07/25	0.000	0.000	-335.365	-335.365	0.000	0.000	0.000	---
03/08/25	0.000	0.000	1.022	1.022	0.000	0.000	0.000	---
03/09/25	0.000	0.000	1.076	1.076	0.000	0.000	0.000	---
03/10/25	0.000	0.000	1.084	1.084	0.000	0.000	0.000	---
03/11/25	0.000	0.000	1.061	1.061	0.000	0.000	0.000	---
03/12/25	0.000	0.000	1.048	1.048	0.000	0.000	0.000	---
03/13/25	0.000	0.000	1.058	1.058	0.000	0.000	0.000	---
03/14/25	0.000	0.000	0.125	0.125	0.000	0.000	0.000	---
03/15/25	0.000	0.000	1.411	1.411	0.000	0.000	0.000	---
03/16/25	0.000	0.000	1.518	1.518	0.000	0.000	0.000	---
03/17/25	-234.880	-234.880	0.365	0.365	0.000	0.000	0.000	---
03/18/25	234.900	234.900	1.022	1.022	0.000	0.000	0.000	---
03/19/25	0.051	0.051	0.041	0.041	0.000	0.000	0.000	---
03/20/25	0.051	0.051	0.923	0.923	0.000	0.000	0.000	---
03/21/25	0.082	0.082	0.488	0.488	0.000	0.000	0.000	---
03/22/25	0.061	0.061	0.005	0.005	0.000	0.000	0.000	---
03/23/25	0.050	0.050	0.000	0.000	0.000	0.000	0.000	---
03/24/25	0.041	0.041	0.871	0.871	0.000	0.000	0.000	---
03/25/25	0.040	0.040	0.974	0.974	0.000	0.000	0.000	---
03/26/25	0.040	0.040	0.970	0.970	0.000	0.000	0.000	---
03/27/25	0.000	0.000	0.896	0.896	0.000	0.000	0.000	---
03/28/25	0.000	0.000	0.501	0.501	0.000	0.000	0.000	---
03/29/25	0.000	0.000	0.732	0.732	0.000	0.000	0.000	---
03/30/25	0.000	0.000	0.445	0.445	0.000	0.000	0.000	---
03/31/25	0.051	0.051	0.917	0.917	0.000	0.000	0.000	---
Total (MG)	0.560	0.560	-313.022	-313.022	0.000	0.000	0.000	0.000
Highest	234.900	234.900	1.518	1.518	0.000	0.000	0.000	---
Average	0.018	0.018	-10.097	-10.097	0.000	0.000	0.000	0.000
Lowest	-234.880	-234.880	-335.365	-335.365	0.000	0.000	0.000	---

Combined Water Production


Past 12 Months

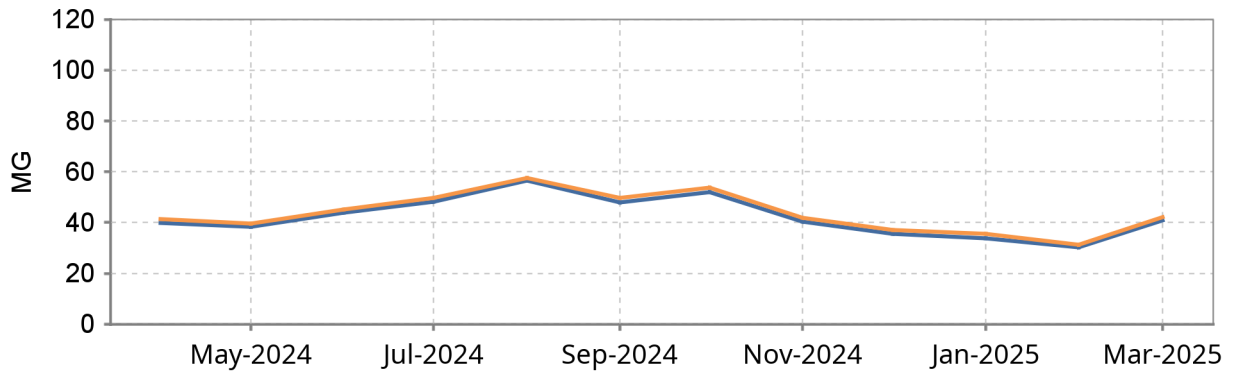

Date	WP1 Raw	WP2 Raw	WP3 Raw	Combined Raw	WP1 Finished	WP2 Finished	WP3 Finished	Combined Finished
Apr, 2024	11.258	---	30.009	41.267	10.391	---	29.535	39.926
May, 2024	11.888	---	27.620	39.509	10.941	---	27.285	38.226
Jun, 2024	17.020	---	28.194	45.214	15.963	---	27.872	43.835
Jul, 2024	18.856	---	30.889	49.745	17.765	---	30.557	48.322
Aug, 2024	21.790	---	35.757	57.547	21.129	---	35.392	56.521
Sep, 2024	21.205	---	28.396	49.601	19.761	---	28.103	47.864
Oct, 2024	23.252	---	30.507	53.759	21.669	---	30.228	51.897
Nov, 2024	17.782	---	23.999	41.782	16.545	---	23.802	40.347
Dec, 2024	15.482	---	21.496	36.978	14.160	---	21.328	35.489
Jan, 2025	11.775	---	23.728	35.503	10.690	---	23.098	33.788
Feb, 2025	8.754	---	22.587	31.341	7.994	---	22.296	30.290
Mar, 2025	12.710	---	29.489	42.199	11.754	---	29.025	40.779
Total (MG)	191.773	0.000	332.671	524.444	178.763	0.000	328.522	507.285
Highest	23.252	---	35.757	57.547	21.669	---	35.392	56.521
Average	15.981	0.000	27.723	43.704	14.897	0.000	27.377	42.274
Lowest	8.754	---	21.496	31.341	7.994	---	21.328	30.290

Water Plant 1 Water Production


Past 12 Months

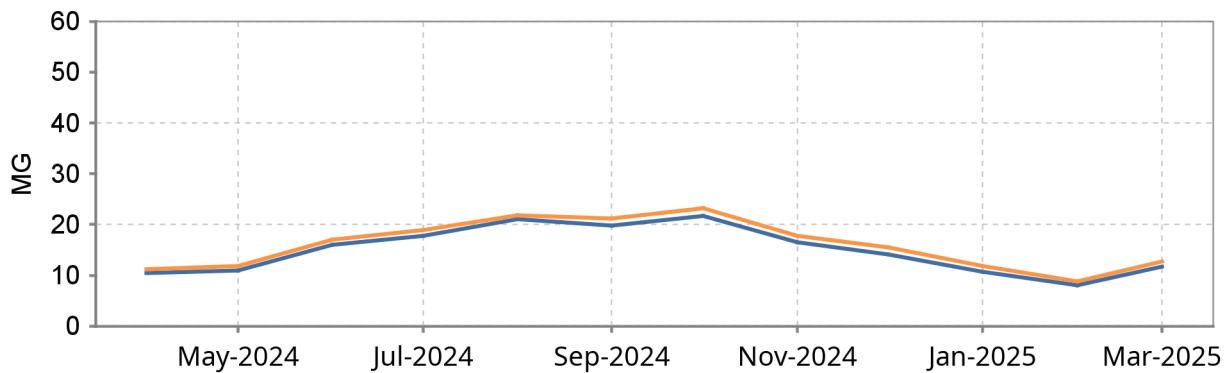

Date	WP1 Raw	WP1 Clarifier A	WP1 Clarifier B	WP1 Finished	WP1 Process Loss	WP1 Efficiency
Apr, 2024	11.258	6.728	4.536	10.391	0.867	92%
May, 2024	11.888	7.086	4.774	10.941	0.947	92%
Jun, 2024	17.020	10.271	6.757	15.963	1.057	94%
Jul, 2024	18.856	11.355	7.502	17.765	1.092	94%
Aug, 2024	21.790	11.931	9.852	21.129	0.660	97%
Sep, 2024	21.205	11.803	9.402	19.761	1.444	93%
Oct, 2024	23.252	13.178	10.071	21.669	1.583	93%
Nov, 2024	17.782	10.107	7.674	16.545	1.237	93%
Dec, 2024	15.482	8.354	7.137	14.160	1.322	91%
Jan, 2025	11.775	2.509	9.264	10.690	1.085	91%
Feb, 2025	8.754	0.000	8.753	7.994	0.760	91%
Mar, 2025	12.710	0.001	12.709	11.754	0.956	92%
Total (MG)	191.773	93.323	98.432	178.763	13.010	-
Highest	23.252	13.178	12.709	21.669	-	-
Average	15.981	7.777	8.203	14.897	-	93%
Lowest	8.754	0.000	4.536	7.994	-	-

Water Plant 3 Water Production

Past 12 Months

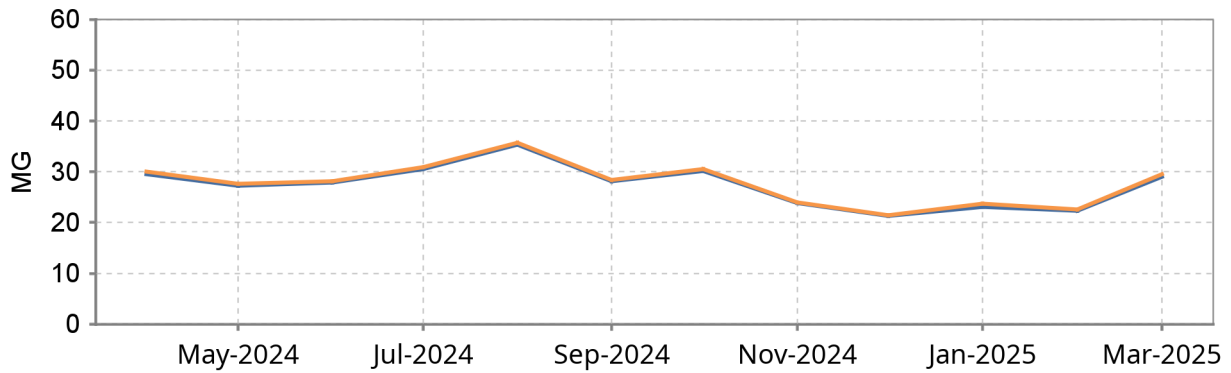


Date	WP3 Raw	WP3 Unit 1	WP3 Decant	WP3 Backwash	WP3 Finished	WP3 Process Loss	WP3 Efficiency
Apr, 2024	30.009	30.600	0.000	0.494	29.535	0.474	98%
May, 2024	27.620	28.178	0.000	0.440	27.285	0.335	99%
Jun, 2024	28.194	28.739	0.000	0.495	27.872	0.322	99%
Jul, 2024	30.889	31.464	0.000	0.495	30.557	0.331	99%
Aug, 2024	35.757	36.729	0.000	0.768	35.392	0.365	99%
Sep, 2024	28.396	29.176	0.000	0.605	28.103	0.293	99%
Oct, 2024	30.507	31.274	0.000	0.656	30.228	0.279	99%
Nov, 2024	23.999	24.710	0.000	0.556	23.802	0.197	99%
Dec, 2024	21.496	22.048	0.000	0.422	21.328	0.168	99%
Jan, 2025	23.728	24.508	0.000	0.790	23.098	0.630	97%
Feb, 2025	22.587	23.460	0.000	0.816	22.296	0.291	99%
Mar, 2025	29.489	30.039	0.000	0.734	29.025	0.464	98%
Total (MG)	332.671	340.925	0.000	7.272	328.522	4.149	-
Highest	35.757	36.729	0.000	0.816	35.392	-	-
Average	27.723	28.410	0.000	0.606	27.377	-	99%
Lowest	21.496	22.048	0.000	0.422	21.328	-	-

March 2025

Waste Water Treatment


Past 12 Months

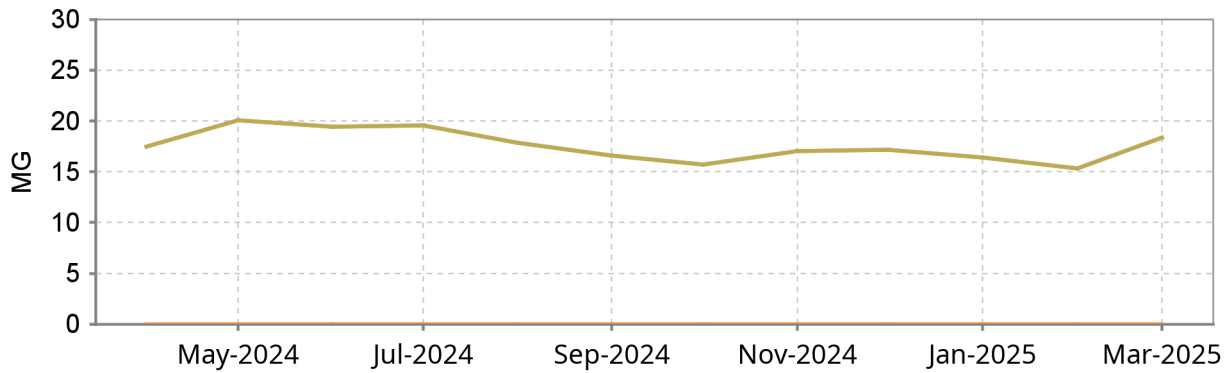

Date	WWTP Treated	LVGC Permit	Cedar Breaks Permit	WWTP Permit	Reclaimed Effluent 210A Permit
Apr, 2024	17.490	3.467	12.976	17.490	0.000
May, 2024	20.104	4.413	3.674	20.104	0.000
Jun, 2024	19.447	5.109	0.000	19.447	0.000
Jul, 2024	19.570	4.772	0.000	19.570	0.000
Aug, 2024	17.850	5.993	0.000	17.850	0.000
Sep, 2024	16.627	4.633	4.363	16.627	0.000
Oct, 2024	15.722	6.327	23.827	15.722	0.000
Nov, 2024	17.031	4.601	20.445	17.031	0.000
Dec, 2024	17.160	2.608	23.415	17.160	0.000
Jan, 2025	16.439	2.218	25.795	16.440	0.000
Feb, 2025	15.340	2.561	18.584	15.340	0.000
Mar, 2025	18.390	0.560	-313.022	18.390	0.000
Total (MG)	211.170	47.263	-179.945	211.171	0.000
Highest	20.104	6.327	25.795	20.104	0.000
Average	17.597	3.939	-14.995	17.598	0.000
Lowest	15.340	0.560	-313.022	15.340	0.000

Effluent Disposal


Past 12 Months

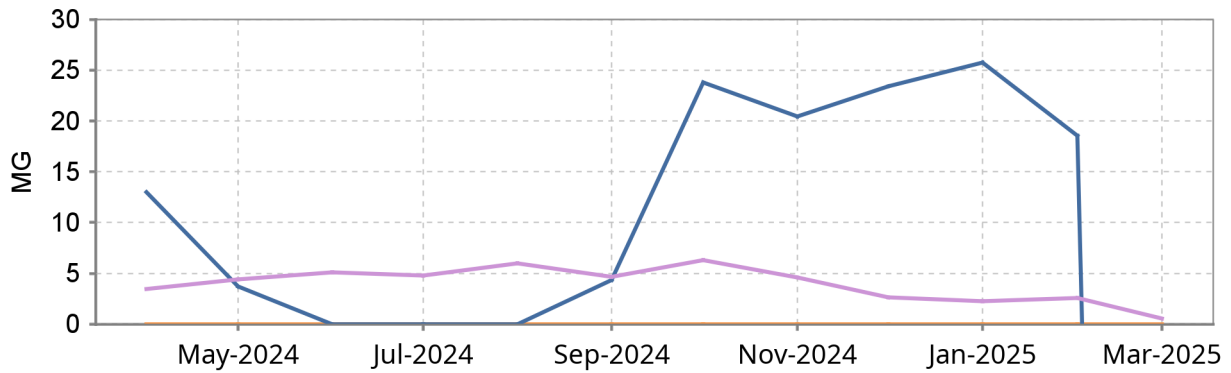

Date	LVGC Usage	LVGC Permit	Cedar Brks. Usage	Cedar Brks. Permit	HLGC Usage	Reclaimed E 210A Permit	LVGC Lake Water	HLGC Lake Water
Apr, 2024	3.467	3.467	12.981	12.976	0.000	0.000	0.000	---
May, 2024	4.413	4.413	3.674	3.674	0.000	0.000	0.000	---
Jun, 2024	5.109	5.109	0.000	0.000	0.000	0.000	0.000	---
Jul, 2024	4.772	4.772	0.000	0.000	0.000	0.000	0.000	---
Aug, 2024	5.993	5.993	0.000	0.000	0.000	0.000	0.000	---
Sep, 2024	4.633	4.633	4.363	4.363	0.000	0.000	0.000	---
Oct, 2024	6.327	6.327	23.827	23.827	0.000	0.000	0.000	---
Nov, 2024	4.601	4.601	20.445	20.445	0.000	0.000	0.000	---
Dec, 2024	2.605	2.608	23.415	23.415	0.000	0.000	0.000	---
Jan, 2025	2.221	2.218	25.795	25.795	0.000	0.000	0.000	---
Feb, 2025	2.561	2.561	18.584	18.584	0.000	0.000	0.000	---
Mar, 2025	0.560	0.560	-313.022	-313.022	0.000	0.000	0.000	---
Total (MG)	47.263	47.263	-179.939	-179.945	0.000	0.000	0.000	0.000
Highest	6.327	6.327	25.795	25.795	0.000	0.000	0.000	---
Average	3.939	3.939	-14.995	-14.995	0.000	0.000	0.000	0.000
Lowest	0.560	0.560	-313.022	-313.022	0.000	0.000	0.000	---

Combined Water Production


5 Year Average Daily Production

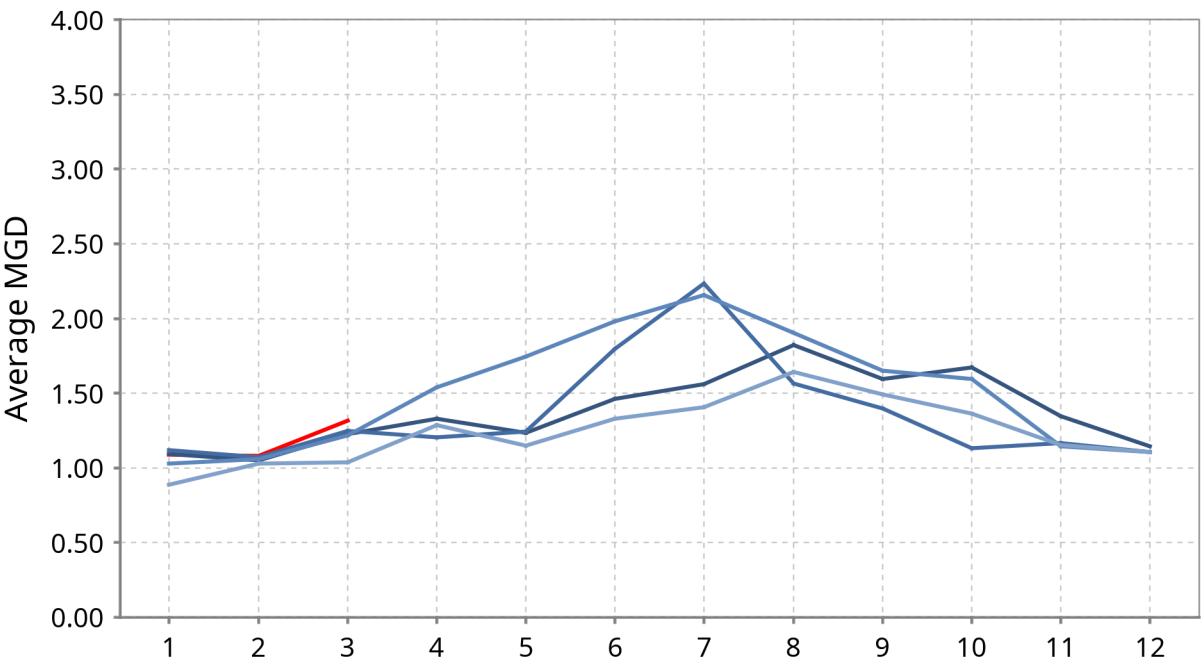

Month	Year - 4	Year - 3	Year - 2	Last Year	This Year
Jan	0.888	1.027	1.118	1.092	1.090
Feb	1.030	1.059	1.073	1.052	1.082
Mar	1.039	1.217	1.246	1.226	1.315
Apr	1.285	1.541	1.205	1.331	---
May	1.149	1.744	1.243	1.233	---
Jun	1.330	1.982	1.796	1.461	---
Jul	1.407	2.158	2.233	1.559	---
Aug	1.642	1.905	1.563	1.823	---
Sep	1.492	1.652	1.400	1.595	---
Oct	1.365	1.594	1.133	1.674	---
Nov	1.153	1.144	1.166	1.345	---
Dec	1.105	1.108	1.107	1.145	---
Highest	1.642	2.158	2.233	1.823	1.315
Average	1.240	1.511	1.357	1.378	1.162
Lowest	0.888	1.027	1.073	1.052	1.082

Waste Water Treatment

5 Year Average Daily Treated

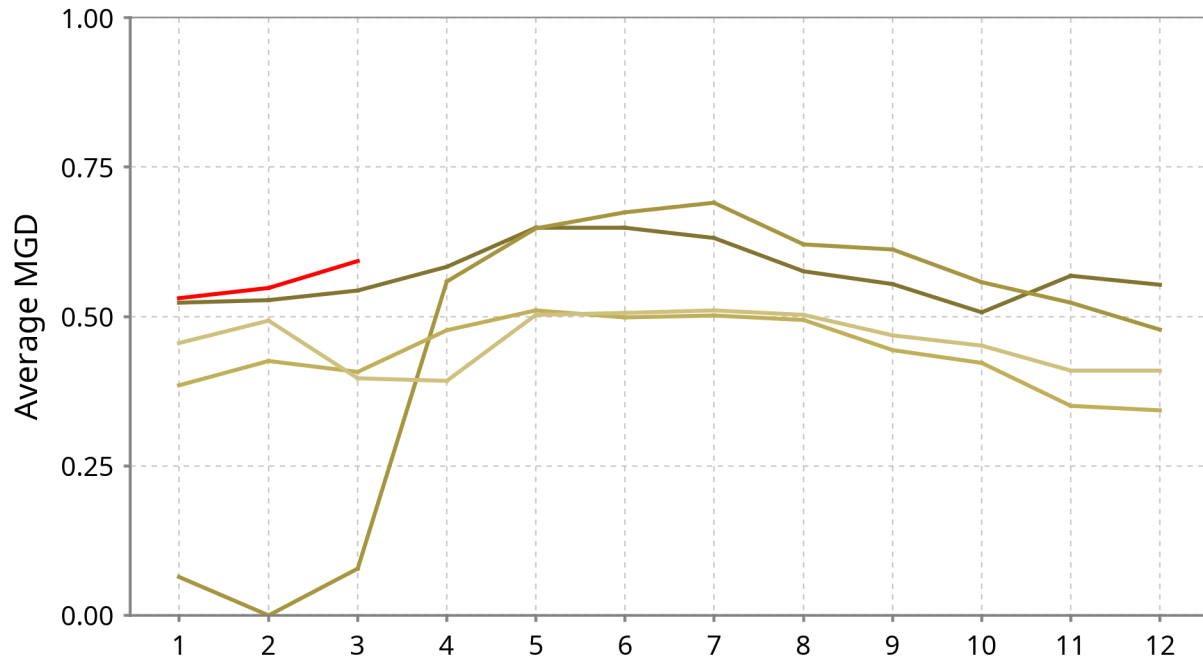

Month	Year - 4	Year - 3	Year - 2	Last Year	This Year
Jan	0.456	0.385	0.064	0.523	0.530
Feb	0.493	0.425	0.000	0.528	0.548
Mar	0.396	0.407	0.078	0.543	0.593
Apr	0.392	0.477	0.559	0.583	---
May	0.503	0.511	0.648	0.649	---
Jun	0.506	0.499	0.675	0.648	---
Jul	0.510	0.502	0.690	0.631	---
Aug	0.503	0.494	0.620	0.576	---
Sep	0.469	0.443	0.612	0.554	---
Oct	0.451	0.422	0.557	0.507	---
Nov	0.409	0.351	0.523	0.568	---
Dec	0.410	0.343	0.478	0.554	---

Highest	0.510	0.511	0.690	0.649	0.593
Average	0.458	0.438	0.459	0.572	0.557
Lowest	0.392	0.343	0.000	0.507	0.530

City of Lago Vista Monthly Water Accounting Report



For the Month of: **February**

Year: **2025**

WATER PRODUCED (GAL)

1 Water Produced **TOTAL PRODUCED: 30,290,000**

WATER SOLD (GAL)

2	Residential	19,764,500	
3	Commercial	2,167,800	
4	City Irrigation	728,000	
5	Fire Hydrant Meters	541,000	
6	City Meters (Y & Z routes)	188,400	
7	Other Sales (explain): 2nd meter	72,000	
8	TOTAL WATER SOLD:	23,461,700	77.46%

BREAKDOWN OF UNBILLED WATER USAGE (GAL)

9	Water Treatment Plant #1: Process Loss	760,000	
10	Water Treatment Plant # 3: Process Loss & Backwash	291,000	
11	Wastewater Treatment Plant:	556,200	
12	System Flushing	5,000	
13	Fire Department Usage:	50,000	
14	Other Usage (explain): off, not charged	1,793,400	
15	lines 9-14 TOTAL UNBILLED WATER USAGE	3,455,600	

BREAKDOWN OF KNOWN WATER LOST (GAL)

16	Tank Overflows/Drainage	40,000	
17	Excavation Breaks	0	
18	Water Line Breaks	165,000	
19	lines 16-18 TOTAL KNOWN WATER LOST	205,000	

TOTAL UNACCOUNTED WATER LOSS (GAL)

20 **TOTAL UNACCOUNTED WATER: 3,167,700 10.46%**



Work Management Requests

Lago Vista

Date Range: 3/1/2025 - 3/31/2025

Start Date	End Date	Status	Request ID	Type	Sub Type	Assigned To
3/31/2025 12:00 AM	3/31/2025 12:00 AM	In Progress	TRUCK 7015 (DRIVERS SIDE TAIL LIGHT OUT)	Utilities	Other	Joel Peer
3/28/2025 12:00 AM	3/28/2025 12:00 AM	Complete	(WATER LEAK FH) 5004 THUNDERBIRD ST	Utilities	Water Leak	Jamie Nichols
3/27/2025 12:00 AM	3/31/2025 12:00 AM	Complete	(WATER MAIN EXTENSION) 2801 WILSON AVE	Utilities	Other	Luis Mendoza
3/27/2025 12:00 AM	3/27/2025 12:00 AM	Complete	6006 (check engine light on)	Utilities		Joel Peer
3/26/2025 12:00 AM	3/27/2025 12:00 AM	Complete	(SEWER SERVICE INSTALL) 2801 WILSON AVE	Utilities	Other	Luis Mendoza
3/26/2025 12:00 AM	3/27/2025 12:00 AM	Complete	(SEWER SERVICE INSTALL) 2401 NEWTON DR	Utilities	Other	Luis Mendoza
3/25/2025 12:00 AM	3/26/2025 12:00 AM	Complete	(WATER SERVICE INSTALL) 8405 BAR K RANCH RD	Utilities	Other	Steve Castro
3/25/2025 12:00 AM	3/25/2025 12:00 AM	Complete	(METER SET) 21415 HIGHLAND LAKES DR	Utilities	Other	Jamie Nichols
3/24/2025 12:00 AM	3/25/2025 12:00 AM	Received	FH Replacement: Round Up	Utilities	FH Issue/Replacement	Luis Mendoza
3/24/2025 12:00 AM	3/25/2025 12:00 AM	In Progress	TRUCK 7019 [FRONT END ISSUE (GRINDING NOISE)]	Utilities	Other	Joel Peer
3/24/2025 12:00 AM	3/25/2025 12:00 AM	Received	(FH Replacement) Buena Vista	Utilities	FH Issue/Replacement	Steve Castro
3/24/2025 12:00 AM	3/25/2025 12:00 AM	Complete	(WATER SERVICE INSTALL) 21415 HIGHLAND LAKE DR	Utilities	Other	Steve Castro
3/20/2025 12:00 AM	3/20/2025 12:00 AM	Complete	(CURB STOP REPLACEMENT) 7301/7303 CROSSBOW TRL	Utilities	Other	Jamie Nichols
3/19/2025 12:00 AM	3/20/2025 12:00 AM	Complete	(CURB STOP REPLACEMENT) 4508 RIMROCK DR	Utilities	Other	Jamie Nichols
3/19/2025 12:00 AM	3/20/2025 12:00 AM	Complete	(WATER LEAK) 2901 WILSON AVE	Utilities	Water Leak	Luis Mendoza

Start Date	End Date	Status	Request ID	Type	Sub Type	Assigned To
3/19/2025 12:00 AM	3/19/2025 12:00 AM	Complete	TRUCK 6005 (CHECK FRONT END INTERMITTENT WOBBLE AND OIL CHANGE)	Utilities	Other	Joel Peer
3/19/2025 12:00 AM	3/20/2025 12:00 AM	Complete	(SEWER ISSUE) 21403 HIGH DR	Utilities	Other	Steve Castro
3/19/2025 12:00 AM	3/20/2025 12:00 AM	Complete	(CURB STOP REPLACEMENT) 4506 RIMROCK DR	Utilities	Other	Jamie Nichols
3/18/2025 12:00 AM	3/18/2025 12:00 AM	In Progress	(SEWER ISSUE) 8207 PURPLE ASTER PASS	Utilities	Other	Luis Mendoza
3/18/2025 12:00 AM	3/18/2025 12:00 AM	Complete	(SEWER ISSUE) 3422 CONGRESS AVE	Utilities	Other	Steve Castro
3/17/2025 12:00 AM	3/20/2025 12:00 AM	In Progress	FORCE MAIN PROJECT (FINAL) 3/17/2025 - 3/20/2025	Utilities	Other	Luis Mendoza
3/17/2025 12:00 AM	3/17/2025 12:00 AM	Complete	20703 DEEP CREEK (6X6 TEE AND FH ISO VALVE INSTALLATION)	Utilities	Other	Steve Castro
3/12/2025 12:00 AM	3/12/2025 12:00 AM	Complete	TRUCK 6006 (DOOR ISSUE)	Utilities	Other	Joel Peer
3/11/2025 12:00 AM	3/11/2025 12:00 AM	Complete	TRUCK 6019 (TIRE AND TPMS ISSUE)	Utilities	Other	Joel Peer
3/11/2025 12:00 AM	3/11/2025 12:00 AM	Complete	(METER SET) 2604 WILSON AVE	Utilities	Other	Jamie Nichols
3/4/2025 12:00 AM	3/4/2025 12:00 AM	Complete	TRUCK 6019 (PULLEY MAYBE GOING OUT)	Utilities	Other	Joel Peer
3/4/2025 12:00 AM	3/4/2025 12:00 AM	Complete	TRUCK 6006 (NEEDS OIL CHANGE)	Utilities	Other	Joel Peer
3/3/2025 12:00 AM	3/4/2025 12:00 AM	Received	(FH Replacement) Patriot	Utilities	FH Issue/Replacement	Steve Castro
3/3/2025 12:00 AM	3/3/2025 12:00 AM	Pending	(Manhole Replacement) Santa Carlo Ave	Utilities	Other	Luis Mendoza
3/3/2025 12:00 AM	3/6/2025 12:00 AM	Complete	FORCE MAIN PROJECT 3/3/2025 - 3/6/2025	Utilities	Other	Luis Mendoza
				Total	30	



Fleet Events By Date Range

Lago Vista

Date Range:

3/1/2025 - 3/31/2025

Date: 3/5/2025

Status: Complete

Assigned To: Carl Sanders

Event ID: case 580 utilities

Event Type: Other

Work Order ID:

Feature ID: Case Backhoe 580 Super
N

Feature Class: Fleet Unit

Fee:

Note: upper hydraulic hose on the bucket arm was leaking. removed and replaced with a new hose.

Date: 3/24/2025

Status: Complete

Assigned To: Joel Peer

Event ID: 6713

Event Type: Maintenance

Work Order ID:

Feature ID: Chevy 2500 Pickup

Feature Class: Fleet Unit

Fee:

Note: oil and filter change, filters checked, passanger side low beam head light replaced.

Date: 3/4/2025

Status: Complete

Assigned To: Joel Peer

Event ID: 3011

Event Type: Maintenance

Work Order ID:

Feature ID: Ford F250 4x4 Crew Cab **Feature Class:** Fleet Unit

Fee:

Note: oil and filter changed, fluids topped off.

Date: 3/25/2025

Status: Complete

Assigned To: Joel Peer

Event ID: E6001

Event Type: Maintenance

Work Order ID:

Feature ID: Case Backhoe 580 Super
N

Feature Class: Fleet Unit

Fee:

Note: (2) two new front tires replaced, kept the best tire as a spare W/O rim

Total

4