

# **Public Works April Monthly Report by Department**

**Ernesto Rios**

**Assistant/Interim PW Director**

# Plants Department

# CITY OF LAGO VISTA WATER & WASTEWATER REPORT

April 2025



## Water Production

| This Month    |           | Total Production - 42.815 MG |            |             |             |            |
|---------------|-----------|------------------------------|------------|-------------|-------------|------------|
|               | Raw Water | Production                   | Efficiency | Highest Day | Average Day | Lowest Day |
| Water Plant 1 | 11.366 MG | 10.450 MG                    | 91.9%      | 0.558 MG    | 0.348 MG    | 0.193 MG   |
| Water Plant 2 | 0.000 MG  | 0.000 MG                     | ∞%         | --- MG      | 0.000 MG    | --- MG     |
| Water Plant 3 | 32.828 MG | 32.365 MG                    | 98.6%      | 1.338 MG    | 1.079 MG    | 0.868 MG   |
| Combined      | 44.195 MG | 42.815 MG                    | 96.9%      | 1.779 MG    | 1.427 MG    | 1.185 MG   |

| Past 12 Months |            | Total Production - 510.174 MG |            |             |             |            |
|----------------|------------|-------------------------------|------------|-------------|-------------|------------|
|                | Raw Water  | Production                    | Efficiency | Highest Day | Average Day | Lowest Day |
| Water Plant 1  | 191.881 MG | 178.822 MG                    | 93.2%      | 0.845 MG    | 0.490 MG    | 0.091 MG   |
| Water Plant 2  | 0.000 MG   | 0.000 MG                      | ∞%         | --- MG      | 0.000 MG    | --- MG     |
| Water Plant 3  | 335.491 MG | 331.352 MG                    | 98.8%      | 1.455 MG    | 0.908 MG    | 0.566 MG   |
| Combined       | 527.372 MG | 510.174 MG                    | 96.7%      | 2.200 MG    | 1.398 MG    | 0.888 MG   |

## Waste Water Treatment

| This Month                  |           | Total Treated - 18.953 MG |             |            |
|-----------------------------|-----------|---------------------------|-------------|------------|
|                             | Treated   | Highest Day               | Average Day | Lowest Day |
| Waste Water Treatment Plant | 18.953 MG | 0.710 MG                  | 0.632 MG    | 0.520 MG   |

| Past 12 Months              |            | Total Treated - 212.633 MG |             |            |
|-----------------------------|------------|----------------------------|-------------|------------|
|                             | Treated    | Highest Day                | Average Day | Lowest Day |
| Waste Water Treatment Plant | 212.633 MG | 0.820 MG                   | 0.583 MG    | 0.440 MG   |

## Effluent Disposal

| This Month                     |           | WWTP Plant Permit Total - 18.952 MG |             |            |
|--------------------------------|-----------|-------------------------------------|-------------|------------|
|                                | Total     | Highest Day                         | Average Day | Lowest Day |
| Lago Vista Golf Course Permit  | 1.552 MG  | 0.132 MG                            | 0.052 MG    | 0.010 MG   |
| Cedar Breaks Permit            | 21.261 MG | 0.934 MG                            | 0.709 MG    | 0.037 MG   |
| WWTP Plant Permit Total        | 18.952 MG | 0.710 MG                            | 0.632 MG    | 0.520 MG   |
| Reclaimed Effluent 210A Permit | 0.000 MG  | 0.000 MG                            | 0.000 MG    | 0.000 MG   |


  

| Past 12 Months                 |            | WWTP Plant Permit Total - 212.633 MG |             |            |
|--------------------------------|------------|--------------------------------------|-------------|------------|
|                                | Total      | Highest Day                          | Average Day | Lowest Day |
| Lago Vista Golf Course Permit  | 45.327 MG  | 2.892 MG                             | 0.124 MG    | 0.000 MG   |
| Cedar Breaks Permit            | 164.760 MG | 1.706 MG                             | 0.451 MG    | 0.000 MG   |
| WWTP Plant Permit Total        | 212.633 MG | 0.820 MG                             | 0.583 MG    | 0.440 MG   |
| Reclaimed Effluent 210A Permit | 0.000 MG   | 0.000 MG                             | 0.000 MG    | 0.000 MG   |

April 2025

## Combined Water Production

This Month

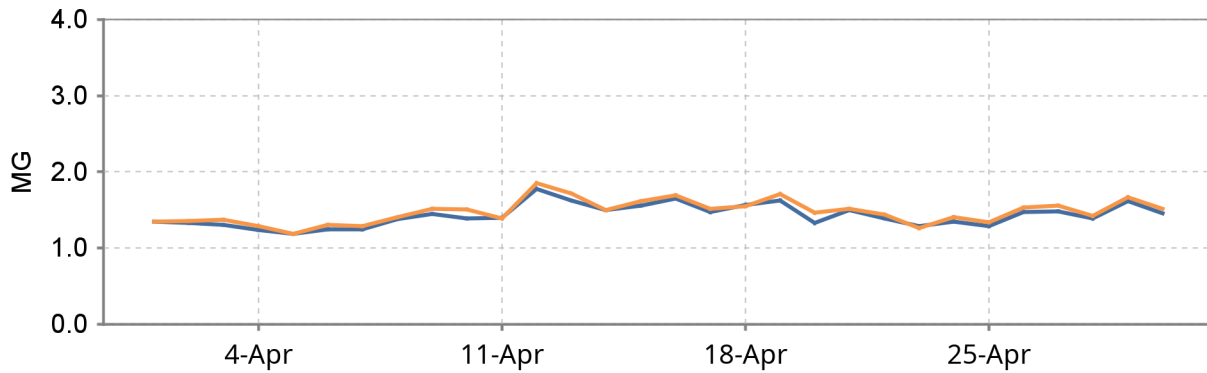


| Date       | WP1 Raw | WP2 Raw | WP3 Raw | Combined Raw | WP1 Finished | WP2 Finished | WP3 Finished | Combined Finished |
|------------|---------|---------|---------|--------------|--------------|--------------|--------------|-------------------|
| 04/01/25   | 0.416   | ---     | 0.930   | 1.346        | 0.368        | ---          | 0.978        | 1.347             |
| 04/02/25   | 0.426   | ---     | 0.930   | 1.356        | 0.406        | ---          | 0.920        | 1.326             |
| 04/03/25   | 0.405   | ---     | 0.962   | 1.367        | 0.385        | ---          | 0.915        | 1.300             |
| 04/04/25   | 0.394   | ---     | 0.888   | 1.282        | 0.348        | ---          | 0.884        | 1.232             |
| 04/05/25   | 0.332   | ---     | 0.855   | 1.187        | 0.317        | ---          | 0.868        | 1.185             |
| 04/06/25   | 0.374   | ---     | 0.934   | 1.307        | 0.358        | ---          | 0.889        | 1.247             |
| 04/07/25   | 0.363   | ---     | 0.921   | 1.284        | 0.337        | ---          | 0.905        | 1.242             |
| 04/08/25   | 0.466   | ---     | 0.936   | 1.402        | 0.418        | ---          | 0.962        | 1.380             |
| 04/09/25   | 0.474   | ---     | 1.041   | 1.515        | 0.451        | ---          | 0.997        | 1.448             |
| 04/10/25   | 0.446   | ---     | 1.062   | 1.509        | 0.399        | ---          | 0.988        | 1.387             |
| 04/11/25   | 0.447   | ---     | 0.937   | 1.384        | 0.417        | ---          | 0.982        | 1.399             |
| 04/12/25   | 0.581   | ---     | 1.275   | 1.855        | 0.558        | ---          | 1.221        | 1.779             |
| 04/13/25   | 0.551   | ---     | 1.164   | 1.715        | 0.478        | ---          | 1.141        | 1.620             |
| 04/14/25   | 0.488   | ---     | 1.012   | 1.500        | 0.470        | ---          | 1.028        | 1.498             |
| 04/15/25   | 0.561   | ---     | 1.053   | 1.615        | 0.511        | ---          | 1.044        | 1.555             |
| 04/16/25   | 0.363   | ---     | 1.327   | 1.691        | 0.340        | ---          | 1.312        | 1.652             |
| 04/17/25   | 0.312   | ---     | 1.205   | 1.517        | 0.297        | ---          | 1.178        | 1.475             |
| 04/18/25   | 0.270   | ---     | 1.276   | 1.545        | 0.255        | ---          | 1.306        | 1.561             |
| 04/19/25   | 0.311   | ---     | 1.397   | 1.707        | 0.287        | ---          | 1.338        | 1.626             |
| 04/20/25   | 0.281   | ---     | 1.187   | 1.467        | 0.224        | ---          | 1.100        | 1.325             |
| 04/21/25   | 0.333   | ---     | 1.180   | 1.513        | 0.307        | ---          | 1.192        | 1.499             |
| 04/22/25   | 0.270   | ---     | 1.171   | 1.441        | 0.256        | ---          | 1.134        | 1.390             |
| 04/23/25   | 0.218   | ---     | 1.047   | 1.265        | 0.201        | ---          | 1.089        | 1.290             |
| 04/24/25   | 0.280   | ---     | 1.121   | 1.401        | 0.265        | ---          | 1.084        | 1.349             |
| 04/25/25   | 0.228   | ---     | 1.108   | 1.336        | 0.193        | ---          | 1.092        | 1.284             |
| 04/26/25   | 0.384   | ---     | 1.150   | 1.534        | 0.349        | ---          | 1.127        | 1.475             |
| 04/27/25   | 0.342   | ---     | 1.212   | 1.554        | 0.305        | ---          | 1.172        | 1.477             |
| 04/28/25   | 0.322   | ---     | 1.100   | 1.422        | 0.307        | ---          | 1.084        | 1.391             |
| 04/29/25   | 0.363   | ---     | 1.300   | 1.663        | 0.339        | ---          | 1.279        | 1.618             |
| 04/30/25   | 0.364   | ---     | 1.148   | 1.512        | 0.306        | ---          | 1.154        | 1.459             |
| Total (MG) | 11.366  | 0.000   | 32.828  | 44.195       | 10.450       | 0.000        | 32.365       | 42.815            |
| Highest    | 0.581   | ---     | 1.397   | 1.855        | 0.558        | ---          | 1.338        | 1.779             |
| Average    | 0.379   | 0.000   | 1.094   | 1.473        | 0.348        | 0.000        | 1.079        | 1.427             |
| Lowest     | 0.218   | ---     | 0.855   | 1.187        | 0.193        | ---          | 0.868        | 1.185             |

April 2025

## Water Plant 1 Water Production


This Month

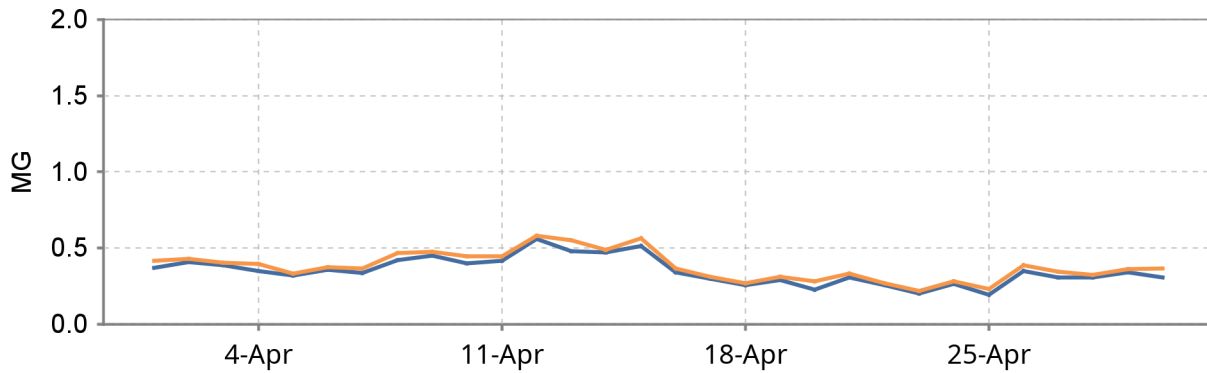

| Date       | WP1 Raw | WP1 Clarifier A | WP1 Clarifier B | WP1 Finished | WP1 Process Loss | WP1 Efficiency |
|------------|---------|-----------------|-----------------|--------------|------------------|----------------|
| 04/01/25   | 0.416   | 0.000           | 0.416           | 0.368        | 0.048            | 89%            |
| 04/02/25   | 0.426   | 0.000           | 0.426           | 0.406        | 0.020            | 95%            |
| 04/03/25   | 0.405   | 0.000           | 0.405           | 0.385        | 0.020            | 95%            |
| 04/04/25   | 0.394   | 0.000           | 0.394           | 0.348        | 0.047            | 88%            |
| 04/05/25   | 0.332   | 0.000           | 0.332           | 0.317        | 0.015            | 96%            |
| 04/06/25   | 0.374   | 0.000           | 0.374           | 0.358        | 0.016            | 96%            |
| 04/07/25   | 0.363   | 0.000           | 0.363           | 0.337        | 0.026            | 93%            |
| 04/08/25   | 0.466   | 0.000           | 0.466           | 0.418        | 0.049            | 90%            |
| 04/09/25   | 0.474   | 0.000           | 0.474           | 0.451        | 0.023            | 95%            |
| 04/10/25   | 0.446   | 0.000           | 0.446           | 0.399        | 0.047            | 89%            |
| 04/11/25   | 0.447   | 0.000           | 0.447           | 0.417        | 0.030            | 93%            |
| 04/12/25   | 0.581   | 0.000           | 0.581           | 0.558        | 0.023            | 96%            |
| 04/13/25   | 0.551   | 0.000           | 0.551           | 0.478        | 0.072            | 87%            |
| 04/14/25   | 0.488   | 0.000           | 0.488           | 0.470        | 0.018            | 96%            |
| 04/15/25   | 0.561   | 0.000           | 0.561           | 0.511        | 0.050            | 91%            |
| 04/16/25   | 0.363   | 0.000           | 0.363           | 0.340        | 0.023            | 94%            |
| 04/17/25   | 0.312   | 0.000           | 0.312           | 0.297        | 0.015            | 95%            |
| 04/18/25   | 0.270   | 0.000           | 0.270           | 0.255        | 0.015            | 94%            |
| 04/19/25   | 0.311   | 0.000           | 0.311           | 0.287        | 0.023            | 93%            |
| 04/20/25   | 0.281   | 0.000           | 0.281           | 0.224        | 0.057            | 80%            |
| 04/21/25   | 0.333   | 0.000           | 0.333           | 0.307        | 0.026            | 92%            |
| 04/22/25   | 0.270   | 0.000           | 0.270           | 0.256        | 0.014            | 95%            |
| 04/23/25   | 0.218   | 0.000           | 0.218           | 0.201        | 0.017            | 92%            |
| 04/24/25   | 0.280   | 0.000           | 0.280           | 0.265        | 0.015            | 95%            |
| 04/25/25   | 0.228   | 0.000           | 0.228           | 0.193        | 0.035            | 85%            |
| 04/26/25   | 0.384   | 0.000           | 0.384           | 0.349        | 0.035            | 91%            |
| 04/27/25   | 0.342   | 0.000           | 0.342           | 0.305        | 0.037            | 89%            |
| 04/28/25   | 0.322   | 0.000           | 0.322           | 0.307        | 0.015            | 95%            |
| 04/29/25   | 0.363   | 0.000           | 0.363           | 0.339        | 0.024            | 93%            |
| 04/30/25   | 0.364   | 0.000           | 0.364           | 0.306        | 0.058            | 84%            |
| Total (MG) | 11.366  | 0.000           | 11.366          | 10.450       | 0.916            | -              |
| Highest    | 0.581   | 0.000           | 0.581           | 0.558        | -                | -              |
| Average    | 0.379   | 0.000           | 0.379           | 0.348        | -                | 92%            |
| Lowest     | 0.218   | 0.000           | 0.218           | 0.193        | -                | -              |

Water Plant 2 Water Production

This Month

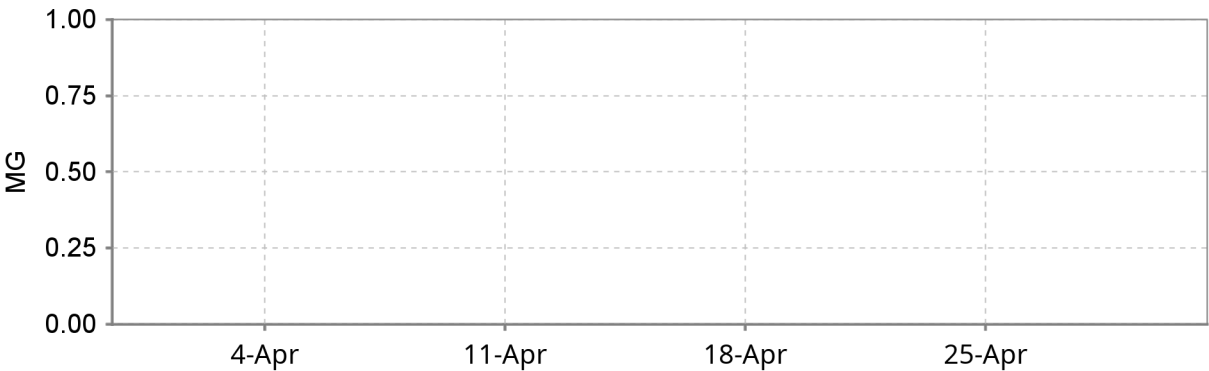


| Date       | WP2 Raw | To Lohmans | To Golfball | From Golfball | WP2 Finished | WP2 Process Loss | WP2 Efficiency |
|------------|---------|------------|-------------|---------------|--------------|------------------|----------------|
| 04/01/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/02/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/03/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/04/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/05/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/06/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/07/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/08/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/09/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/10/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/11/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/12/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/13/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/14/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/15/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/16/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/17/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/18/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/19/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/20/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/21/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/22/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/23/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/24/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/25/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/26/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/27/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/28/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/29/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| 04/30/25   | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Total (MG) | 0.000   | 0.000      | 0.000       | 0.000         | 0.000        | 0.000            | -              |
| Highest    | ---     | ---        | ---         | ---           | ---          | -                | -              |
| Average    | 0.000   | 0.000      | 0.000       | 0.000         | 0.000        | -                | ∞%             |
| Lowest     | ---     | ---        | ---         | ---           | ---          | -                | -              |

April 2025

## Water Plant 3 Water Production

This Month

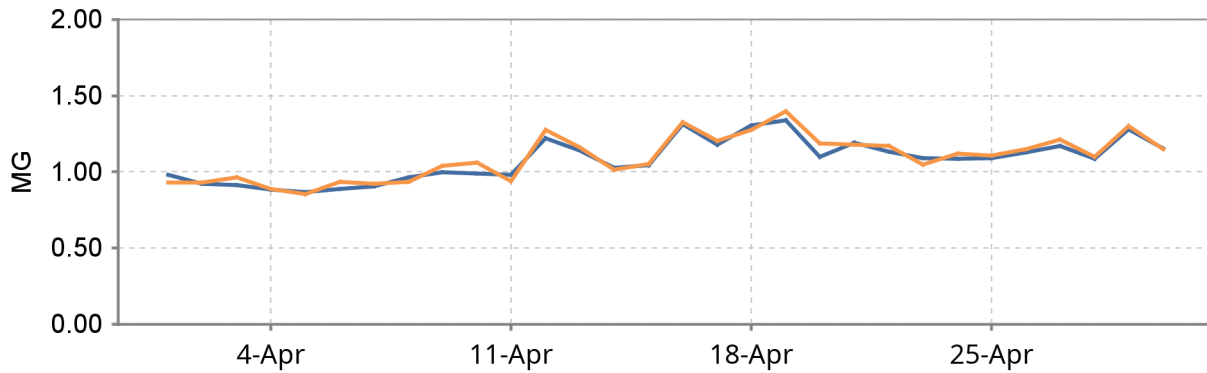


| Date       | WP3 Raw | WP3 Unit 1 | WP3 Decant | WP3 Backwash | WP3 Finished | WP3 Process Loss | WP3 Efficiency |
|------------|---------|------------|------------|--------------|--------------|------------------|----------------|
| 04/01/25   | 0.930   | 0.967      | 0.000      | 0.005        | 0.978        | -0.048           | 105%           |
| 04/02/25   | 0.930   | 0.926      | 0.000      | 0.000        | 0.920        | 0.010            | 99%            |
| 04/03/25   | 0.962   | 1.022      | 0.000      | 0.048        | 0.915        | 0.047            | 95%            |
| 04/04/25   | 0.888   | 0.872      | 0.000      | 0.007        | 0.884        | 0.004            | 100%           |
| 04/05/25   | 0.855   | 0.857      | 0.000      | 0.000        | 0.868        | -0.013           | 101%           |
| 04/06/25   | 0.934   | 0.996      | 0.000      | 0.053        | 0.889        | 0.044            | 95%            |
| 04/07/25   | 0.921   | 0.893      | 0.000      | 0.004        | 0.905        | 0.016            | 98%            |
| 04/08/25   | 0.936   | 0.988      | 0.000      | 0.052        | 0.962        | -0.026           | 103%           |
| 04/09/25   | 1.041   | 1.029      | 0.000      | 0.005        | 0.997        | 0.044            | 96%            |
| 04/10/25   | 1.062   | 1.072      | 0.000      | 0.048        | 0.988        | 0.075            | 93%            |
| 04/11/25   | 0.937   | 0.980      | 0.000      | 0.009        | 0.982        | -0.045           | 105%           |
| 04/12/25   | 1.275   | 1.263      | 0.000      | 0.000        | 1.221        | 0.054            | 96%            |
| 04/13/25   | 1.164   | 1.220      | 0.000      | 0.048        | 1.141        | 0.023            | 98%            |
| 04/14/25   | 1.012   | 0.996      | 0.000      | 0.008        | 1.028        | -0.016           | 102%           |
| 04/15/25   | 1.053   | 1.113      | 0.000      | 0.050        | 1.044        | 0.009            | 99%            |
| 04/16/25   | 1.327   | 1.327      | 0.000      | 0.006        | 1.312        | 0.015            | 99%            |
| 04/17/25   | 1.205   | 1.263      | 0.000      | 0.055        | 1.178        | 0.027            | 98%            |
| 04/18/25   | 1.276   | 1.282      | 0.000      | 0.002        | 1.306        | -0.031           | 102%           |
| 04/19/25   | 1.397   | 1.436      | 0.000      | 0.053        | 1.338        | 0.059            | 96%            |
| 04/20/25   | 1.187   | 1.206      | 0.000      | 0.054        | 1.100        | 0.086            | 93%            |
| 04/21/25   | 1.180   | 1.224      | 0.000      | 0.010        | 1.192        | -0.012           | 101%           |
| 04/22/25   | 1.171   | 1.152      | 0.000      | 0.009        | 1.134        | 0.037            | 97%            |
| 04/23/25   | 1.047   | 1.068      | 0.000      | 0.000        | 1.089        | -0.042           | 104%           |
| 04/24/25   | 1.121   | 1.164      | 0.000      | 0.048        | 1.084        | 0.037            | 97%            |
| 04/25/25   | 1.108   | 1.094      | 0.000      | 0.008        | 1.092        | 0.017            | 98%            |
| 04/26/25   | 1.150   | 1.201      | 0.000      | 0.048        | 1.127        | 0.023            | 98%            |
| 04/27/25   | 1.212   | 1.256      | 0.000      | 0.053        | 1.172        | 0.039            | 97%            |
| 04/28/25   | 1.100   | 1.094      | 0.000      | 0.006        | 1.084        | 0.016            | 99%            |
| 04/29/25   | 1.300   | 1.358      | 0.000      | 0.048        | 1.279        | 0.021            | 98%            |
| 04/30/25   | 1.148   | 1.136      | 0.000      | 0.002        | 1.154        | -0.006           | 100%           |
| Total (MG) | 32.828  | 33.456     | 0.000      | 0.740        | 32.365       | 0.463            | -              |
| Highest    | 1.397   | 1.436      | 0.000      | 0.055        | 1.338        | -                | -              |
| Average    | 1.094   | 1.115      | 0.000      | 0.025        | 1.079        | -                | 99%            |
| Lowest     | 0.855   | 0.857      | 0.000      | 0.000        | 0.868        | -                | -              |

April 2025

## Waste Water Treatment

This Month

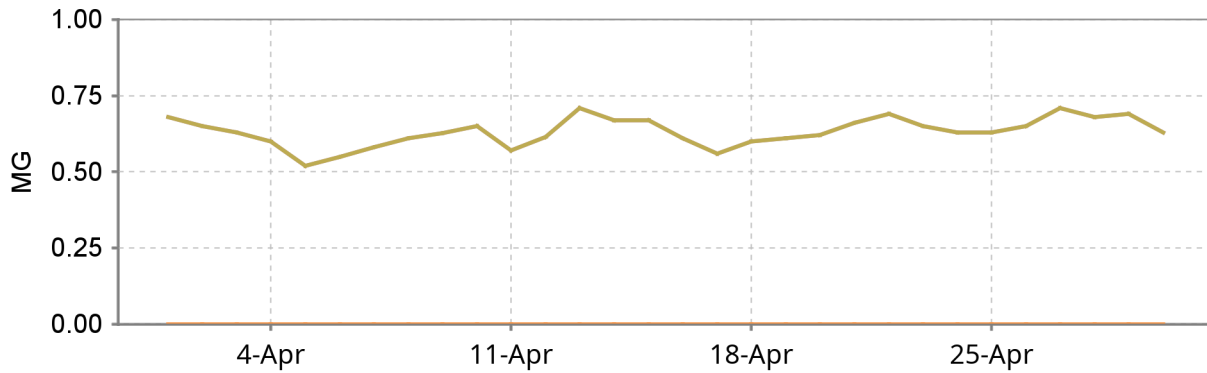


| Date       | WWTP Treated | LVGC Permit | Cedar Breaks Permit | WWTP Permit | Reclaimed Effluent 210A Permit |
|------------|--------------|-------------|---------------------|-------------|--------------------------------|
| 04/01/25   | 0.680        | 0.020       | 0.909               | 0.680       | 0.000                          |
| 04/02/25   | 0.650        | 0.062       | 0.921               | 0.650       | 0.000                          |
| 04/03/25   | 0.630        | 0.061       | 0.912               | 0.630       | 0.000                          |
| 04/04/25   | 0.600        | 0.061       | 0.899               | 0.600       | 0.000                          |
| 04/05/25   | 0.520        | 0.050       | 0.921               | 0.520       | 0.000                          |
| 04/06/25   | 0.550        | 0.041       | 0.905               | 0.550       | 0.000                          |
| 04/07/25   | 0.580        | 0.071       | 0.925               | 0.580       | 0.000                          |
| 04/08/25   | 0.610        | 0.091       | 0.934               | 0.610       | 0.000                          |
| 04/09/25   | 0.628        | 0.059       | 0.929               | 0.627       | 0.000                          |
| 04/10/25   | 0.650        | 0.101       | 0.759               | 0.650       | 0.000                          |
| 04/11/25   | 0.570        | 0.058       | 0.691               | 0.570       | 0.000                          |
| 04/12/25   | 0.615        | 0.101       | 0.671               | 0.615       | 0.000                          |
| 04/13/25   | 0.710        | 0.071       | 0.665               | 0.710       | 0.000                          |
| 04/14/25   | 0.670        | 0.132       | 0.675               | 0.670       | 0.000                          |
| 04/15/25   | 0.670        | 0.040       | 0.784               | 0.670       | 0.000                          |
| 04/16/25   | 0.610        | 0.040       | 0.297               | 0.610       | 0.000                          |
| 04/17/25   | 0.560        | 0.060       | 0.701               | 0.560       | 0.000                          |
| 04/18/25   | 0.600        | 0.071       | 0.525               | 0.600       | 0.000                          |
| 04/19/25   | 0.610        | 0.061       | 0.536               | 0.610       | 0.000                          |
| 04/20/25   | 0.620        | 0.030       | 0.392               | 0.620       | 0.000                          |
| 04/21/25   | 0.660        | 0.070       | 0.535               | 0.660       | 0.000                          |
| 04/22/25   | 0.690        | 0.020       | 0.576               | 0.690       | 0.000                          |
| 04/23/25   | 0.650        | 0.010       | 0.037               | 0.650       | 0.000                          |
| 04/24/25   | 0.630        | 0.030       | 0.814               | 0.630       | 0.000                          |
| 04/25/25   | 0.630        | 0.020       | 0.861               | 0.630       | 0.000                          |
| 04/26/25   | 0.650        | 0.020       | 0.844               | 0.650       | 0.000                          |
| 04/27/25   | 0.710        | 0.030       | 0.834               | 0.710       | 0.000                          |
| 04/28/25   | 0.680        | 0.010       | 0.662               | 0.680       | 0.000                          |
| 04/29/25   | 0.690        | 0.020       | 0.565               | 0.690       | 0.000                          |
| 04/30/25   | 0.630        | 0.040       | 0.581               | 0.630       | 0.000                          |
| Total (MG) | 18.953       | 1.552       | 21.261              | 18.952      | 0.000                          |
| Highest    | 0.710        | 0.132       | 0.934               | 0.710       | 0.000                          |
| Average    | 0.632        | 0.052       | 0.709               | 0.632       | 0.000                          |
| Lowest     | 0.520        | 0.010       | 0.037               | 0.520       | 0.000                          |



April 2025

## Effluent Disposal


This Month

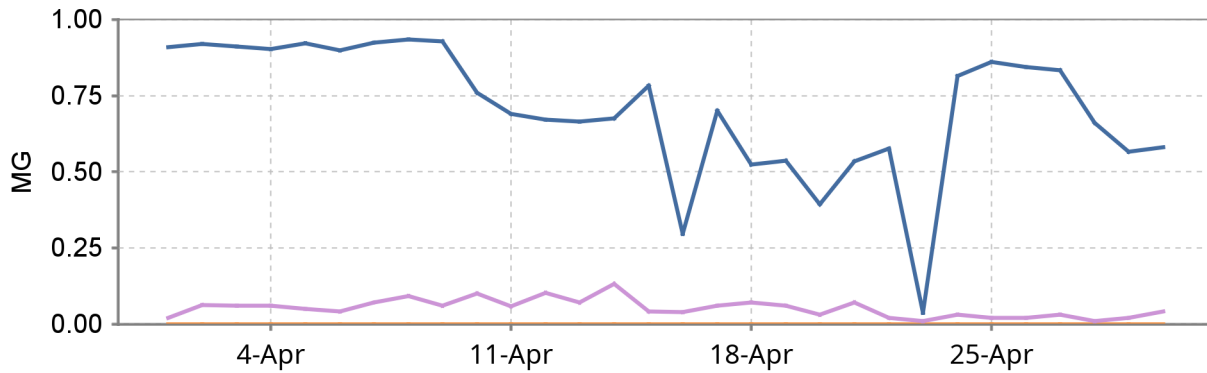

| Date       | LVGC Usage | LVGC Permit | Cedar Brks. Usage | Cedar Brks. Permit | HLGC Usage | Reclaimed E 210A Permit | LVGC Lake Water | HLGC Lake Water |
|------------|------------|-------------|-------------------|--------------------|------------|-------------------------|-----------------|-----------------|
| 04/01/25   | 0.020      | 0.020       | 0.909             | 0.909              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/02/25   | 0.062      | 0.062       | 0.921             | 0.921              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/03/25   | 0.061      | 0.061       | 0.912             | 0.912              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/04/25   | 0.061      | 0.061       | 0.903             | 0.899              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/05/25   | 0.050      | 0.050       | 0.922             | 0.921              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/06/25   | 0.041      | 0.041       | 0.900             | 0.905              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/07/25   | 0.071      | 0.071       | 0.924             | 0.925              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/08/25   | 0.091      | 0.091       | 0.935             | 0.934              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/09/25   | 0.059      | 0.059       | 0.929             | 0.929              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/10/25   | 0.101      | 0.101       | 0.759             | 0.759              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/11/25   | 0.058      | 0.058       | 0.691             | 0.691              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/12/25   | 0.101      | 0.101       | 0.671             | 0.671              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/13/25   | 0.071      | 0.071       | 0.665             | 0.665              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/14/25   | 0.132      | 0.132       | 0.675             | 0.675              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/15/25   | 0.040      | 0.040       | 0.784             | 0.784              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/16/25   | 0.040      | 0.040       | 0.297             | 0.297              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/17/25   | 0.060      | 0.060       | 0.701             | 0.701              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/18/25   | 0.071      | 0.071       | 0.525             | 0.525              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/19/25   | 0.061      | 0.061       | 0.536             | 0.536              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/20/25   | 0.030      | 0.030       | 0.392             | 0.392              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/21/25   | 0.070      | 0.070       | 0.535             | 0.535              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/22/25   | 0.020      | 0.020       | 0.576             | 0.576              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/23/25   | 0.010      | 0.010       | 0.037             | 0.037              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/24/25   | 0.030      | 0.030       | 0.814             | 0.814              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/25/25   | 0.020      | 0.020       | 0.861             | 0.861              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/26/25   | 0.020      | 0.020       | 0.844             | 0.844              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/27/25   | 0.030      | 0.030       | 0.834             | 0.834              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/28/25   | 0.010      | 0.010       | 0.662             | 0.662              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/29/25   | 0.020      | 0.020       | 0.565             | 0.565              | 0.000      | 0.000                   | 0.000           | ---             |
| 04/30/25   | 0.040      | 0.040       | 0.581             | 0.581              | 0.000      | 0.000                   | 0.000           | ---             |
| Total (MG) | 1.552      | 1.552       | 21.261            | 21.261             | 0.000      | 0.000                   | 0.000           | 0.000           |
| Highest    | 0.132      | 0.132       | 0.935             | 0.934              | 0.000      | 0.000                   | 0.000           | ---             |
| Average    | 0.052      | 0.052       | 0.709             | 0.709              | 0.000      | 0.000                   | 0.000           | 0.000           |
| Lowest     | 0.010      | 0.010       | 0.037             | 0.037              | 0.000      | 0.000                   | 0.000           | ---             |

Combined Water Production


Past 12 Months

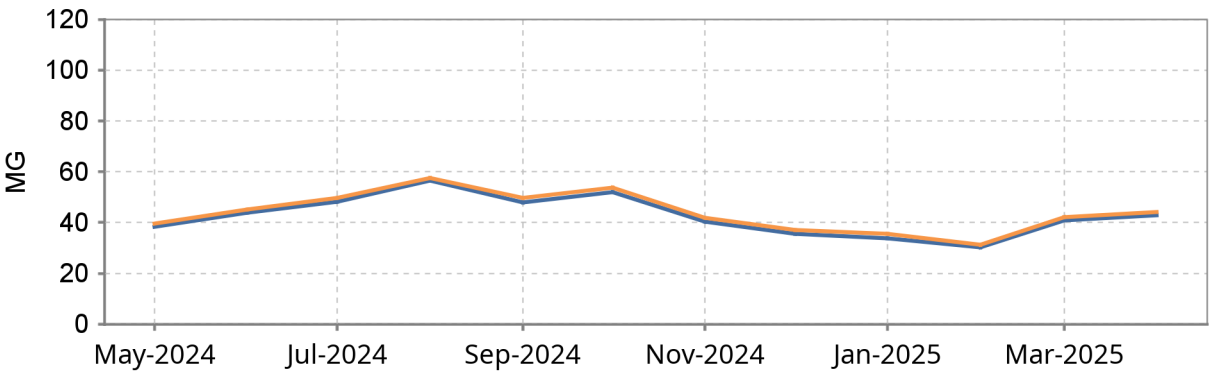

| Date       | WP1 Raw | WP2 Raw | WP3 Raw | Combined Raw | WP1 Finished | WP2 Finished | WP3 Finished | Combined Finished |
|------------|---------|---------|---------|--------------|--------------|--------------|--------------|-------------------|
| May, 2024  | 11.888  | ---     | 27.620  | 39.509       | 10.941       | ---          | 27.285       | 38.226            |
| Jun, 2024  | 17.020  | ---     | 28.194  | 45.214       | 15.963       | ---          | 27.872       | 43.835            |
| Jul, 2024  | 18.856  | ---     | 30.889  | 49.745       | 17.765       | ---          | 30.557       | 48.322            |
| Aug, 2024  | 21.790  | ---     | 35.757  | 57.547       | 21.129       | ---          | 35.392       | 56.521            |
| Sep, 2024  | 21.205  | ---     | 28.396  | 49.601       | 19.761       | ---          | 28.103       | 47.864            |
| Oct, 2024  | 23.252  | ---     | 30.507  | 53.759       | 21.669       | ---          | 30.228       | 51.897            |
| Nov, 2024  | 17.782  | ---     | 23.999  | 41.782       | 16.545       | ---          | 23.802       | 40.347            |
| Dec, 2024  | 15.482  | ---     | 21.496  | 36.978       | 14.160       | ---          | 21.328       | 35.489            |
| Jan, 2025  | 11.775  | ---     | 23.728  | 35.503       | 10.690       | ---          | 23.098       | 33.788            |
| Feb, 2025  | 8.754   | ---     | 22.587  | 31.341       | 7.994        | ---          | 22.296       | 30.290            |
| Mar, 2025  | 12.710  | ---     | 29.489  | 42.199       | 11.754       | ---          | 29.025       | 40.779            |
| Apr, 2025  | 11.366  | ---     | 32.828  | 44.194       | 10.450       | ---          | 32.365       | 42.815            |
| Total (MG) | 191.881 | 0.000   | 335.491 | 527.372      | 178.822      | 0.000        | 331.352      | 510.174           |
| Highest    | 23.252  | ---     | 35.757  | 57.547       | 21.669       | ---          | 35.392       | 56.521            |
| Average    | 15.990  | 0.000   | 27.958  | 43.948       | 14.902       | 0.000        | 27.613       | 42.514            |
| Lowest     | 8.754   | ---     | 21.496  | 31.341       | 7.994        | ---          | 21.328       | 30.290            |

Water Plant 1 Water Production


Past 12 Months

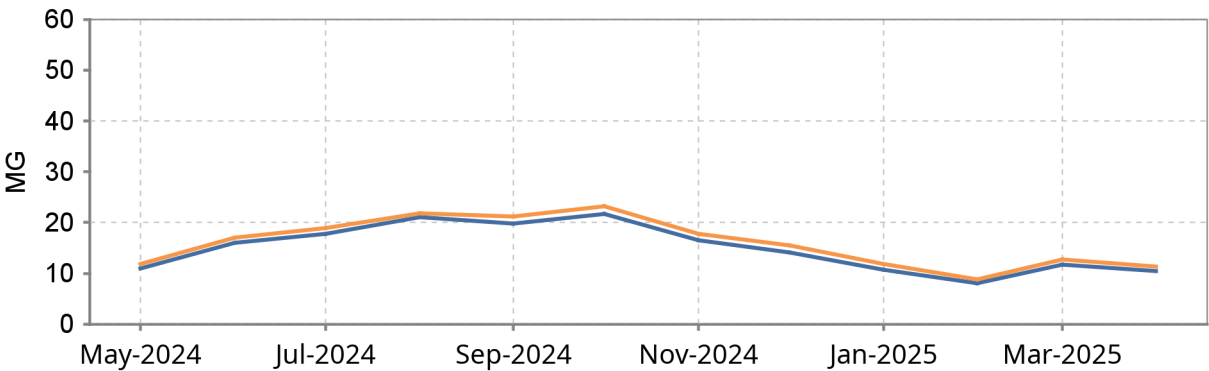

| Date       | WP1 Raw | WP1 Clarifier A | WP1 Clarifier B | WP1 Finished | WP1 Process Loss | WP1 Efficiency |
|------------|---------|-----------------|-----------------|--------------|------------------|----------------|
| May, 2024  | 11.888  | 7.086           | 4.774           | 10.941       | 0.947            | 92%            |
| Jun, 2024  | 17.020  | 10.271          | 6.757           | 15.963       | 1.057            | 94%            |
| Jul, 2024  | 18.856  | 11.355          | 7.502           | 17.765       | 1.092            | 94%            |
| Aug, 2024  | 21.790  | 11.931          | 9.852           | 21.129       | 0.660            | 97%            |
| Sep, 2024  | 21.205  | 11.803          | 9.402           | 19.761       | 1.444            | 93%            |
| Oct, 2024  | 23.252  | 13.178          | 10.071          | 21.669       | 1.583            | 93%            |
| Nov, 2024  | 17.782  | 10.107          | 7.674           | 16.545       | 1.237            | 93%            |
| Dec, 2024  | 15.482  | 8.354           | 7.137           | 14.160       | 1.322            | 91%            |
| Jan, 2025  | 11.775  | 2.509           | 9.264           | 10.690       | 1.085            | 91%            |
| Feb, 2025  | 8.754   | 0.000           | 8.753           | 7.994        | 0.760            | 91%            |
| Mar, 2025  | 12.710  | 0.001           | 12.709          | 11.754       | 0.956            | 92%            |
| Apr, 2025  | 11.366  | 0.000           | 11.366          | 10.450       | 0.916            | 92%            |
| Total (MG) | 191.881 | 86.596          | 105.261         | 178.822      | 13.059           | -              |
| Highest    | 23.252  | 13.178          | 12.709          | 21.669       | -                | -              |
| Average    | 15.990  | 7.216           | 8.772           | 14.902       | -                | 93%            |
| Lowest     | 8.754   | 0.000           | 4.774           | 7.994        | -                | -              |

Water Plant 2 Water Production


Past 12 Months

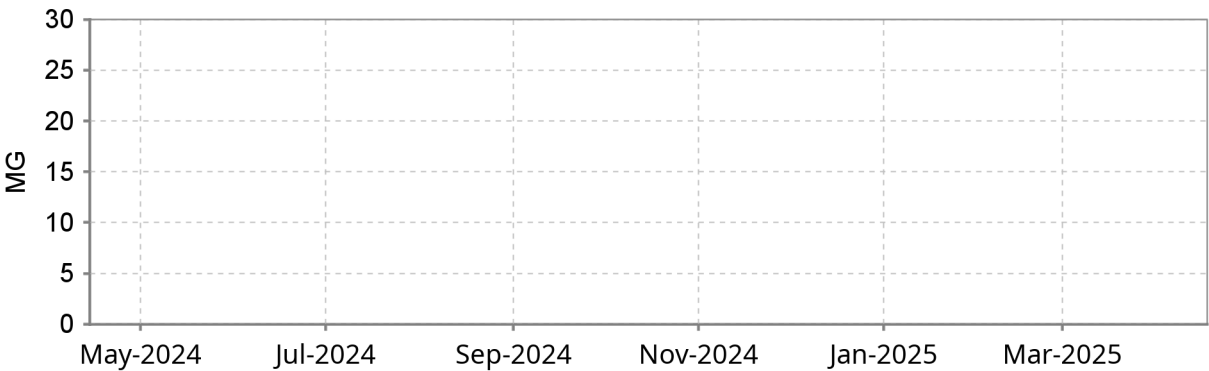

| Date       | WP2 Raw | To Lohmans | To Golfball | From Golfball | WP2 Finished | WP2 Process Loss | WP2 Efficiency |
|------------|---------|------------|-------------|---------------|--------------|------------------|----------------|
| May, 2024  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Jun, 2024  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Jul, 2024  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Aug, 2024  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Sep, 2024  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Oct, 2024  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Nov, 2024  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Dec, 2024  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Jan, 2025  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Feb, 2025  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Mar, 2025  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Apr, 2025  | ---     | ---        | ---         | ---           | ---          | ---              | ---%           |
| Total (MG) | 0.000   | 0.000      | 0.000       | 0.000         | 0.000        | 0.000            | -              |
| Highest    | ---     | ---        | ---         | ---           | ---          | -                | -              |
| Average    | 0.000   | 0.000      | 0.000       | 0.000         | 0.000        | -                | ∞%             |
| Lowest     | ---     | ---        | ---         | ---           | ---          | -                | -              |

Water Plant 3 Water Production


Past 12 Months

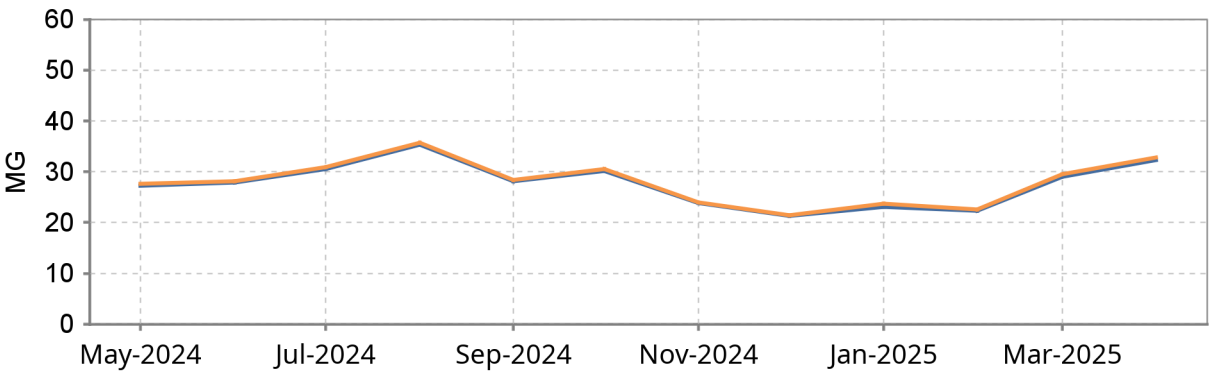

| Date       | WP3 Raw | WP3 Unit 1 | WP3 Decant | WP3 Backwash | WP3 Finished | WP3 Process Loss | WP3 Efficiency |
|------------|---------|------------|------------|--------------|--------------|------------------|----------------|
| May, 2024  | 27.620  | 28.178     | 0.000      | 0.440        | 27.285       | 0.335            | 99%            |
| Jun, 2024  | 28.194  | 28.739     | 0.000      | 0.495        | 27.872       | 0.322            | 99%            |
| Jul, 2024  | 30.889  | 31.464     | 0.000      | 0.495        | 30.557       | 0.331            | 99%            |
| Aug, 2024  | 35.757  | 36.729     | 0.000      | 0.768        | 35.392       | 0.365            | 99%            |
| Sep, 2024  | 28.396  | 29.176     | 0.000      | 0.605        | 28.103       | 0.293            | 99%            |
| Oct, 2024  | 30.507  | 31.274     | 0.000      | 0.656        | 30.228       | 0.279            | 99%            |
| Nov, 2024  | 23.999  | 24.710     | 0.000      | 0.556        | 23.802       | 0.197            | 99%            |
| Dec, 2024  | 21.496  | 22.048     | 0.000      | 0.422        | 21.328       | 0.168            | 99%            |
| Jan, 2025  | 23.728  | 24.508     | 0.000      | 0.790        | 23.098       | 0.630            | 97%            |
| Feb, 2025  | 22.587  | 23.460     | 0.000      | 0.816        | 22.296       | 0.291            | 99%            |
| Mar, 2025  | 29.489  | 30.039     | 0.000      | 0.734        | 29.025       | 0.464            | 98%            |
| Apr, 2025  | 32.828  | 33.456     | 0.000      | 0.740        | 32.365       | 0.463            | 99%            |
| Total (MG) | 335.491 | 343.782    | 0.000      | 7.517        | 331.352      | 4.139            | -              |
| Highest    | 35.757  | 36.729     | 0.000      | 0.816        | 35.392       | -                | -              |
| Average    | 27.958  | 28.648     | 0.000      | 0.626        | 27.613       | -                | 99%            |
| Lowest     | 21.496  | 22.048     | 0.000      | 0.422        | 21.328       | -                | -              |

Waste Water Treatment


Past 12 Months

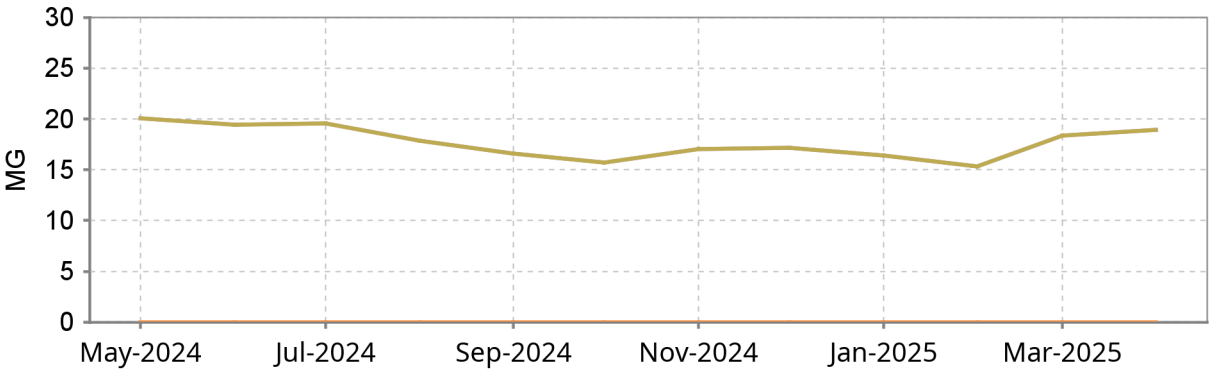

| Date       | WWTP Treated | LVGC Permit | Cedar Breaks Permit | WWTP Permit | Reclaimed Effluent 210A Permit |
|------------|--------------|-------------|---------------------|-------------|--------------------------------|
| May, 2024  | 20.104       | 4.413       | 3.674               | 20.104      | 0.000                          |
| Jun, 2024  | 19.447       | 5.109       | 0.000               | 19.447      | 0.000                          |
| Jul, 2024  | 19.570       | 4.772       | 0.000               | 19.570      | 0.000                          |
| Aug, 2024  | 17.850       | 5.993       | 0.000               | 17.850      | 0.000                          |
| Sep, 2024  | 16.627       | 4.633       | 4.363               | 16.627      | 0.000                          |
| Oct, 2024  | 15.722       | 6.327       | 23.827              | 15.722      | 0.000                          |
| Nov, 2024  | 17.031       | 4.601       | 20.445              | 17.031      | 0.000                          |
| Dec, 2024  | 17.160       | 2.608       | 23.415              | 17.160      | 0.000                          |
| Jan, 2025  | 16.439       | 2.218       | 25.795              | 16.440      | 0.000                          |
| Feb, 2025  | 15.340       | 2.561       | 18.584              | 15.340      | 0.000                          |
| Mar, 2025  | 18.390       | 0.539       | 23.397              | 18.390      | 0.000                          |
| Apr, 2025  | 18.953       | 1.552       | 21.261              | 18.952      | 0.000                          |
| Total (MG) | 212.633      | 45.327      | 164.760             | 212.633     | 0.000                          |
| Highest    | 20.104       | 6.327       | 25.795              | 20.104      | 0.000                          |
| Average    | 17.719       | 3.777       | 13.730              | 17.719      | 0.000                          |
| Lowest     | 15.340       | 0.539       | 0.000               | 15.340      | 0.000                          |

Effluent Disposal


Past 12 Months

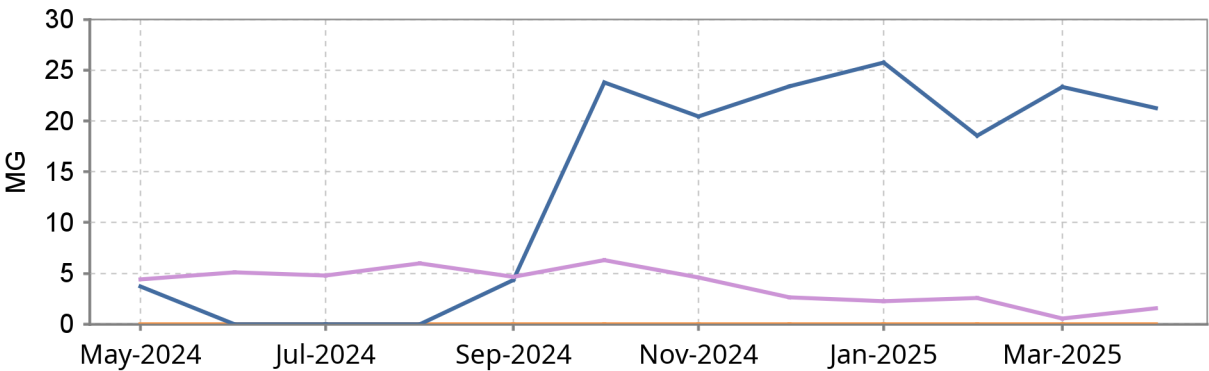

| Date       | LVGC Usage | LVGC Permit | Cedar Brks. Usage | Cedar Brks. Permit | HLGC Usage | Reclaimed E 210A Permit | LVGC Lake Water | HLGC Lake Water |
|------------|------------|-------------|-------------------|--------------------|------------|-------------------------|-----------------|-----------------|
| May, 2024  | 4.413      | 4.413       | 3.674             | 3.674              | 0.000      | 0.000                   | 0.000           | ---             |
| Jun, 2024  | 5.109      | 5.109       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| Jul, 2024  | 4.772      | 4.772       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| Aug, 2024  | 5.993      | 5.993       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |
| Sep, 2024  | 4.633      | 4.633       | 4.363             | 4.363              | 0.000      | 0.000                   | 0.000           | ---             |
| Oct, 2024  | 6.327      | 6.327       | 23.827            | 23.827             | 0.000      | 0.000                   | 0.000           | ---             |
| Nov, 2024  | 4.601      | 4.601       | 20.445            | 20.445             | 0.000      | 0.000                   | 0.000           | ---             |
| Dec, 2024  | 2.605      | 2.608       | 23.415            | 23.415             | 0.000      | 0.000                   | 0.000           | ---             |
| Jan, 2025  | 2.221      | 2.218       | 25.795            | 25.795             | 0.000      | 0.000                   | 0.000           | ---             |
| Feb, 2025  | 2.561      | 2.561       | 18.584            | 18.584             | 0.000      | 0.000                   | 0.000           | ---             |
| Mar, 2025  | 0.539      | 0.539       | 23.397            | 23.397             | 0.000      | 0.000                   | 0.000           | ---             |
| Apr, 2025  | 1.552      | 1.552       | 21.261            | 21.261             | 0.000      | 0.000                   | 0.000           | ---             |
| Total (MG) | 45.327     | 45.327      | 164.760           | 164.760            | 0.000      | 0.000                   | 0.000           | 0.000           |
| Highest    | 6.327      | 6.327       | 25.795            | 25.795             | 0.000      | 0.000                   | 0.000           | ---             |
| Average    | 3.777      | 3.777       | 13.730            | 13.730             | 0.000      | 0.000                   | 0.000           | 0.000           |
| Lowest     | 0.539      | 0.539       | 0.000             | 0.000              | 0.000      | 0.000                   | 0.000           | ---             |

Combined Water Production

5 Year Average Daily Production

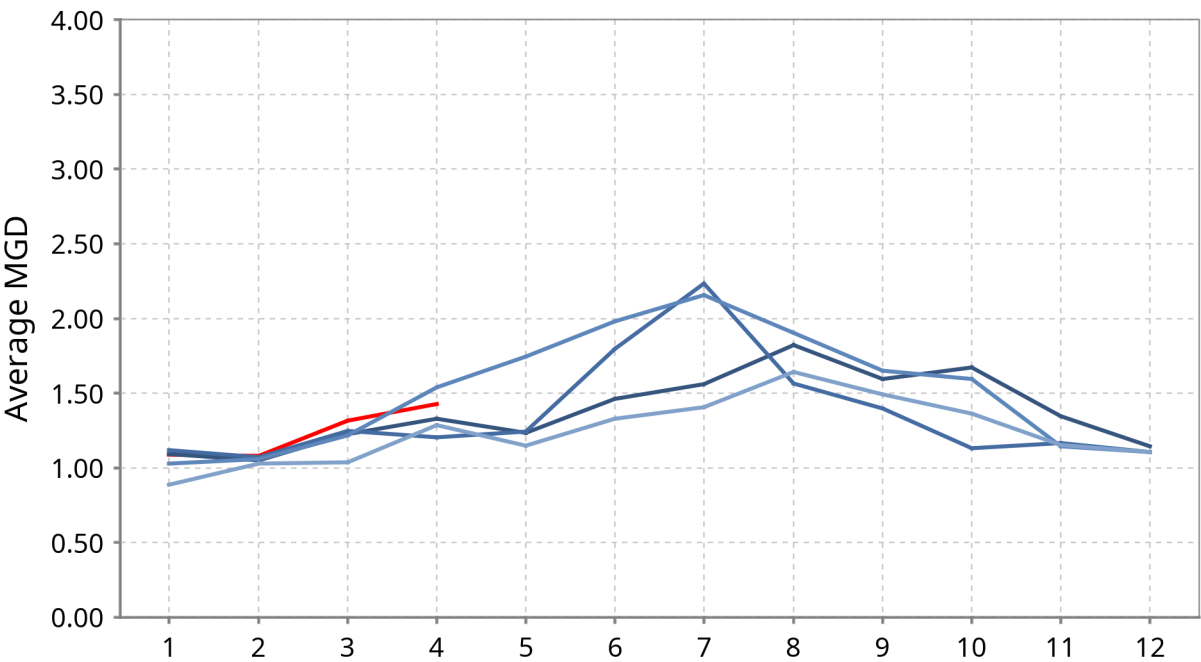


| Month   | Year - 4 | Year - 3 | Year - 2 | Last Year | This Year |
|---------|----------|----------|----------|-----------|-----------|
| Jan     | 0.888    | 1.027    | 1.118    | 1.092     | 1.090     |
| Feb     | 1.030    | 1.059    | 1.073    | 1.052     | 1.082     |
| Mar     | 1.039    | 1.217    | 1.246    | 1.226     | 1.315     |
| Apr     | 1.285    | 1.541    | 1.205    | 1.331     | 1.427     |
| May     | 1.149    | 1.744    | 1.243    | 1.233     | ---       |
| Jun     | 1.330    | 1.982    | 1.796    | 1.461     | ---       |
| Jul     | 1.407    | 2.158    | 2.233    | 1.559     | ---       |
| Aug     | 1.642    | 1.905    | 1.563    | 1.823     | ---       |
| Sep     | 1.492    | 1.652    | 1.400    | 1.595     | ---       |
| Oct     | 1.365    | 1.594    | 1.133    | 1.674     | ---       |
| Nov     | 1.153    | 1.144    | 1.166    | 1.345     | ---       |
| Dec     | 1.105    | 1.108    | 1.107    | 1.145     | ---       |
| Highest | 1.642    | 2.158    | 2.233    | 1.823     | 1.427     |
| Average | 1.240    | 1.511    | 1.357    | 1.378     | 1.229     |
| Lowest  | 0.888    | 1.027    | 1.073    | 1.052     | 1.082     |



Waste Water Treatment

5 Year Average Daily Treated

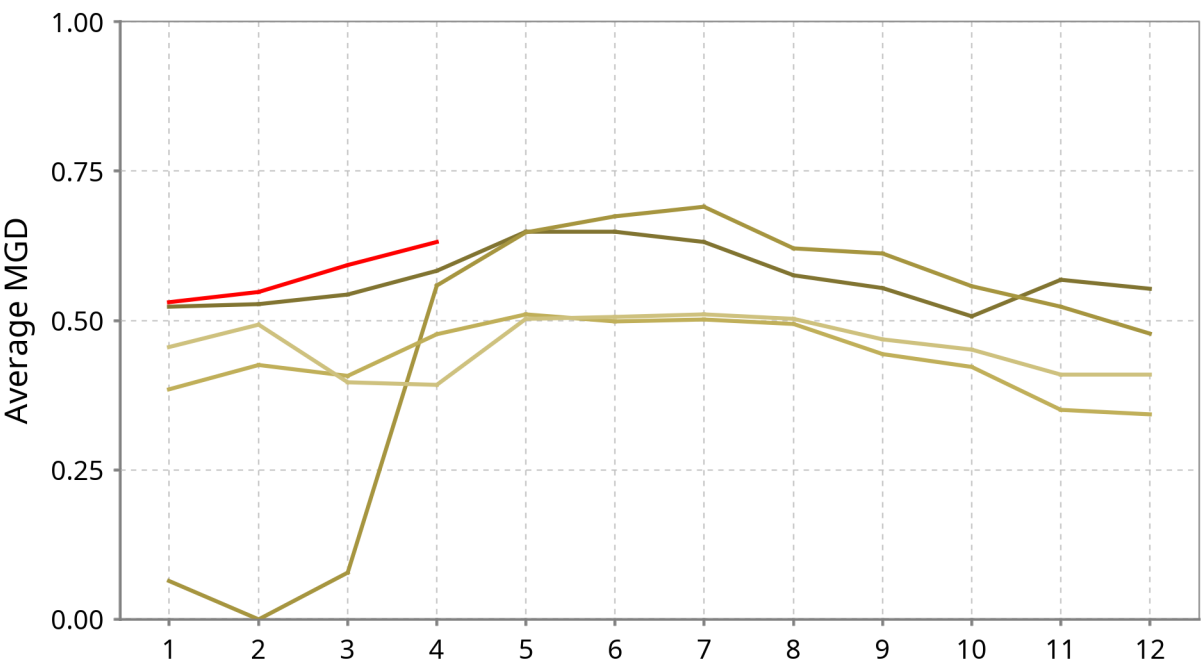

| Month   | Year - 4 | Year - 3 | Year - 2 | Last Year | This Year |
|---------|----------|----------|----------|-----------|-----------|
| Jan     | 0.456    | 0.385    | 0.064    | 0.523     | 0.530     |
| Feb     | 0.493    | 0.425    | 0.000    | 0.528     | 0.548     |
| Mar     | 0.396    | 0.407    | 0.078    | 0.543     | 0.593     |
| Apr     | 0.392    | 0.477    | 0.559    | 0.583     | 0.632     |
| May     | 0.503    | 0.511    | 0.648    | 0.649     | ---       |
| Jun     | 0.506    | 0.499    | 0.675    | 0.648     | ---       |
| Jul     | 0.510    | 0.502    | 0.690    | 0.631     | ---       |
| Aug     | 0.503    | 0.494    | 0.620    | 0.576     | ---       |
| Sep     | 0.469    | 0.443    | 0.612    | 0.554     | ---       |
| Oct     | 0.451    | 0.422    | 0.557    | 0.507     | ---       |
| Nov     | 0.409    | 0.351    | 0.523    | 0.568     | ---       |
| Dec     | 0.410    | 0.343    | 0.478    | 0.554     | ---       |
| Highest | 0.510    | 0.511    | 0.690    | 0.649     | 0.632     |
| Average | 0.458    | 0.438    | 0.459    | 0.572     | 0.576     |
| Lowest  | 0.392    | 0.343    | 0.000    | 0.507     | 0.530     |

# Utilities Department

# **April 2025 Field Crew & Fleet Maintenance Report**

## **Field Crews Report**

Repair and installed Valve Concrete Aprons  
Five Sewer Service Installs  
One Sewer Main Install  
Fire Hydrant Pressure Check  
Two Water Leak Repairs  
Three Fire Hydrant Replacement  
Two Water Service Installs  
Water Pressure Check  
One Sewer Issue  
Silt Fence Removal  
Potholes for (Pond 17) Data  
Manhole Ring Replacement

## **Fleet Maintenance Report**

Hydro Vac was dropped off for Maintenance and Repairs  
Three Oil Changes and Topped off Fluids  
Hydraulic Filter Replacement  
Installed Vehicle Decals



# Work Management Requests

Lago Vista

Date Range: 4/1/2025 - 4/30/2025

| Start Date         | End Date           | Status   | Request ID                                                 | Type      | Sub Type             | Assigned To  |
|--------------------|--------------------|----------|------------------------------------------------------------|-----------|----------------------|--------------|
| 4/30/2025 12:00 AM | 5/1/2025 12:00 AM  | Complete | (CONCRETE APRON) SURREY LN                                 | Utilities | Other                | Steve Castro |
| 4/30/2025 12:00 AM | 4/30/2025 12:00 AM | Complete | (SEWER SERVICE INSTALL) 21801 SURREY LN                    | Utilities | Other                | Steve Castro |
| 4/29/2025 12:00 AM | 4/29/2025 12:00 AM | Complete | (FH PRESSURE CHECK) MACARTHUR AVE                          | Utilities | Other                | Steve Castro |
| 4/29/2025 12:00 AM | 4/30/2025 12:00 AM | Complete | (WATER LEAK) 21709 OSAGE LN                                | Utilities | Water Leak           | Steve Castro |
| 4/28/2025 12:00 AM | 4/28/2025 12:00 AM | Complete | (SEWER SERVICE INSTALL) 3808 CAPITOL AVE                   | Utilities | Other                | Steve Castro |
| 4/21/2025 12:00 AM | 4/21/2025 12:00 AM | Complete | ( FH Replacement) Buena Vista                              | Utilities | FH Issue/Replacement | Steve Castro |
| 4/14/2025 12:00 AM | 4/15/2025 12:00 AM | Complete | (SEWER SERVICE INSTALL) 21109 SANTA PAULA AVE              | Utilities | Other                | Steve Castro |
| 4/9/2025 12:00 AM  | 4/10/2025 12:00 AM | Complete | (WATER SERVICE INSTALLATION) 21701 OREGON LN               | Utilities | Other                | Steve Castro |
| 4/9/2025 12:00 AM  | 4/10/2025 12:00 AM | Complete | (SEWER MAIN EXT. AND SERVICE INSTALLATION) 21701 OREGON LN | Utilities | Other                | Steve Castro |
| 4/7/2025 12:00 AM  | 4/8/2025 12:00 AM  | Complete | (SEWER SERVICE INSTALL) 3705 BUCKEYE DR                    | Utilities | Other                | Steve Castro |
| 4/7/2025 12:00 AM  | 4/8/2025 12:00 AM  | Complete | (WATER SERVICE INSTALL) 3705 BUCKEYE DR                    | Utilities | Other                | Steve Castro |
|                    |                    |          |                                                            | Total     | 11                   |              |



# Fleet Events By Date Range

Lago Vista

Date Range:

4/1/2025 - 4/30/2025

**Date:** 4/3/2025

**Status:** Complete

**Assigned To:** Ernesto Rios

**Event ID:** Sprayer Repair

**Event Type:** Service

**Work Order ID:**

**Feature ID:** Hydro Vac

**Feature Class:** Fleet Unit

**Fee:**

**Note:** -Hydro Vac PSI system and Sprayer was not working. It was Dropped off at Veermer for Maintenance and Repairs.

**Date:** 4/22/2025

**Status:** Complete

**Assigned To:** Joel Peer

**Event ID:** 7019

**Event Type:** Maintenance

**Work Order ID:**

**Feature ID:** Chevy 2500 Pickup

**Feature Class:** Fleet Unit

**Fee:**

**Note:** oil a.nd filter changed fluids topped off

**Date:** 4/30/2025

**Status:** Complete

**Assigned To:** Joel Peer

**Event ID:** mini ex #3

**Event Type:** Maintenance

**Work Order ID:**

**Feature ID:** John Deere 35G mini ex **Feature Class:** Fleet Unit

**Fee:**

**Note:** oil and filter changed, fuel filter changed, hydraulic filter changed.

**Date:** 4/16/2025

**Status:** Complete

**Assigned To:** Joel Peer

**Event ID:** 7021

**Event Type:** Maintenance

**Work Order ID:**

**Feature ID:** GMC SERRIA

**Feature Class:** Fleet Unit

**Fee:**

**Note:** oil and fliter changed, fluids topped off, and number decals installed.

**Total**

4



# Work Management Requests

Lago Vista

Date Range: 4/1/2025 - 4/30/2025

| Start Date         | End Date           | Status   | Request ID                               | Type      | Sub Type             | Assigned To  |
|--------------------|--------------------|----------|------------------------------------------|-----------|----------------------|--------------|
| 4/29/2025 12:00 AM | 4/29/2025 12:00 AM | Complete | (WATER PRESSURE ISSUE) 21806 ORWELL CV   | Utilities | Other                | Luis Mendoza |
| 4/29/2025 12:00 AM | 4/30/2025 12:00 AM | Complete | (SEWER ISSUE) 2004 AMERICAN DR           | Utilities | Other                | Luis Mendoza |
| 4/28/2025 12:00 AM | 4/28/2025 12:00 AM | Complete | (FH Replacement) Patriot                 | Utilities | FH Issue/Replacement | Luis Mendoza |
| 4/28/2025 12:00 AM | 4/28/2025 12:00 AM | Complete | (SEWER ISSUE) 2004 AMERICAN DR           | Utilities | Other                | Luis Mendoza |
| 4/23/2025 12:00 AM | 4/23/2025 12:00 AM | Complete | Remove silt fence along 1431             | Utilities | Other                | Luis Mendoza |
| 4/21/2025 12:00 AM | 4/22/2025 12:00 AM | Complete | FH Replacement: Round Up                 | Utilities | FH Issue/Replacement | Luis Mendoza |
| 4/14/2025 12:00 AM | 4/17/2025 12:00 AM | Complete | (Pothole) Pond 17th                      | Utilities | Other                | Luis Mendoza |
| 4/14/2025 12:00 AM | 4/14/2025 12:00 AM | Complete | (Manhole Ring Replacement) Outpost Trace | Utilities | Other                | Luis Mendoza |
| 4/9/2025 12:00 AM  | 4/9/2025 12:00 AM  | Complete | (WATER LEAK) 20700 FAWN CIRCLE           | Utilities | Water Leak           | Luis Mendoza |
| 4/7/2025 12:00 AM  | 4/7/2025 12:00 AM  | Complete | (Pothole #3) Pond 17                     | Utilities | Other                | Luis Mendoza |
| 4/7/2025 12:00 AM  | 4/7/2025 12:00 AM  | Complete | (Pothole #4) Pond 17                     | Utilities | Other                | Luis Mendoza |
| 4/7/2025 12:00 AM  | 4/7/2025 12:00 AM  | Complete | (Pothole #1) Pond 17                     | Utilities | Other                | Luis Mendoza |
|                    |                    |          |                                          | Total     | 12                   |              |

# Street Department

## 2025-2026 STREET DEPARTMENT WEEKLY ACTIVITY REPORT

| 4/24/2025                            | SUN | MON | TUE | WED | THUR | FRI | SAT | TOTALS |
|--------------------------------------|-----|-----|-----|-----|------|-----|-----|--------|
| <b><u>STREET PATCHING</u></b>        |     |     |     |     |      |     |     |        |
| Tons of Asphatt Used                 |     |     |     |     |      |     |     | 0      |
| Number of Patches                    |     |     |     |     |      |     |     | 0      |
| Square Feet of Patches               |     |     |     |     |      |     |     | 0      |
| Tons of Base Material Used           |     |     |     |     |      |     |     | 0      |
| Repaint Intersections                |     |     |     |     |      |     |     | 0      |
| Replace Reflective Buttons           |     |     |     |     |      |     |     | 0      |
| <b><u>CRACK SEAL PROGRAM</u></b>     |     |     |     |     |      |     |     |        |
| Linear Feet of Crack Seating         |     |     |     |     |      |     |     | 0      |
| <b><u>LANDSCAPING ACTIVITIES</u></b> |     |     |     |     |      |     |     |        |
| WorkerHours                          |     | 9   | 4   |     |      |     |     | 13     |
| <b><u>ROADSIDE MOWING</u></b>        |     |     |     |     |      |     |     |        |
| MilesMowed                           |     |     |     |     |      |     |     | 0      |
| <b><u>TRAFFIC CONTROL</u></b>        |     |     |     |     |      |     |     |        |
| New Signs Installed                  |     |     |     |     |      |     |     | 0      |
| Signs Replaced                       |     | 2   |     |     |      |     |     | 2      |
| <b><u>DRAINAGE MAINTENANCE</u></b>   |     |     |     |     |      |     |     |        |
| Projects Completed                   |     |     |     |     |      |     |     | 0      |
| Linear Feet of Drtches Cleared       |     |     |     |     |      |     |     | 0      |
| Culverts Cleared                     |     |     |     |     |      |     |     | 0      |



## 2025-2026 STREET DEPARTMENT WEEKLY ACTIVITY REPORT

| 4/24/2025                              | SUN | MON | TUE | WED | THUR | FRI | SAT | TOTALS |
|----------------------------------------|-----|-----|-----|-----|------|-----|-----|--------|
| <b><u>MISCELLANEOUS ACTIVITIES</u></b> |     |     |     |     |      |     |     |        |
| Worker Hours on City Clean Up          |     |     |     |     |      |     |     | 0      |
| Worker Hours on Bum Day                |     |     |     |     |      |     |     | 0      |
| Worker Hours on Park Maint.            |     |     |     |     |      |     |     | 0      |
| Worker Hours on X-Mas Lights           |     |     |     |     |      |     |     | 0      |
| Worker Hours on Tree Trimming          |     |     |     |     |      |     |     | 0      |
| Deer Pick Ups                          |     |     |     | 1   |      |     |     | 1      |
| Bldg. Maintenance Requests             |     |     |     |     |      |     |     | 0      |
| Pool Operation & Maintenance (hrs)     |     |     |     |     |      |     |     | 0      |
| Airport Maintenance (hrs)              |     |     |     |     |      |     |     | 0      |
| Mowing Bark Golf Course (hrs)          |     |     |     |     |      |     |     | 0      |
| Assist Utility Department (hrs)        |     |     |     |     |      |     |     | 0      |
| Assist CIP Projects (hrs)              |     |     |     |     |      |     |     | 0      |
| Assist Plant Operations (hrs)          |     |     |     |     |      |     |     | 0      |
| Assist Library (hrs)                   |     |     |     |     |      |     |     | 0      |
| Assist Effluent Department (hrs)       |     |     |     |     |      |     |     | 0      |
| Assist Golf Courses (hrs)              |     |     |     |     |      |     |     | 0      |
| Assist LVPD (hrs)                      |     |     |     |     |      |     |     | 0      |
| KI VB Projects (hrs)                   |     |     |     |     |      |     |     | 0      |
| Special Events (hrs)                   |     | 8   | 4   |     |      |     |     | 12     |
| Loads of Brush Collected               |     |     |     |     |      |     |     | 0      |
| Wood Chipping (hrs)                    |     | 8   | 8   | 8   |      |     |     | 24     |
| Loads of Mulch Picked Up               |     |     |     |     |      |     |     | 0      |
| Trash/Metal Collection (hrs)           |     |     |     |     |      |     |     | 0      |
| <b><u>SPECIAL COMMENTS</u></b>         |     |     |     |     |      |     |     |        |

Raised the flags back up after the Pope's funeral